

TABLE 4: WATER USE SUMMARY

FILL IN DEVELOPMENT NAME AND CITY CASE NUMBER ON TAB 1

WATER USE SUMMARY FOR THE DEVELOPMENT

USE CATEGORY	AMOUNT	UNITS	% OF TOTAL USE	CALCULATION NOTES
A. TOTAL DAILY AVERAGE WATER USE	104,260	GPD	100.0%	A=B+C, C=D+E, F=B+D
B. OUTDOOR CONSUMPTIVE USE	13,164	GPD	12.6%	
C. TOTAL INDOOR USE	91,096	GPD	87.4%	
D. INDOOR CONSUMPTIVE USE	13,656	GPD	13.1%	
E. WASTEWATER TO SEWER	77,441	GPD	74.3%	
F. TOTAL CONSUMPTIVE USE (NET USE)	26,820	GPD	25.7%	

NOTES:

GPD=GALLONS PER DAY

ALL VALUES ARE FOR AVERAGE WATER USE ANALYSIS ONLY. THIS CALCULATION IS NOT INTENDED TO BE USED FOR INFRASTRUCTURE DESIGN, PEAK FLOW DETERMINATION, OR SYSTEM CAPACITY ANALYSIS. FOR THESE PURPOSES REFER TO CH.6 & 7 OF THE CITY'S DESIGN STANDARDS AND POLICY MANUAL FOR THE RESPECTIVE DESIGN VALUES, PEAKING FACTORS, AND DESIGN REQUIREMENTS.

TOTAL AVERAGE WATER USE (GALLONS PER DAY, GPD)

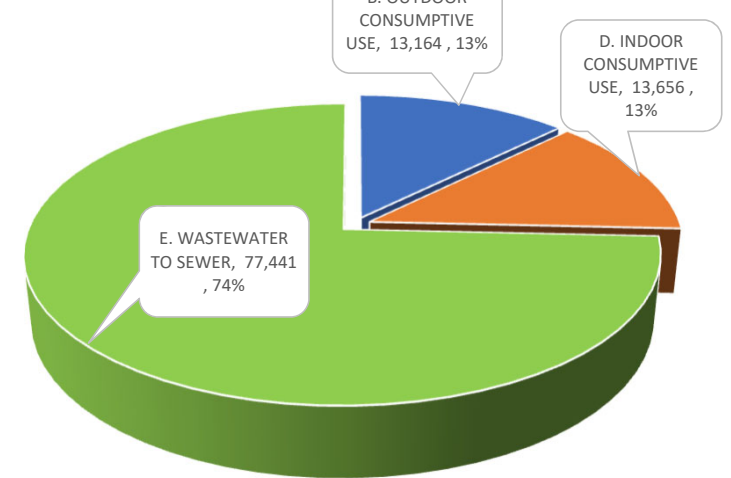


TABLE INPUT VALUES LAST UPDATED:

10/2/2025