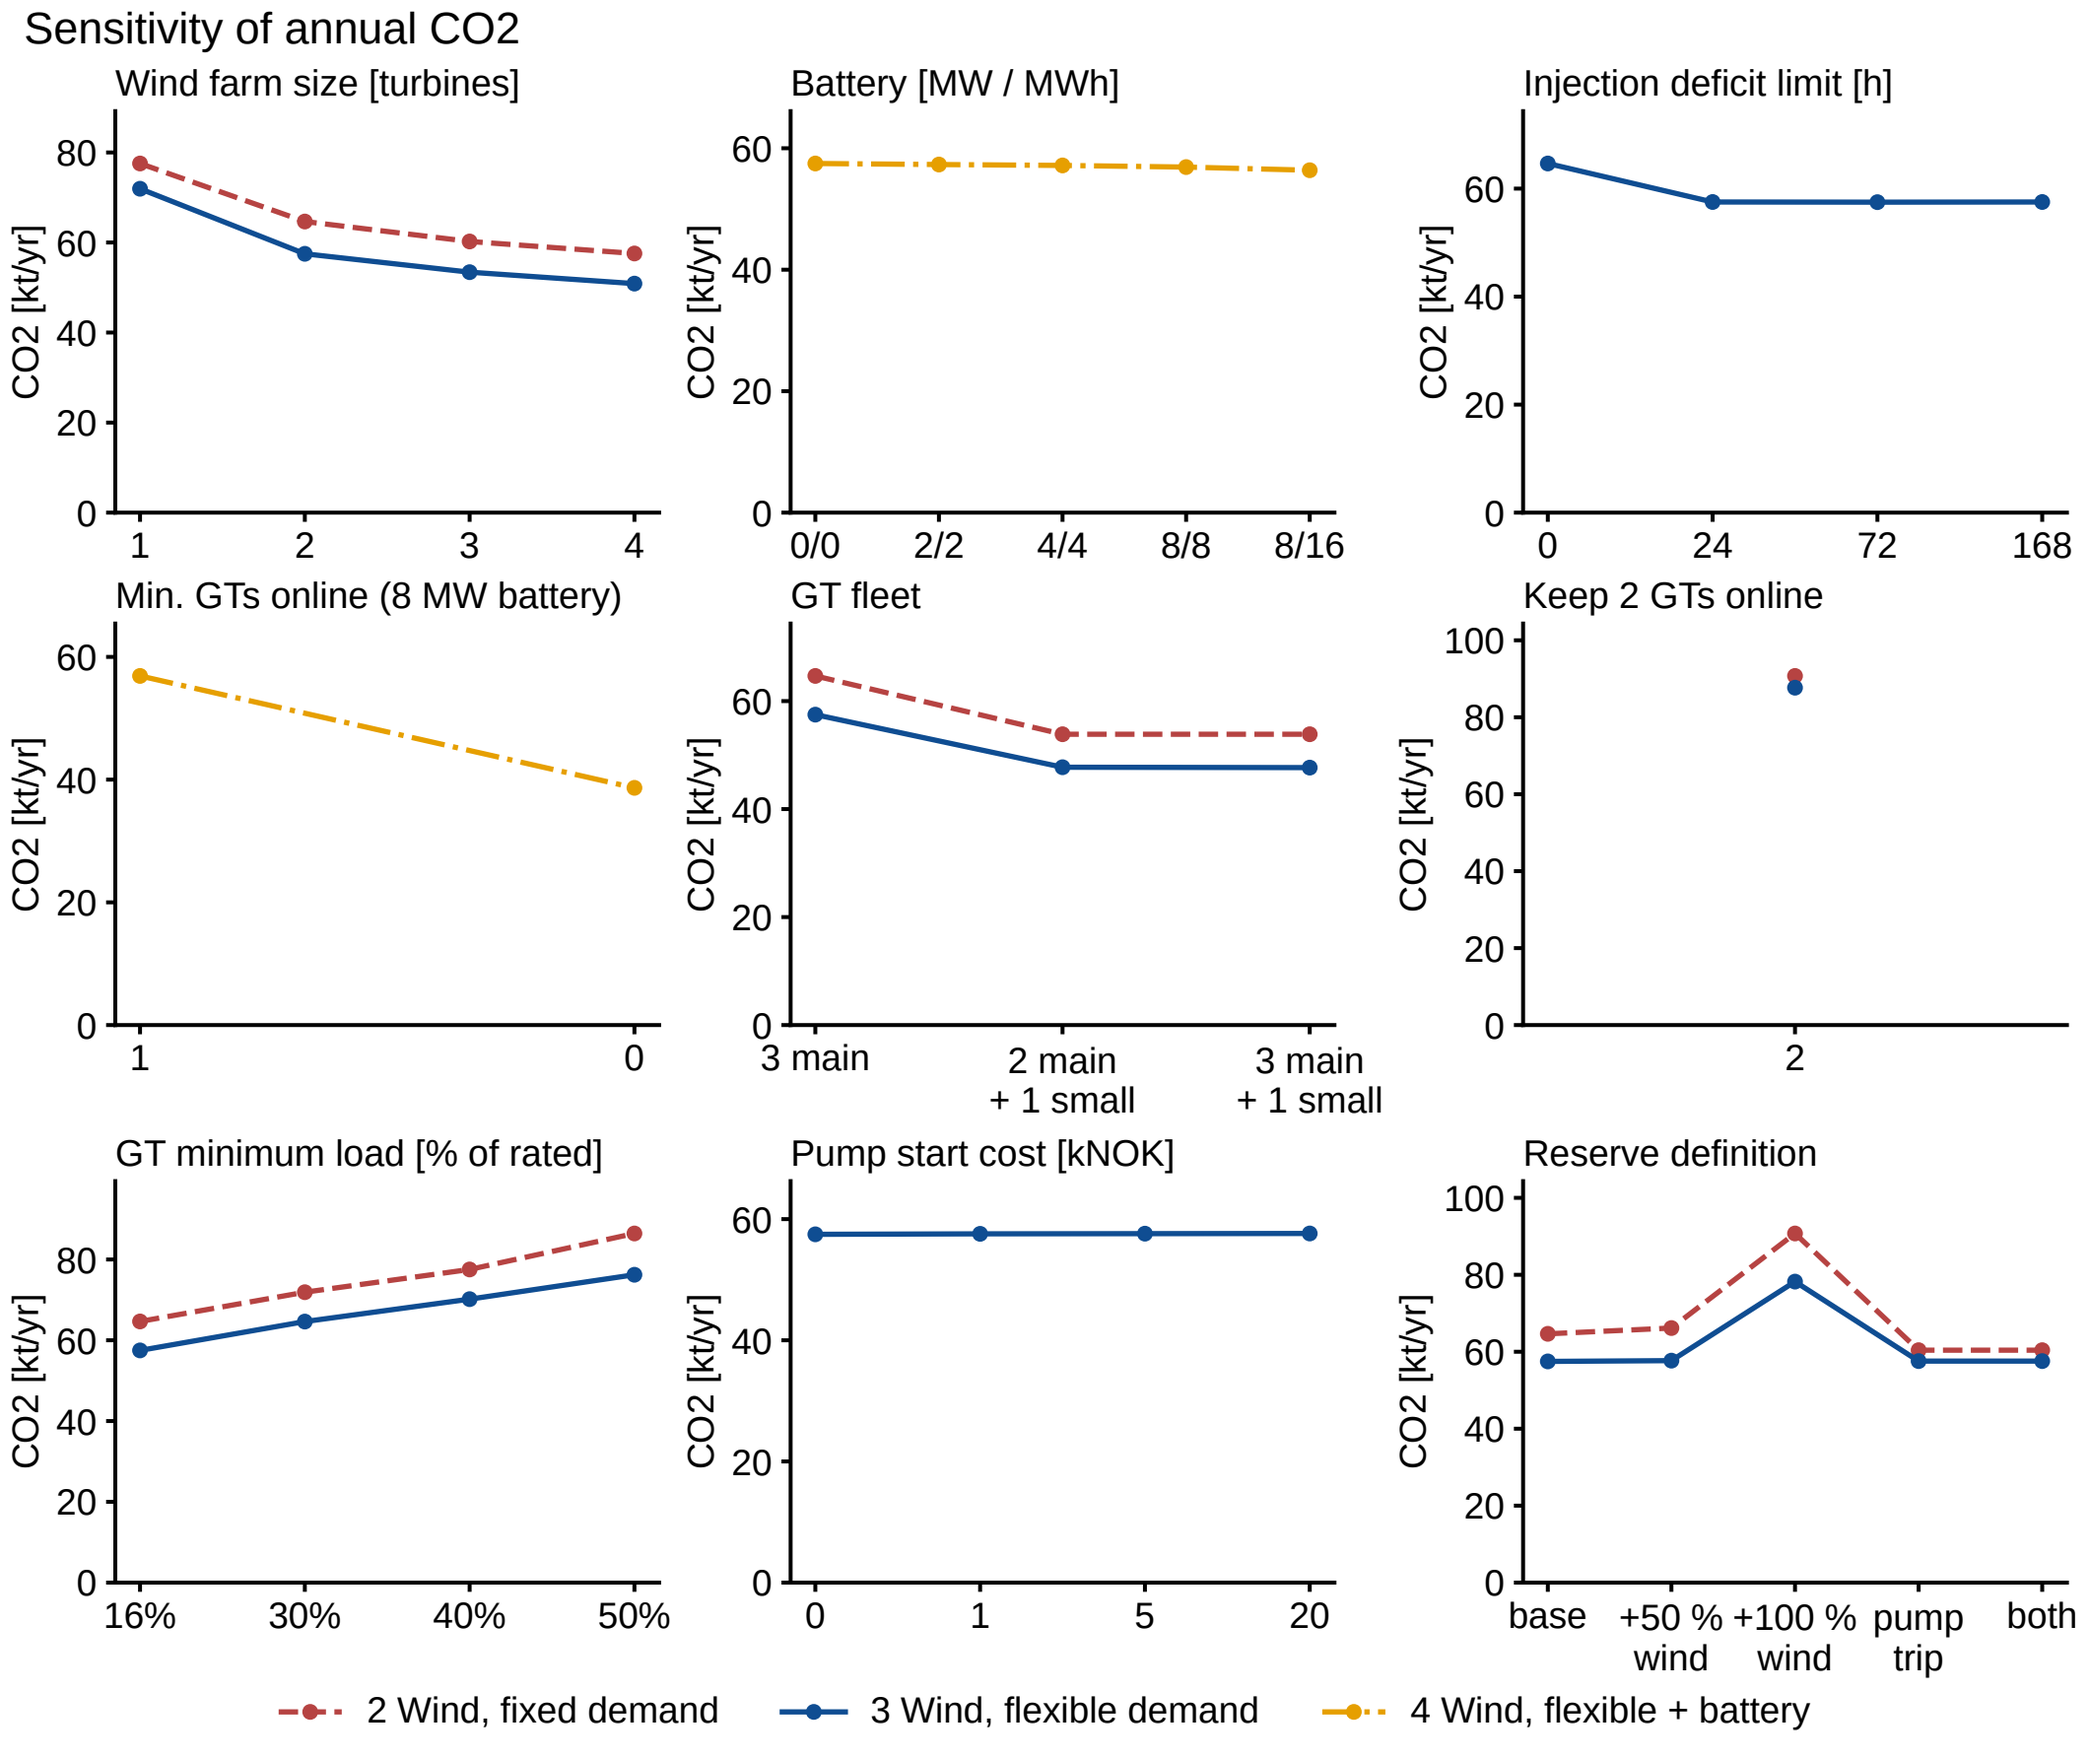
Sensitivity of annual CO2
Wind farm size [turbines]
Battery [MW / MWh]
Injection deficit limit [h]
Min. GTs online (8 MW battery)
GT fleet
Keep 2 GTs online
GT minimum load [% of rated]
Pump start cost [kNOK]
Reserve definition
CO2 [kt/yr]
0/0
2/2
4/4
8/8
8/16
3 main
2 main + 1 small
3 main + 1 small
base
+50 % wind
+100 % wind
pump trip
both
2 Wind, fixed demand
3 Wind, flexible demand
4 Wind, flexible + battery