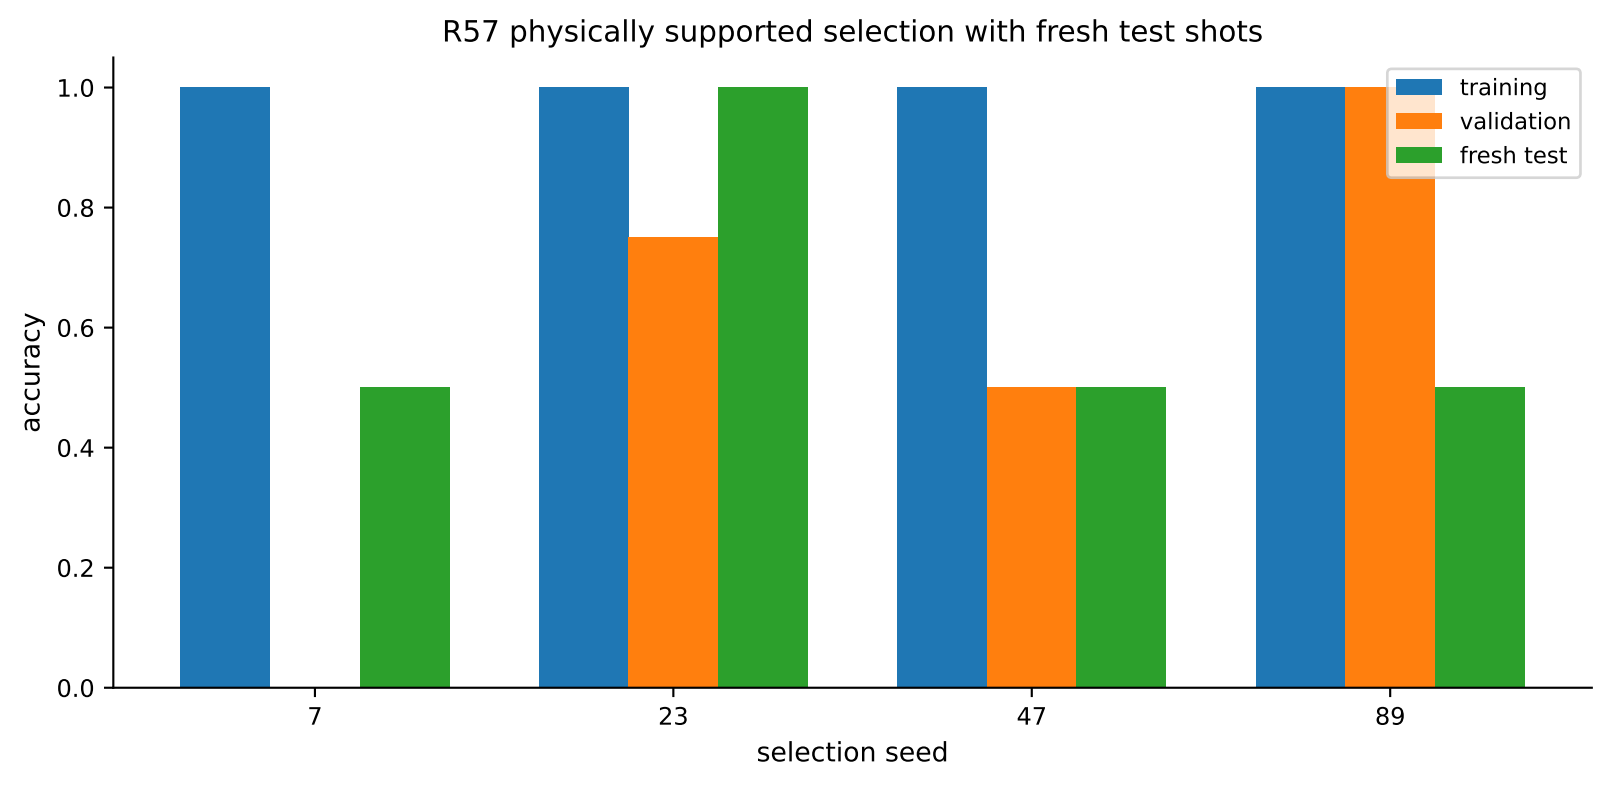
R57 physically supported selection with fresh test shots
training
validation
fresh test
accuracy
1.0
0.8
0.6
0.4
0.2
0.0
7
23
47
89
selection seed