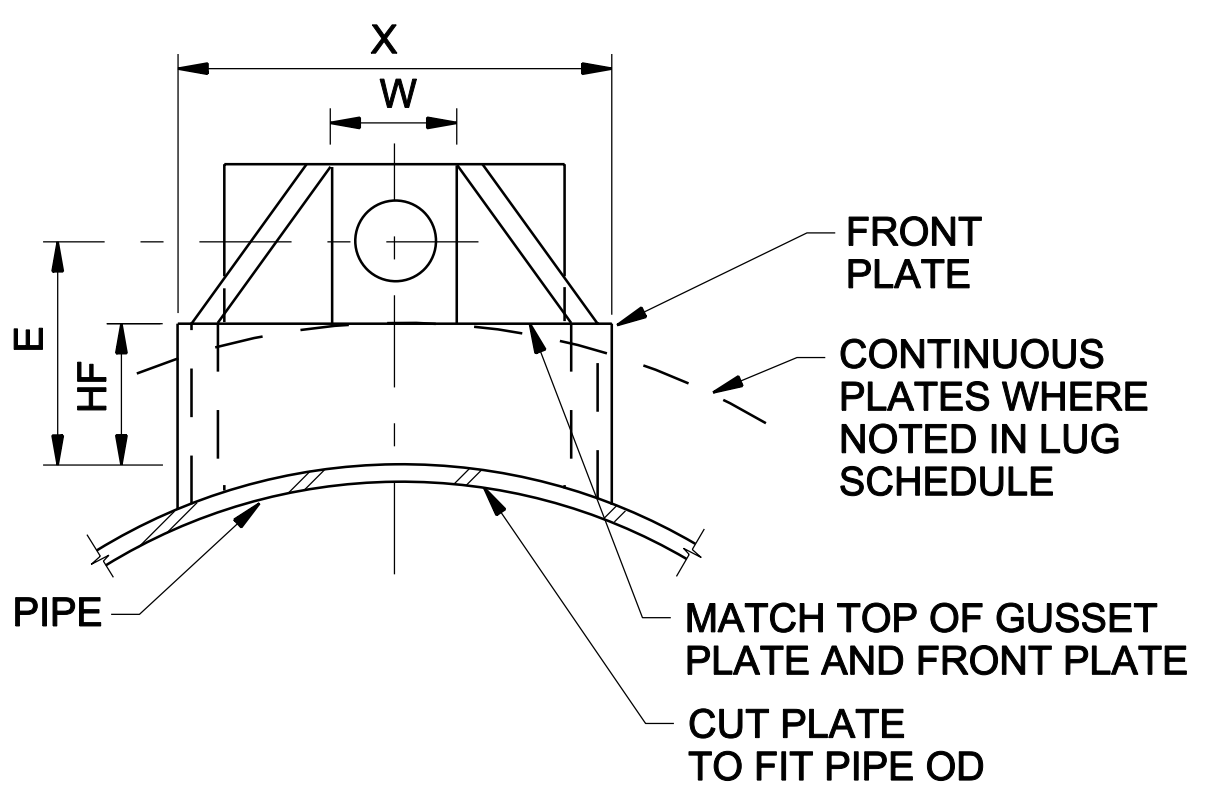

FRONT ELEVATION

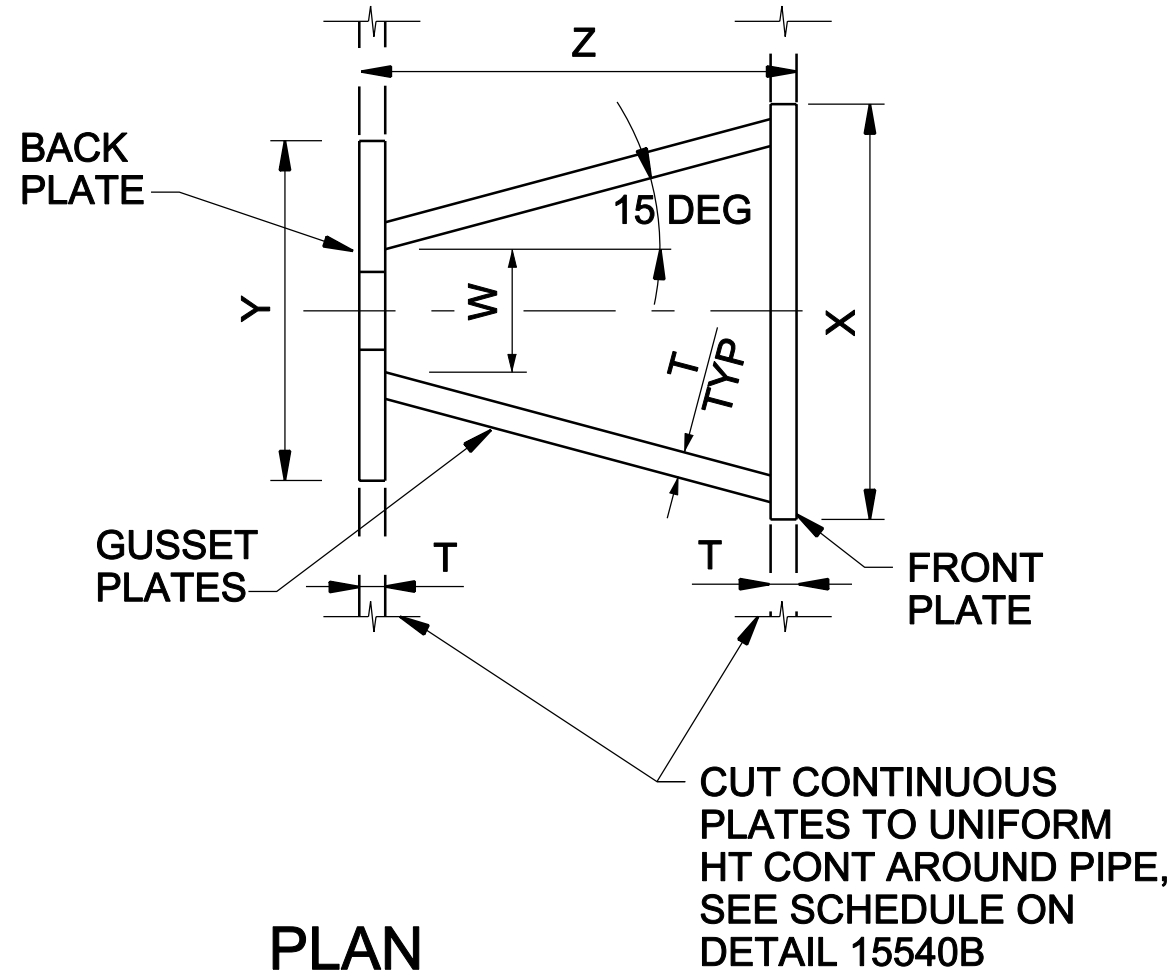

PLAN

NOTES:

1. LUG SCHEDULE DIMENSIONS IN MILLIMETERS.
2. PLATE SHALL CONFORM TO ASTM A283 GRADE D.
3. TIE ROD LUGS SHALL BE SPACED EQUALLY AROUND PIPE.
4. FILLET WELDS SHALL MEET THE MINIMUM REQUIREMENTS OF THE BS 4872 PART 1 AND BS-EN 287-1 SPECIFICATIONS EXCEPT AS FOLLOWS: FILLET WELDS SHALL BE 6mm MINIMUM EXCEPT WHEN WELDING 5mm PLATE WHERE THEY SHALL BE 5mm.
5. LUG TYPE I IS AS SHOWN IN DETAIL. LUG TYPE II HAS CONTINUOUS FRONT AND BACK PLATES AROUND PIPE.
6. THE MINIMUM PIPE WALL THICKNESSES SHOWN ARE TO ENSURE PROPER PERFORMANCE OF THE THRUST TIE LUG. PIPE WALL THICKNESSES GREATER THAN SHOWN IN THE TABLE MAY BE REQUIRED AND MAY BE SHOWN ELSEWHERE OR SPECIFIED ELSEWHERE TO RESIST INTERNAL PRESSURES.

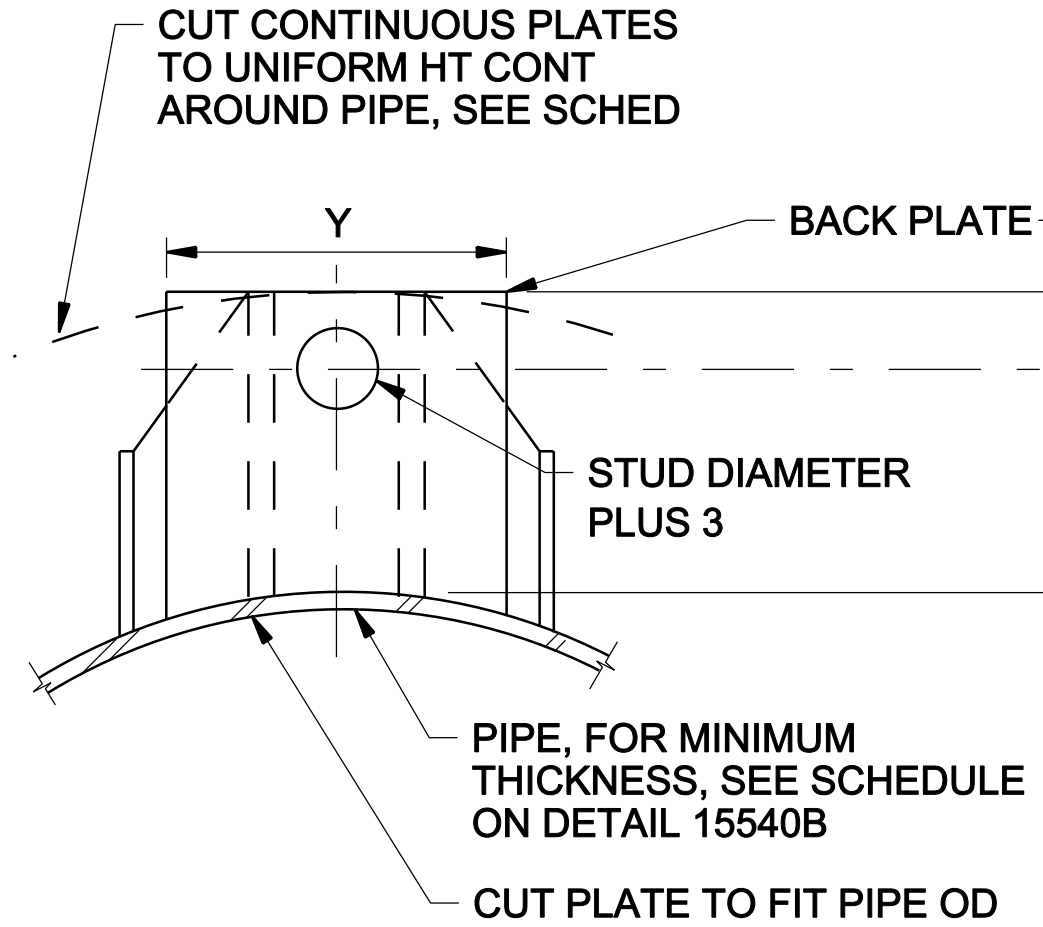

BACK ELEVATION

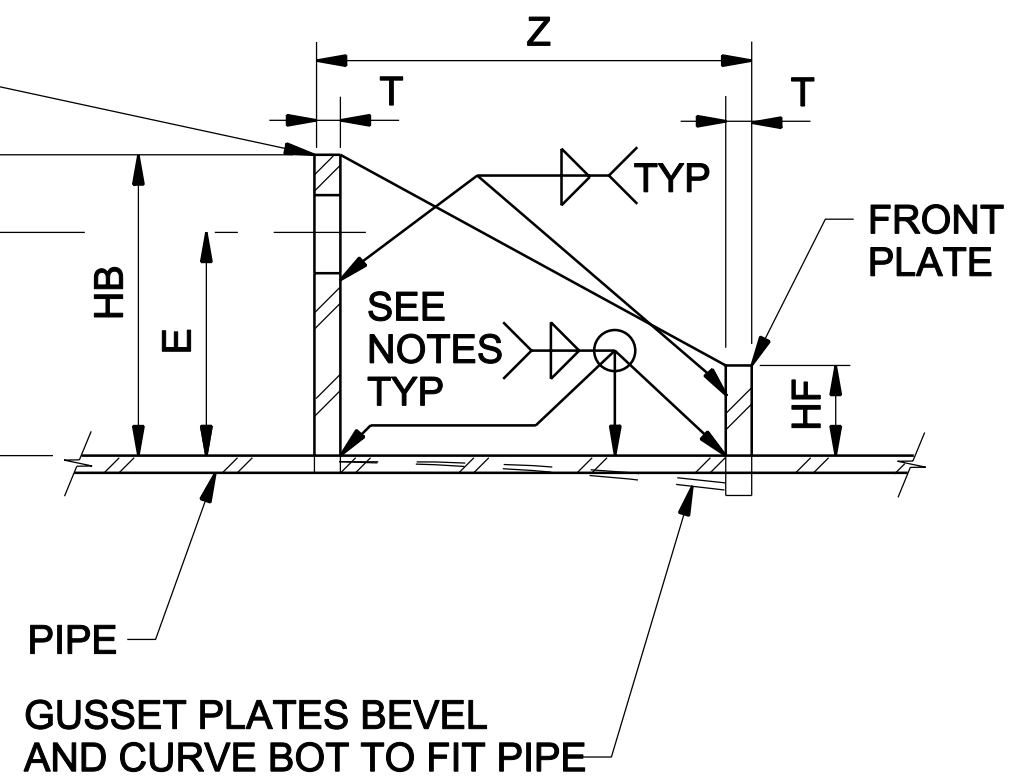

SECTION

LUG SCHEDULE

ROD DIA	LUG TYPE	T	W	X	Y	Z	HB	E	HF	L
16	I	10	35	103	114	86	98	76	44	75
20	I	10	38	127	114	127	105	79	44	75
22	I	12	41	140	114	130	105	79	44	100
25	II	12	44	146	CONT	152	105	83	51	100
30	II	16	50	184	CONT	194	140	95	51	100
40	II	20	57	229	CONT	290	140	98	51	100
44	III	25	64	CONT	CONT	302	149	102	57	100
50	III	25	70	CONT	CONT	352	159	108	57	100

NOTES :

1. ALL DIMENSIONS IN MILLIMETER, UNLESS OTHERWISE NOTED.
2. 'CONT' MEANS 'CONTINUOUS' AROUND PIPE CIRCUMFERENCE.

SPECIAL THRUST TIE FOR STEEL PIPE - LUG DETAIL AND SCHEDULE

NTS

SHT 3 OF 3

15540C

STANDARD DETAIL

JACOBS

REV 2 19 APR 2018