

PARTICULAR SPECIFICATION P4F

Appendix 4F- ROP/G1 Water Quality

CONTENTS

P4F.1	ROP/G1 Water Quality	1
P4F.2	ROP/G1 interfaces.....	3

P4F.1 ROP/G1 WATER QUALITY

Table P4F-1: ROP/G1 Water Quality

Parameter	Units	ROP/G1 Max ¹	ROP/G1 Avg ²	Test Method (For Reference)
Turbidity	NTU	<0.5	<0.5	USEPA/180.1
Conductivity	µS/cm	<100	75	USEPA/120.1
pH	-	4.5 – 6.5	4.5 – 6.5	USEPA/9040B
Colour	Hazen	<5	<5	USEPA/110.2
Total Hardness	mg/L (as CaCO ₃)	< 5	1	APHA/2340B
Total Dissolved Solids (TDS)	mg/L	<50	25	APHA/2540C
Total Organic Carbon (TOC) ^{Note 1}	mg/L	<0.1	<0.1	
Ammoniacal Nitrogen (as N)	mg/L	<0.5	0.5	
Nitrate (as N)	mg/L	<2.26	2	
Aluminium	mg/L	<0.05	<0.05	
Barium	mg/L	<0.05	<0.05	
Boron	mg/L	<0.5	<0.5	
Calcium	mg/L	< 0.75	< 0.75	USEPA/6010B
Chloride	mg/L	< 6	< 6	USEPA/300.0
Copper	mg/L	<0.05	<0.05	
Fluoride	mg/L	<0.5	<0.5	
Iron	mg/L	<0.04	<0.04	
Manganese	mg/L	<0.05	<0.05	
Silica (as SiO ₂)	mg/L	<1.3	0.5	
Sodium	mg/L	<12	6	USEPA/6010B

Table P4F-1: ROP/G1 Water Quality

Parameter	Units	ROP/G1 Max ¹	ROP/G1 Avg ²	Test Method (For Reference)
Strontium	mg/L	<0.1	<0.1	
Sulphate (as SO ₄)	mg/L	<1.0	0.5	
Zinc	mg/L	<0.1	<0.1	
Formaldehyde	µg/L	<0.1		
Total Trihalomethane (TTHM)	µg/L	<18		
Bacterial / Viral				
Enterovirus	PFU/400mL	Not detectable	Not detectable	USEPA 600 / 4- 84-013
E Coli	CFU/100mL	<1		APHA 9223
Heterotrophic Plate Count (35°C, 48h)	CFU/mL	<100	<100	APHA/9215 B/C
Total coliform bacteria	CFU/100mL	Not detectable	Not detectable	APHA/9222B
1. ROP/G1 Max - Maximum water quality for RO Permeate (ROP/G1) 2. ROP/G1 Ave - Average water quality for RO Permeate (ROP/G1)				

P4F.2 ROP/G1 INTERFACES

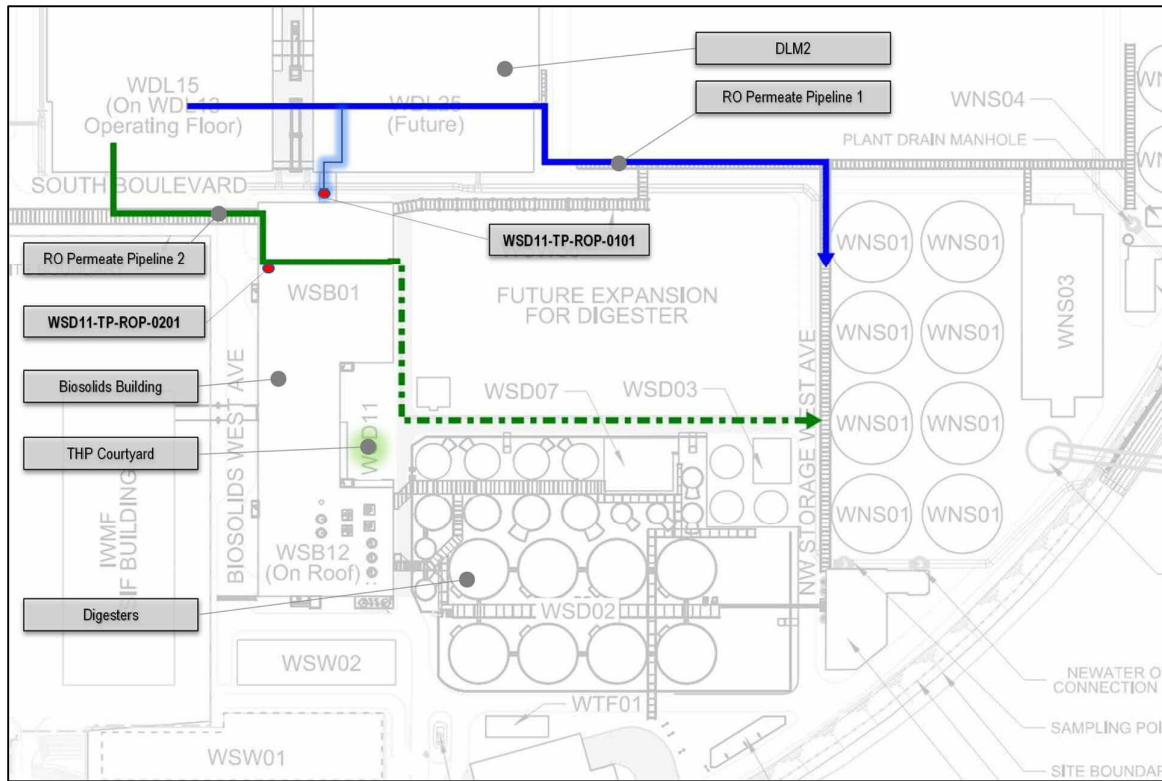


Figure P4F. 2 Indicative location of ROP/G1 tie-in points for connections

END OF SECTION