


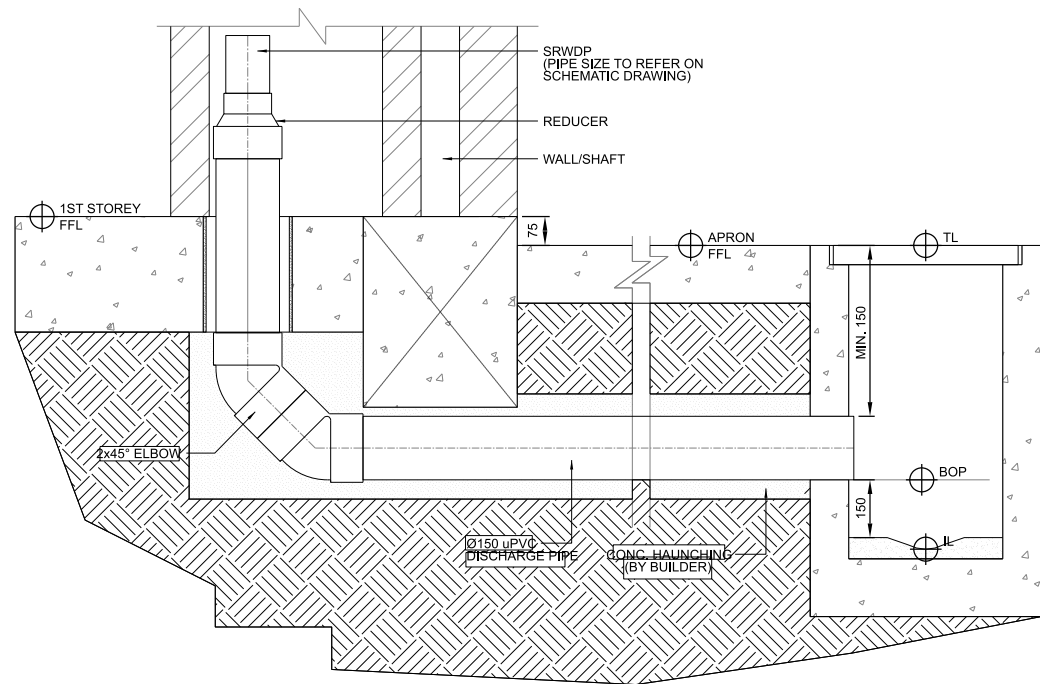


**TYPE 1
TYPICAL DISCHARGE DETAIL**

1:10

NOTE:

1. DRAIN INVERT LEVEL RECOMMENDED TO BE MINIMUM 150mm LOWER THAN BOTTOM OF DISCHARGE PIPE AND DRAIN TOP LEVEL TO BE MINIMUM 150mm HIGHER THAN TOP OF DISCHARGE PIPE (BUILDER TO CONFIRM).

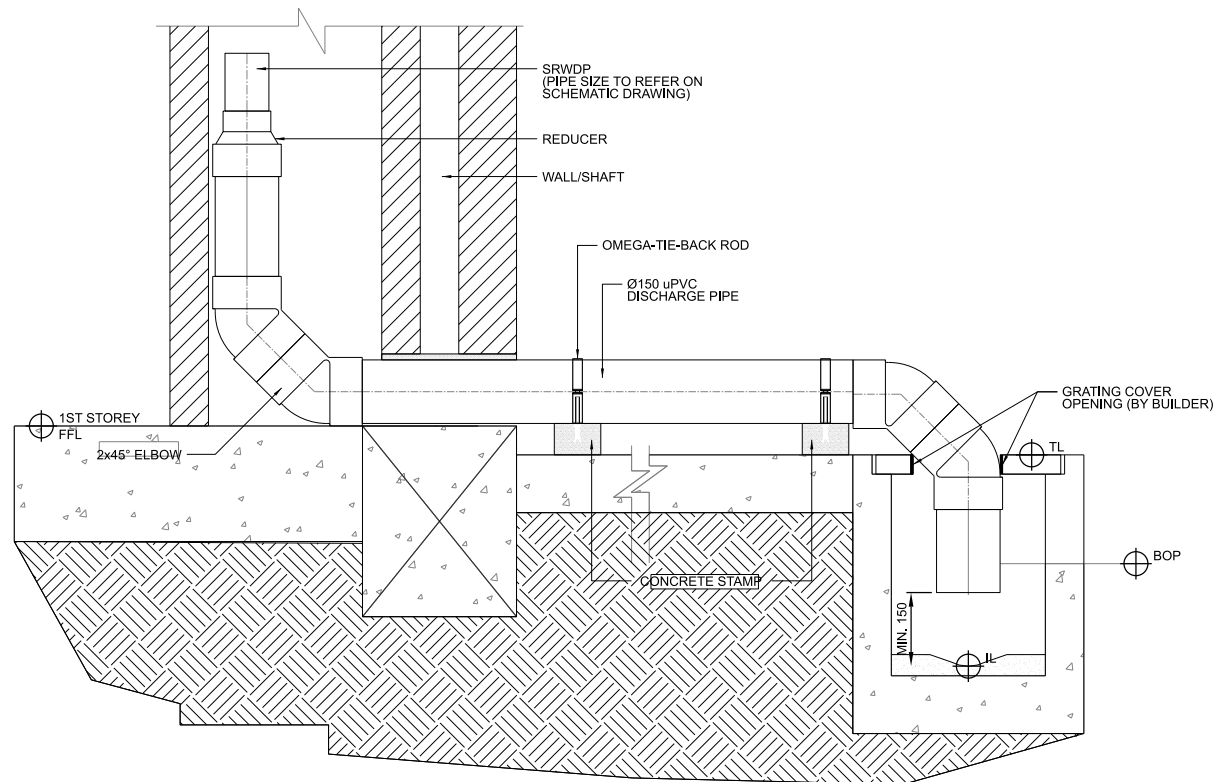


**TYPE 2
TYPICAL DISCHARGE DETAIL**

1:10

NOTE:

1. DRAIN INVERT LEVEL RECOMMENDED TO BE MINIMUM 150mm LOWER THAN BOTTOM OF DISCHARGE PIPE AND DRAIN TOP LEVEL TO BE MINIMUM 150mm HIGHER THAN TOP OF DISCHARGE PIPE (BUILDER TO CONFIRM).

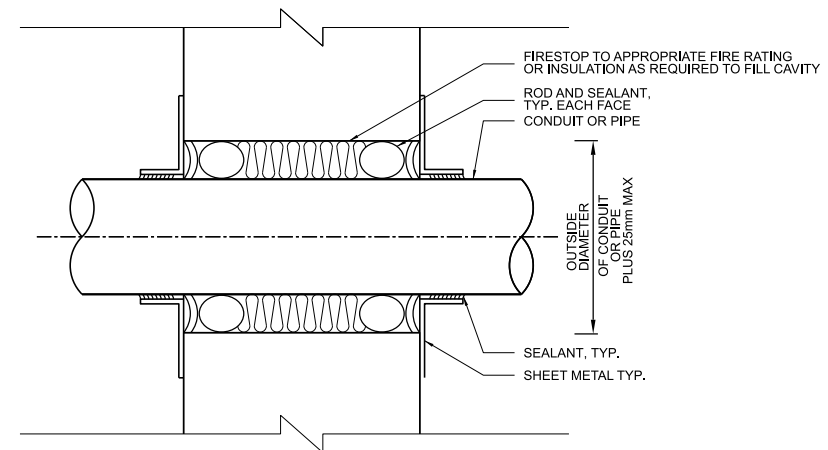


NOTES:

1. OVER SIZE PENETRATION TO PROVIDE 15mm ANNULAR SPACE FOR ROD AND SEALANT.

EXTERIOR WALL PENETRATION

NTS



TENDER

T1	20/05/22	ISSUED FOR TENDER C4B	PK	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

**TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2**

DRAWING TITLE

**ARCHITECTURAL
STANDARD DETAILS
DISCHARGE AND
WALL PENETRATION**

DRAFTED: SP	DESIGNED: SP	SHEET SIZE: A1
DRAFTING CHECK: DW	DESIGN CHECK: PE	SCALE: AS SHOWN
DATE: 24/07/18	REVIEWED: PK	PBS: 131101

CONTRACT: C4B	DRAWING NUMBER: PUB-DTSS2-TWRP
SHEET NUMBER: WSW41-A-5003	REVISION: T1

THIS DRAWING IS COPYRIGHT