


ROOF

2ND STOREY

1ST STOREY

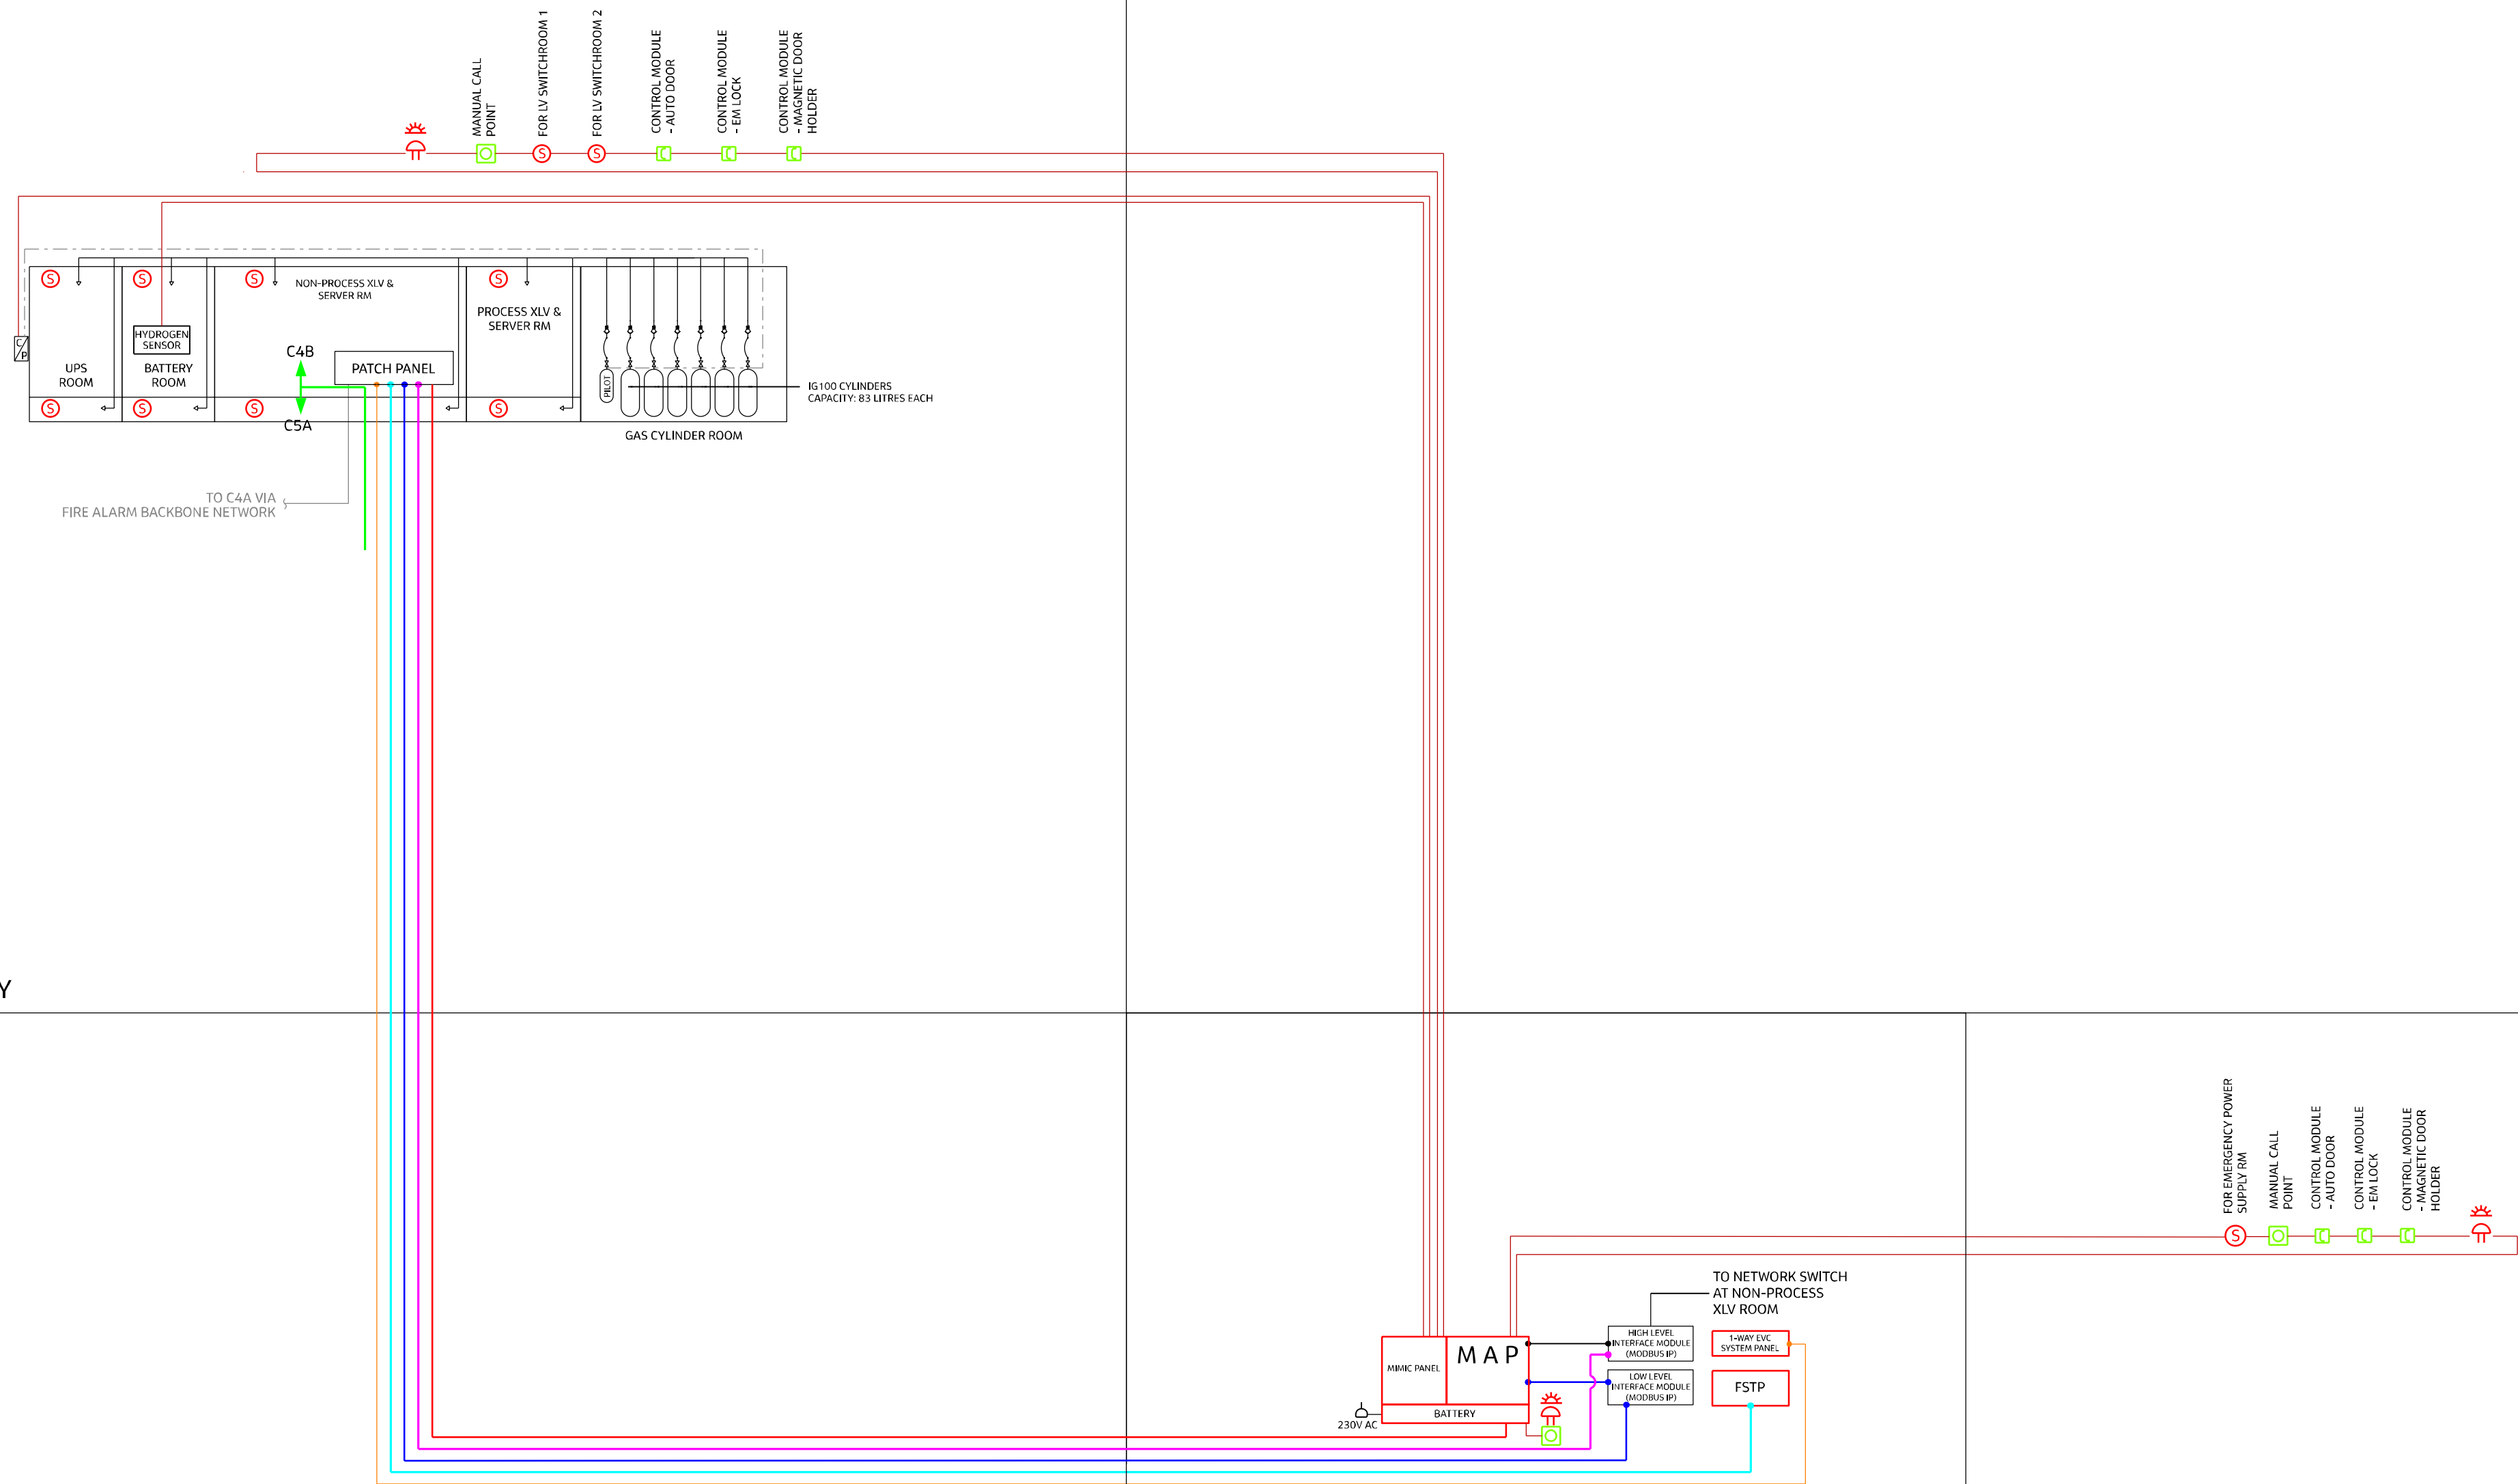

NOTE:-

- QUANTITIES, LOCATION, NUMBER OF STOREY SHOWN ARE FOR INDICATIVE PURPOSES ONLY.
- THE SCHEMATIC IS INDICATIVE AND THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONFIRMING THE FINAL QUANTITIES AND CONFIGURATION THAT COMPLY WITH THE LATEST REVISION OF THE CODE OF PRACTICE FOR INSTALLATION OF ELECTRICAL FIRE ALARM SYSTEMS AND FIRE CODE AT THE TIME OF CONSTRUCTION.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING DESIGN DETAILS TO THE S.O. FOR APPROVAL PRIOR TO INSTALLATION.
- EQUIPMENT SUPPLIED TO BE CORROSION AND WEATHER RESISTANT WITH MINIMUM IP66 RATING.

LEGEND

- | | |
|--|--------------------------------|
| | MANUAL CALL POINT (BREAKGLASS) |
| | ALARM BELL |
| | STROBE LIGHT |
| | SMOKE DETECTOR |
| | CONTROL MODULE |
| | CONTROL PANEL |

ABBREVIATIONS

- | | |
|------|---------------------------------------|
| MAP | MAIN FIRE ALARM PANEL |
| FSTP | FIREMAN SUPERVISORY TERMINATION PANEL |

TENDER

T1	20/05/22	ISSUED FOR TENDER	HKT	HKT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE:

SIDESTREAM NITROGEN REMOVAL (WST02)
SCHEMATIC FOR FIRE ALARM PANEL

DRAFTED: EZ	DESIGNED: EZ	SHEET SIZE: A1
DRAFTING CHECK: HKT	DESIGN CHECK: HKT	SCALE: NTS
DATE: 21/03/22	REVIEWED: HKT	PBS: 131101

CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP	
C4B	SHEET NUMBER: WST02-B-7101	REVISION: T1

THIS DRAWING IS COPYRIGHT