


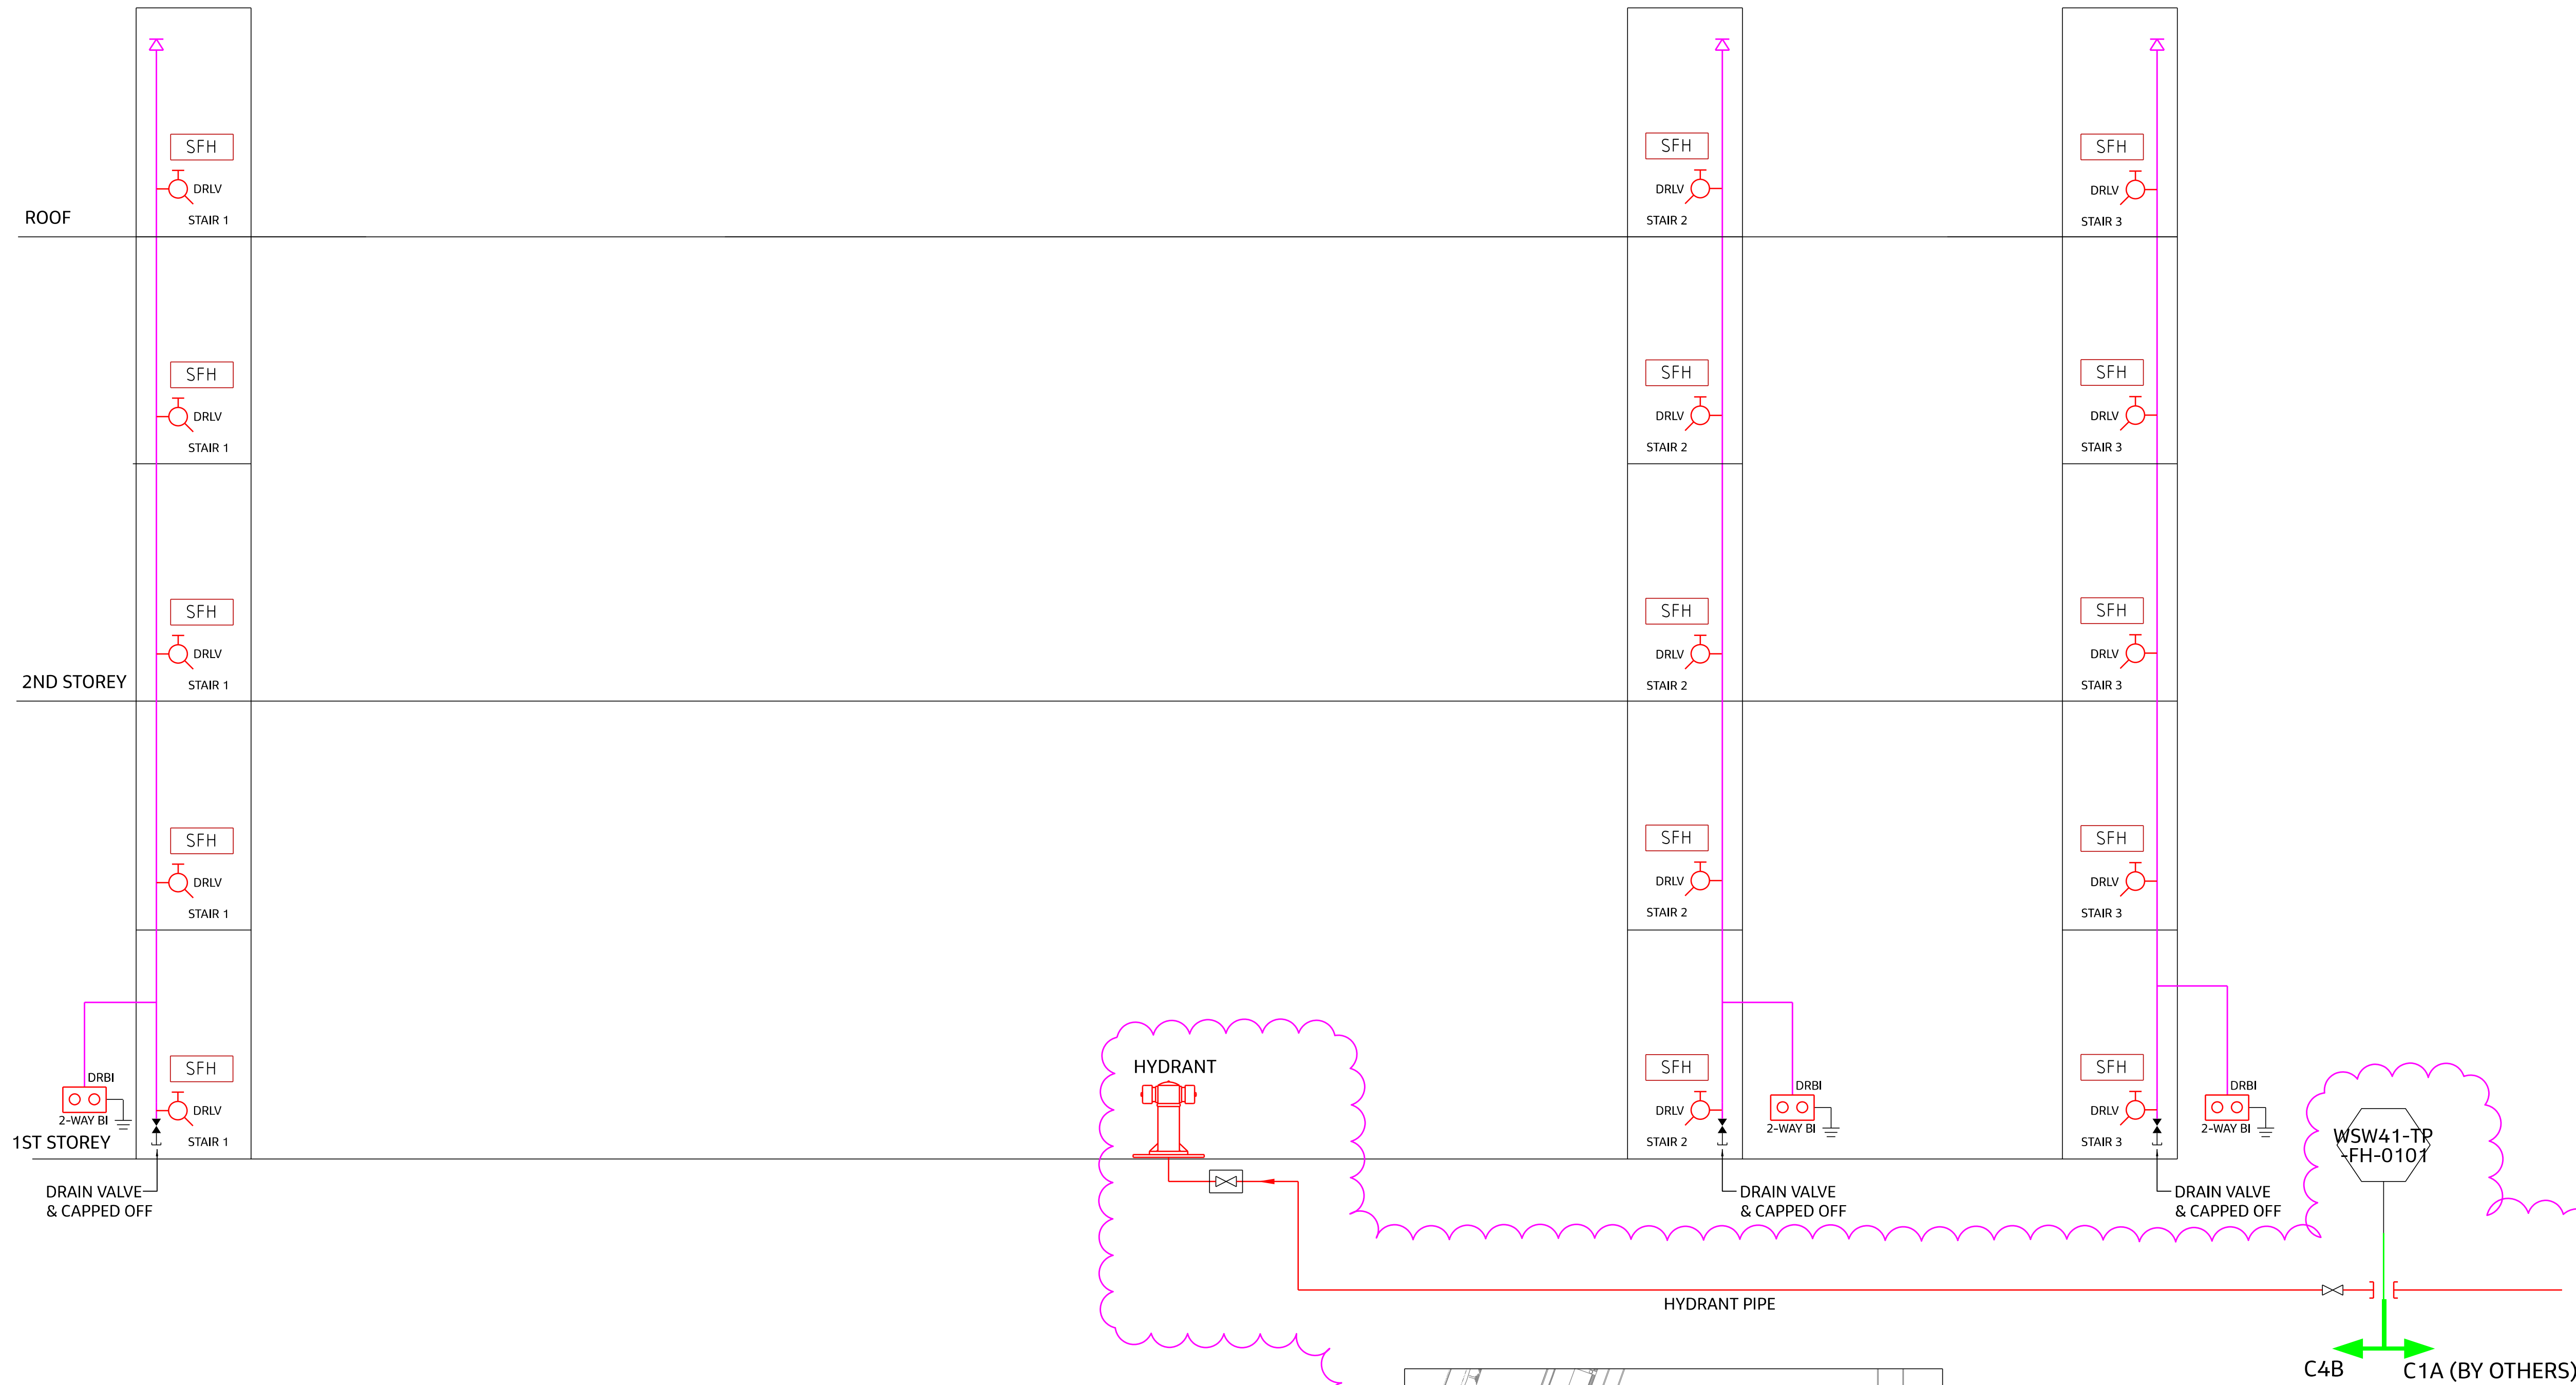


NOTE:-

1. QUANTITIES, LOCATION, NUMBER OF STOREY SHOWN ARE FOR INDICATIVE PURPOSES ONLY.
2. THE SCHEMATIC IS INDICATIVE AND THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONFIRMING THE FINAL QUANTITIES AND CONFIGURATION THAT COMPLY WITH THE LATEST REVISION OF THE CODE OF PRACTICE AND FIRE CODE AT THE TIME OF CONSTRUCTION.
3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING DESIGN DETAILS TO THE S.O. FOR APPROVAL PRIOR TO INSTALLATION.
4. FINAL LOCATION OF HYDRANT SHALL BE DESIGN AND BUILD BY THE CONTRACTOR ACCORDING TO THE PARTICULAR SPECIFICATION P8 ARCHITECTURAL WORKS.

LEGEND

- DRBI 2-WAY BREECHING INLET C/W STAINLESS STEEL CABINET
- DRLV DRY RISER LANDING VALVE
- SFH STANDBY FIRE-HOSE C/W SS304 CABINET
- AIR RELIEF VALVE
- EARTH
- VALVE
- FIRE HYDRANT

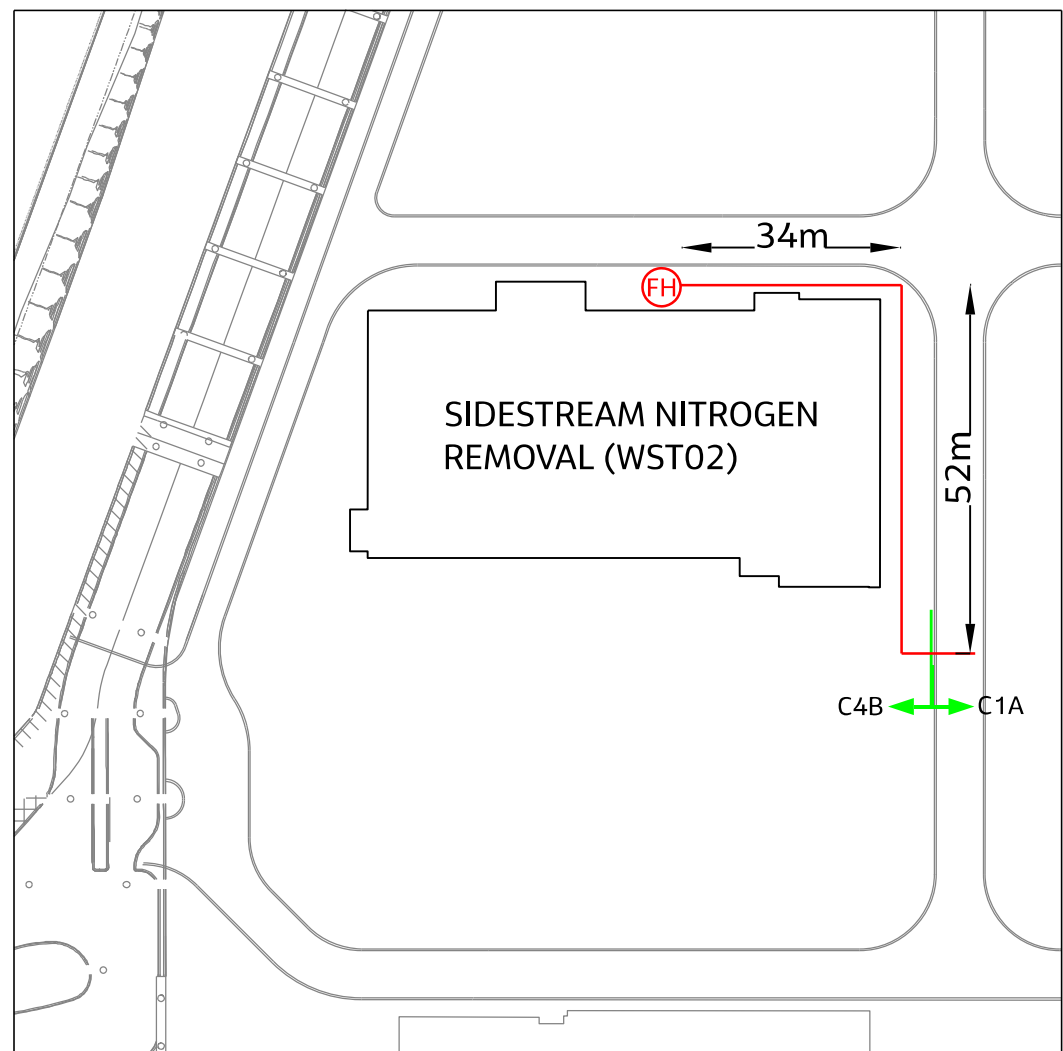

ADDENDUM

REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED
T2	29/06/22	ISSUED FOR ADDENDUM 1	HKT	HKT
T1	20/05/22	ISSUED FOR TENDER	HKT	HKT

CLIENT:



PROGRAMME MANAGER:
binnies AECOM
A JOINT VENTURE DELIVERING THE DTSS2 PROJECT

CONSULTANT:
Jacobs
CH2M HILL Singapore Pte Ltd

PROJECT TITLE:
**TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2**

DRAWING TITLE:
**SIDESTREAM NITROGEN REMOVAL (WST02)
SCHEMATIC FOR DRY RISER AND
HYDRANT SYSTEM**

DRAFTED: EZ	DESIGNED: EZ	SHEET SIZE: A1
DRAFTING CHECK: HKT	DESIGN CHECK: HKT	SCALE: NTS
DATE: 21/03/22	REVIEWED: HKT	PBS: 131101

CONTRACT: C4B	DRAWING NUMBER: PUB-DTSS2-TWRP	REVISION: T2
SHEET NUMBER: WST02-B-7104		

THIS DRAWING IS COPYRIGHT