


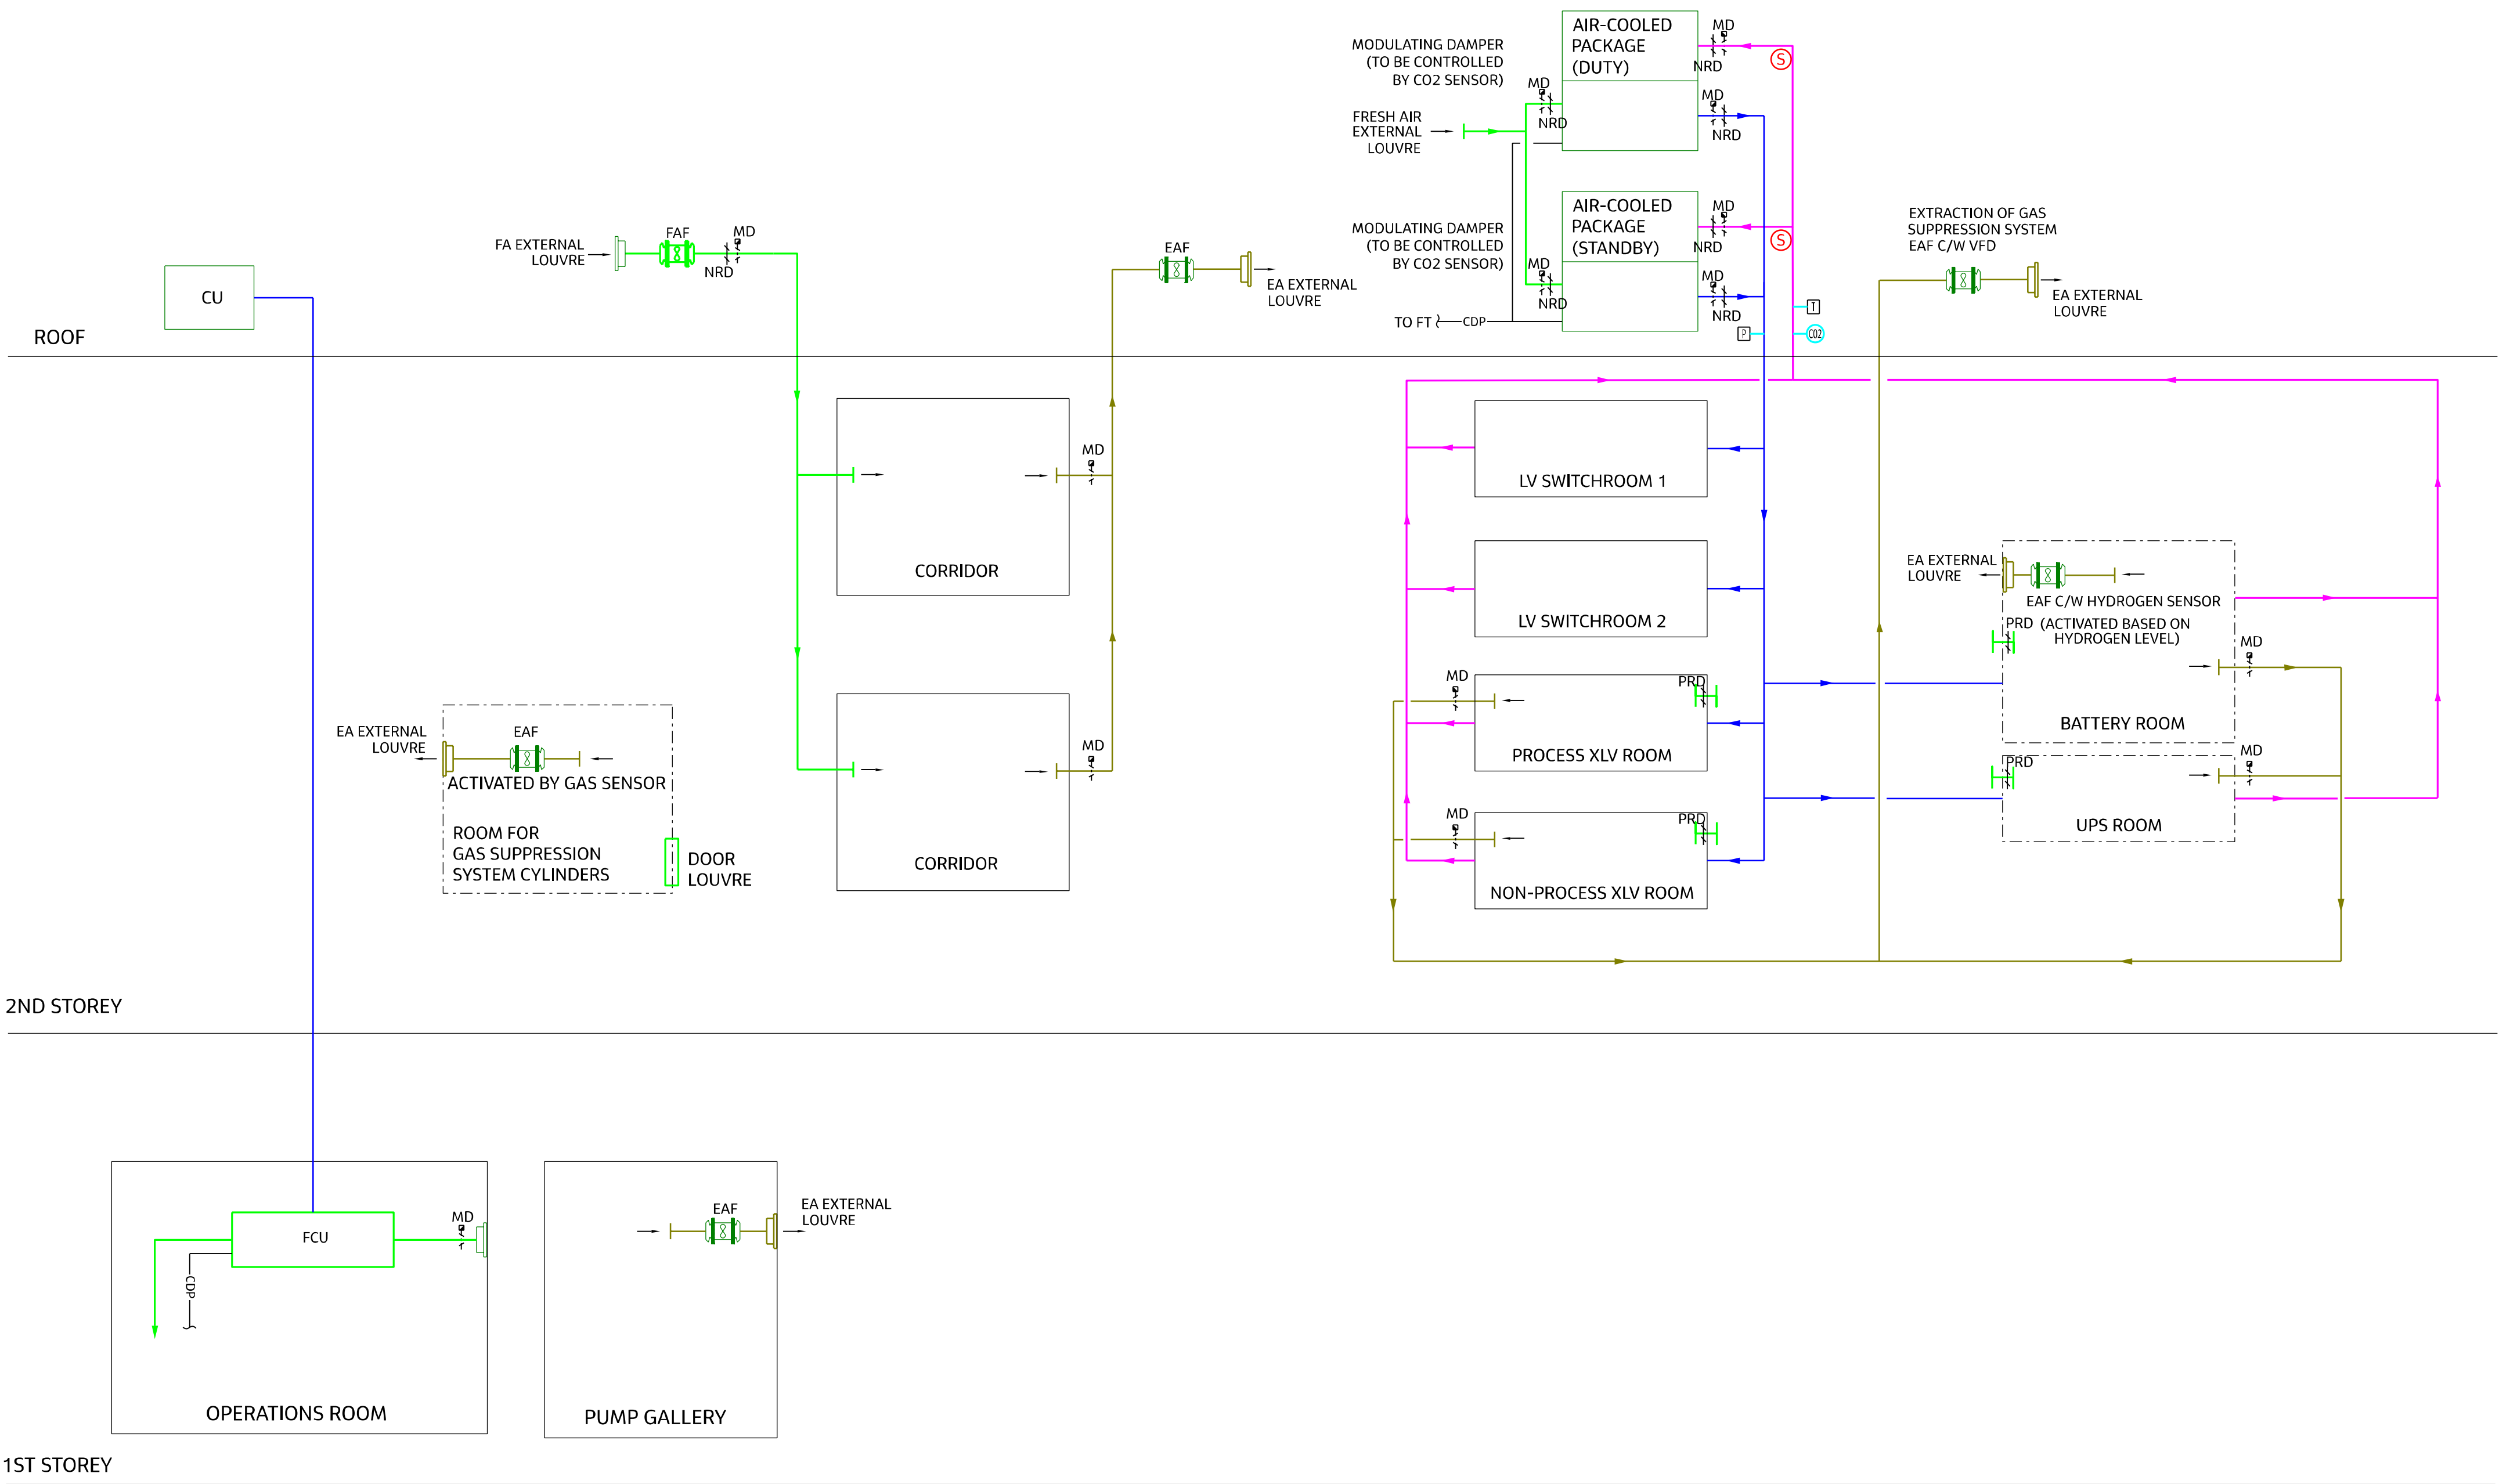

NOTE:-

- QUANTITIES, LOCATION, NUMBER OF STOREY SHOWN ARE FOR INDICATIVE PURPOSES ONLY.
- THE SCHEMATIC IS INDICATIVE AND THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONFIRMING THE FINAL QUANTITIES AND CONFIGURATION THAT COMPLY WITH THE LATEST REVISION OF THE CODE OF PRACTICE AND FIRE CODE AT THE TIME OF CONSTRUCTION.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING DESIGN DETAILS TO THE S.O. FOR APPROVAL PRIOR TO INSTALLATION.

LEGEND

— CDP —	CONDENSATE DRAIN PIPE
— SAD —	AC SUPPLY AIR DUCT (SAD)
— RAD —	AC RETURN AIR DUCT (RAD)
— FAD —	FRESH AIR DUCT (FAD)
— EAD —	MV EXHAUST AIR DUCT (EAD)
— FAD —	MV FRESH AIR DUCT (FAD)
□	TEMPERATURE SENSOR
□	PRESSURE SENSOR
⊙	SMOKE DETECTOR
MD ~~~	MOTORISED / MODULATING DAMPER
⊙	CO2 SENSOR

⊘	EXHAUST AIR FAN (EAF)
⊘	FRESH AIR FAN (FAF)
—	MV EXHAUST AIR DUCT (EAD)
—	MV FRESH AIR DUCT (FAD)
⊘	EXHAUST AIR LOUVRE
⊘	FRESH AIR LOUVRE
⊘	PRESSURE RELIEF DAMPER

NRD ~~~	NON RETURN DAMPER
---------	-------------------

ABBREVIATIONS

EA	EXHAUST AIR
FA	FRESH AIR
FCU	FAN COIL UNIT
CU	CONDENSING UNIT
FT	FLOOR TRAP

TENDER

T1	20/05/22	ISSUED FOR TENDER	HKT	HKT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE:

SIDESTREAM NITROGEN REMOVAL (WST02)
SCHEMATIC FOR AIR-CONDITIONING &
MECHANICAL VENTILATION SYSTEM (ACMV)

DRAFTED: EZ	DESIGNED: EZ	SHEET SIZE: A1
DRAFTING CHECK: HKT	DESIGN CHECK: HKT	SCALE: NTS
DATE: 21/03/22	REVIEWED: HKT	PBS: 131101

CONTRACT: C4B	DRAWING NUMBER: PUB-DTSS2-TWRP	REVISION: T1
SHEET NUMBER: WST02-B-7201		

THIS DRAWING IS COPYRIGHT