


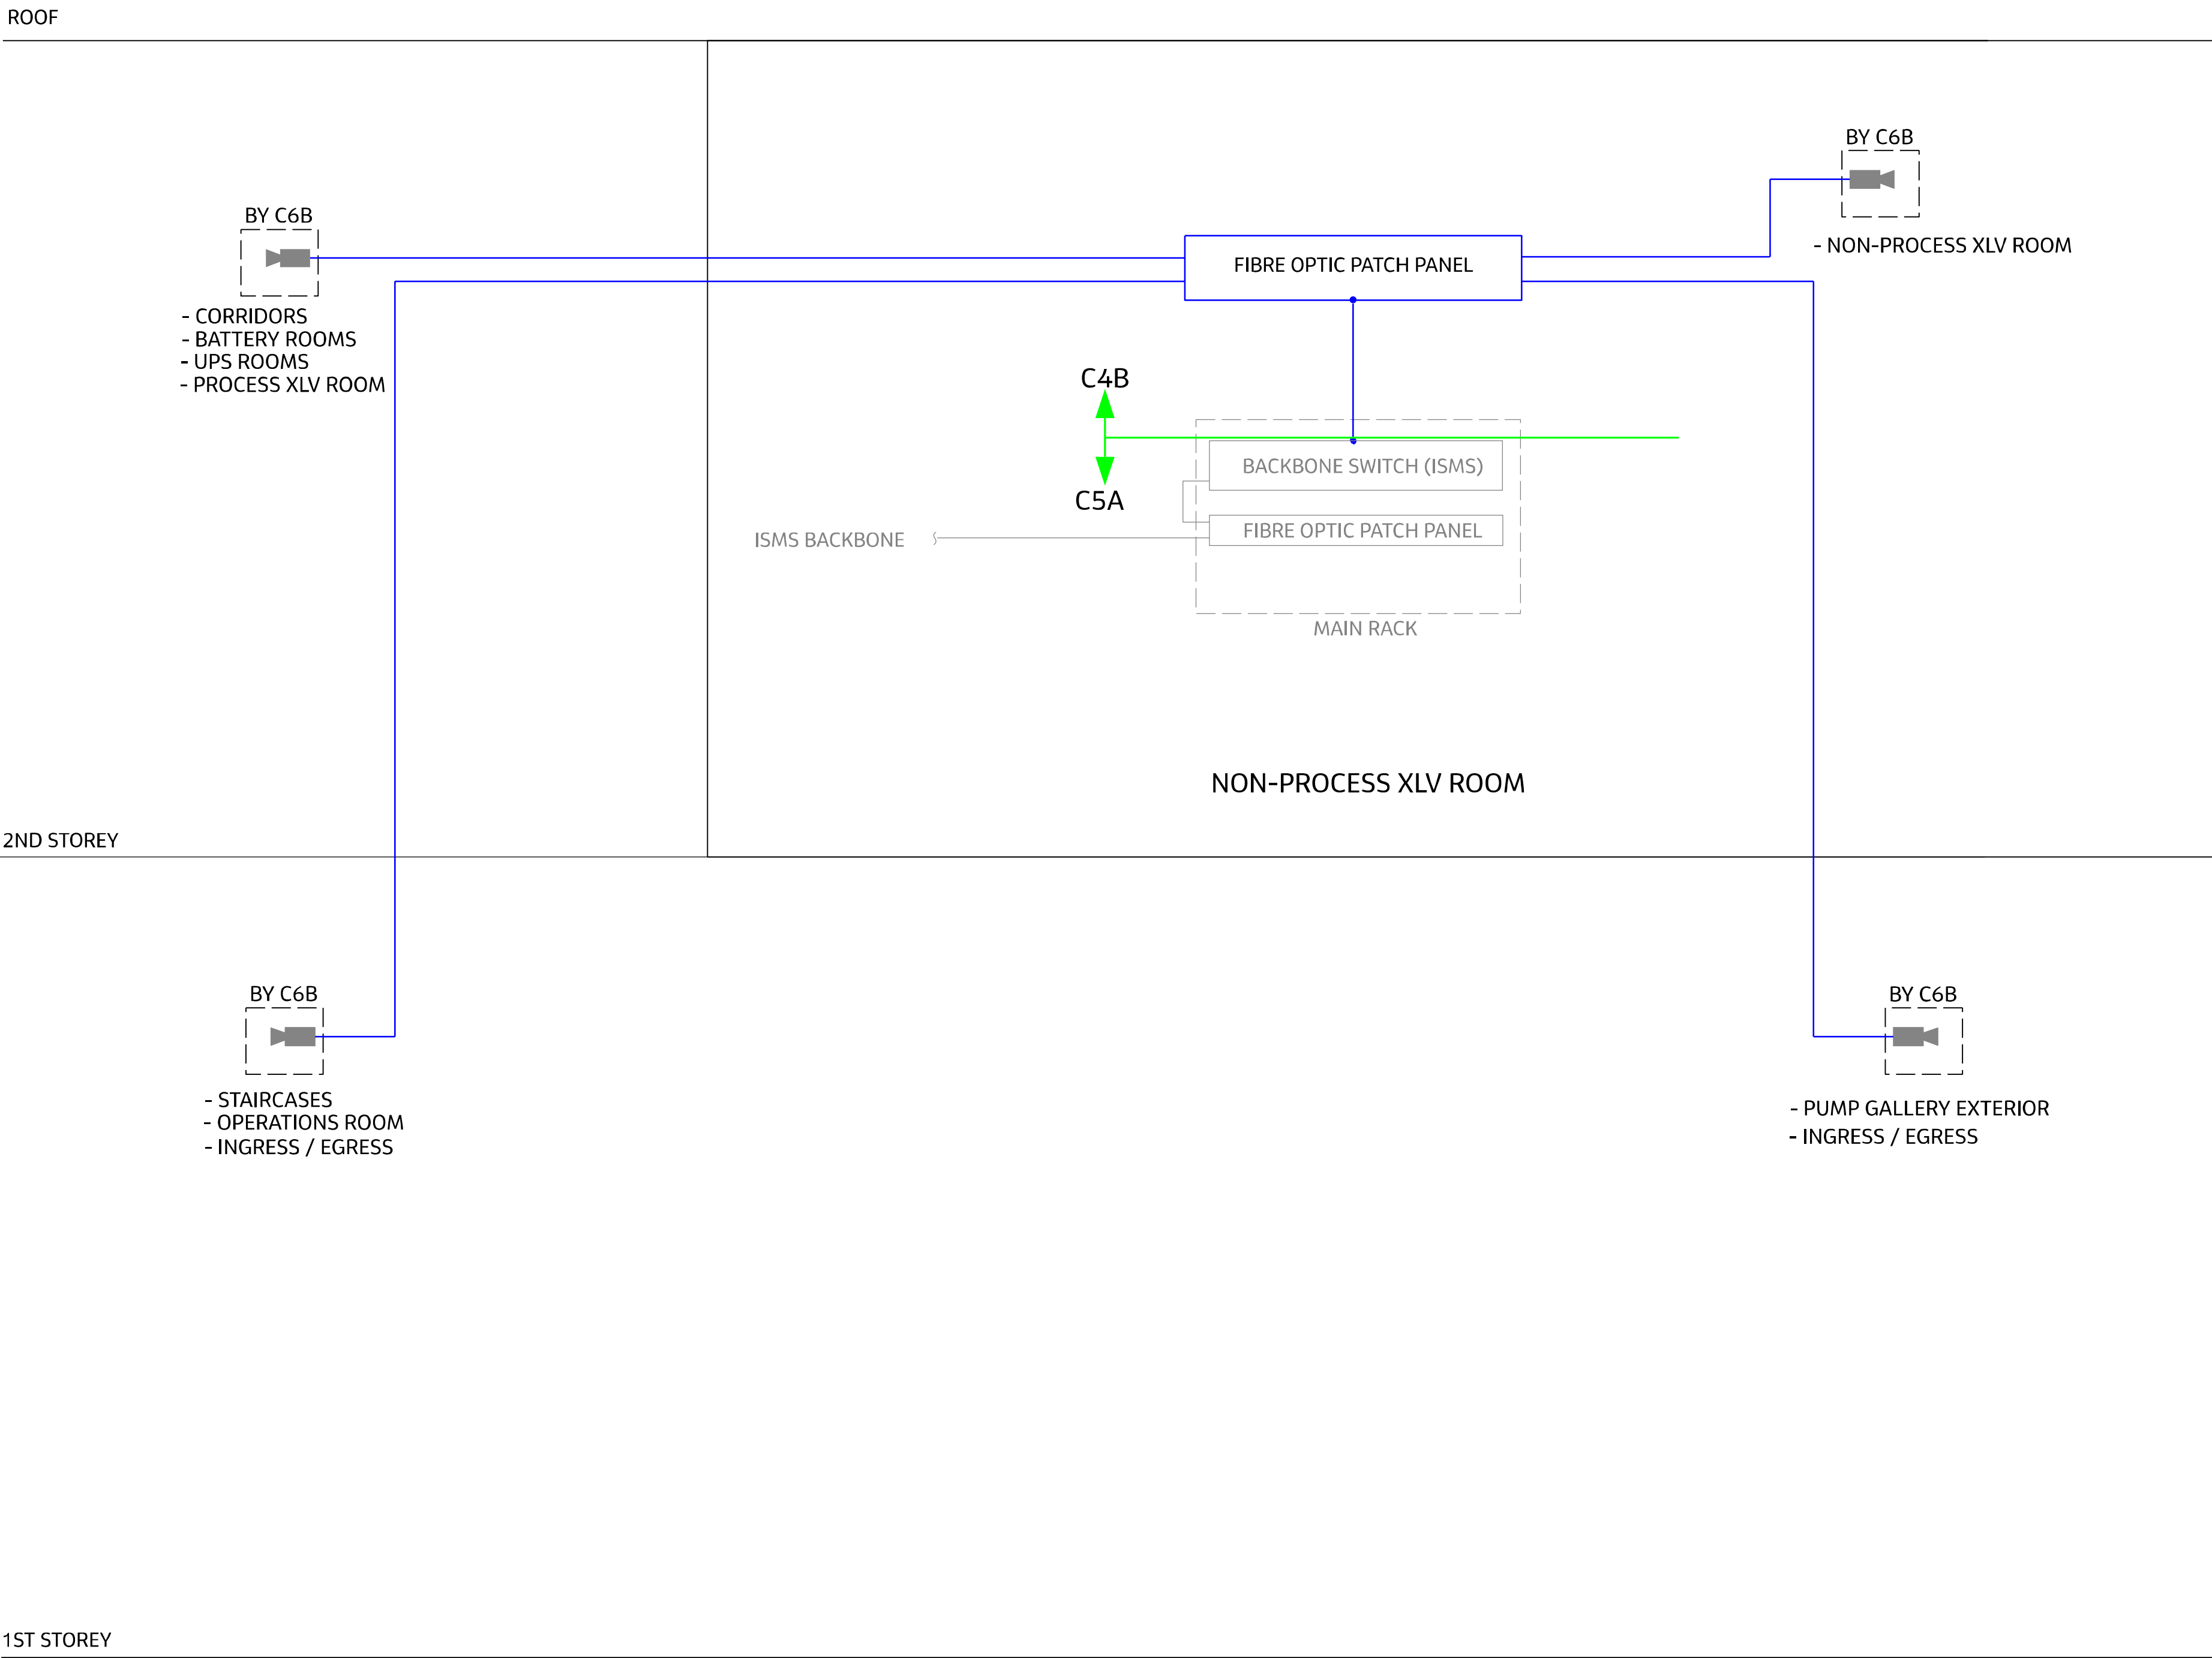

NOTE:-

1. QUANTITIES, LOCATION, NUMBER OF STOREY SHOWN ARE FOR INDICATIVE PURPOSES ONLY.
2. THE SCHEMATIC IS INDICATIVE AND THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONFIRMING THE FINAL QUANTITIES AND CONFIGURATION WITH THE S.O. PRIOR INSTALLATION.
3. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING DESIGN DETAILS TO THE S.O. FOR APPROVAL PRIOR TO INSTALLATION.

LEGEND

- | | | | |
|--|------------------|--|---|
| | EQUIPMENT BY C4B | | 3 MEGAPIXEL IP65 BULLET CAMERA WITH INFRA-RED |
| | EQUIPMENT BY C5A | | |
| | EQUIPMENT BY C6B | | |
| | CABLING BY C4B | | |

TENDER

T1	20/05/22	ISSUED FOR TENDER	HKT	HKT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:

PUB SINGAPORE'S NATIONAL WATER AGENCY

PROGRAMME MANAGER:

binnies AECOM
A JOINT VENTURE DELIVERING THE DTSS2 PROJECT

CONSULTANT:

Jacobs
CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

SIDESTREAM NITROGEN REMOVAL (WST02)
SCHEMATIC FOR SECURITY CCTV
SYSTEM

DRAFTED: EZ	DESIGNED: EZ	SHEET SIZE: A1
DRAFTING CHECK: HKT	DESIGN CHECK: HKT	SCALE: NTS
DATE: 21/03/22	REVIEWED: HKT	PBS: 131101
CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP	
C4B	SHEET NUMBER: WST02-B-7501	REVISION: T1

THIS DRAWING IS COPYRIGHT