



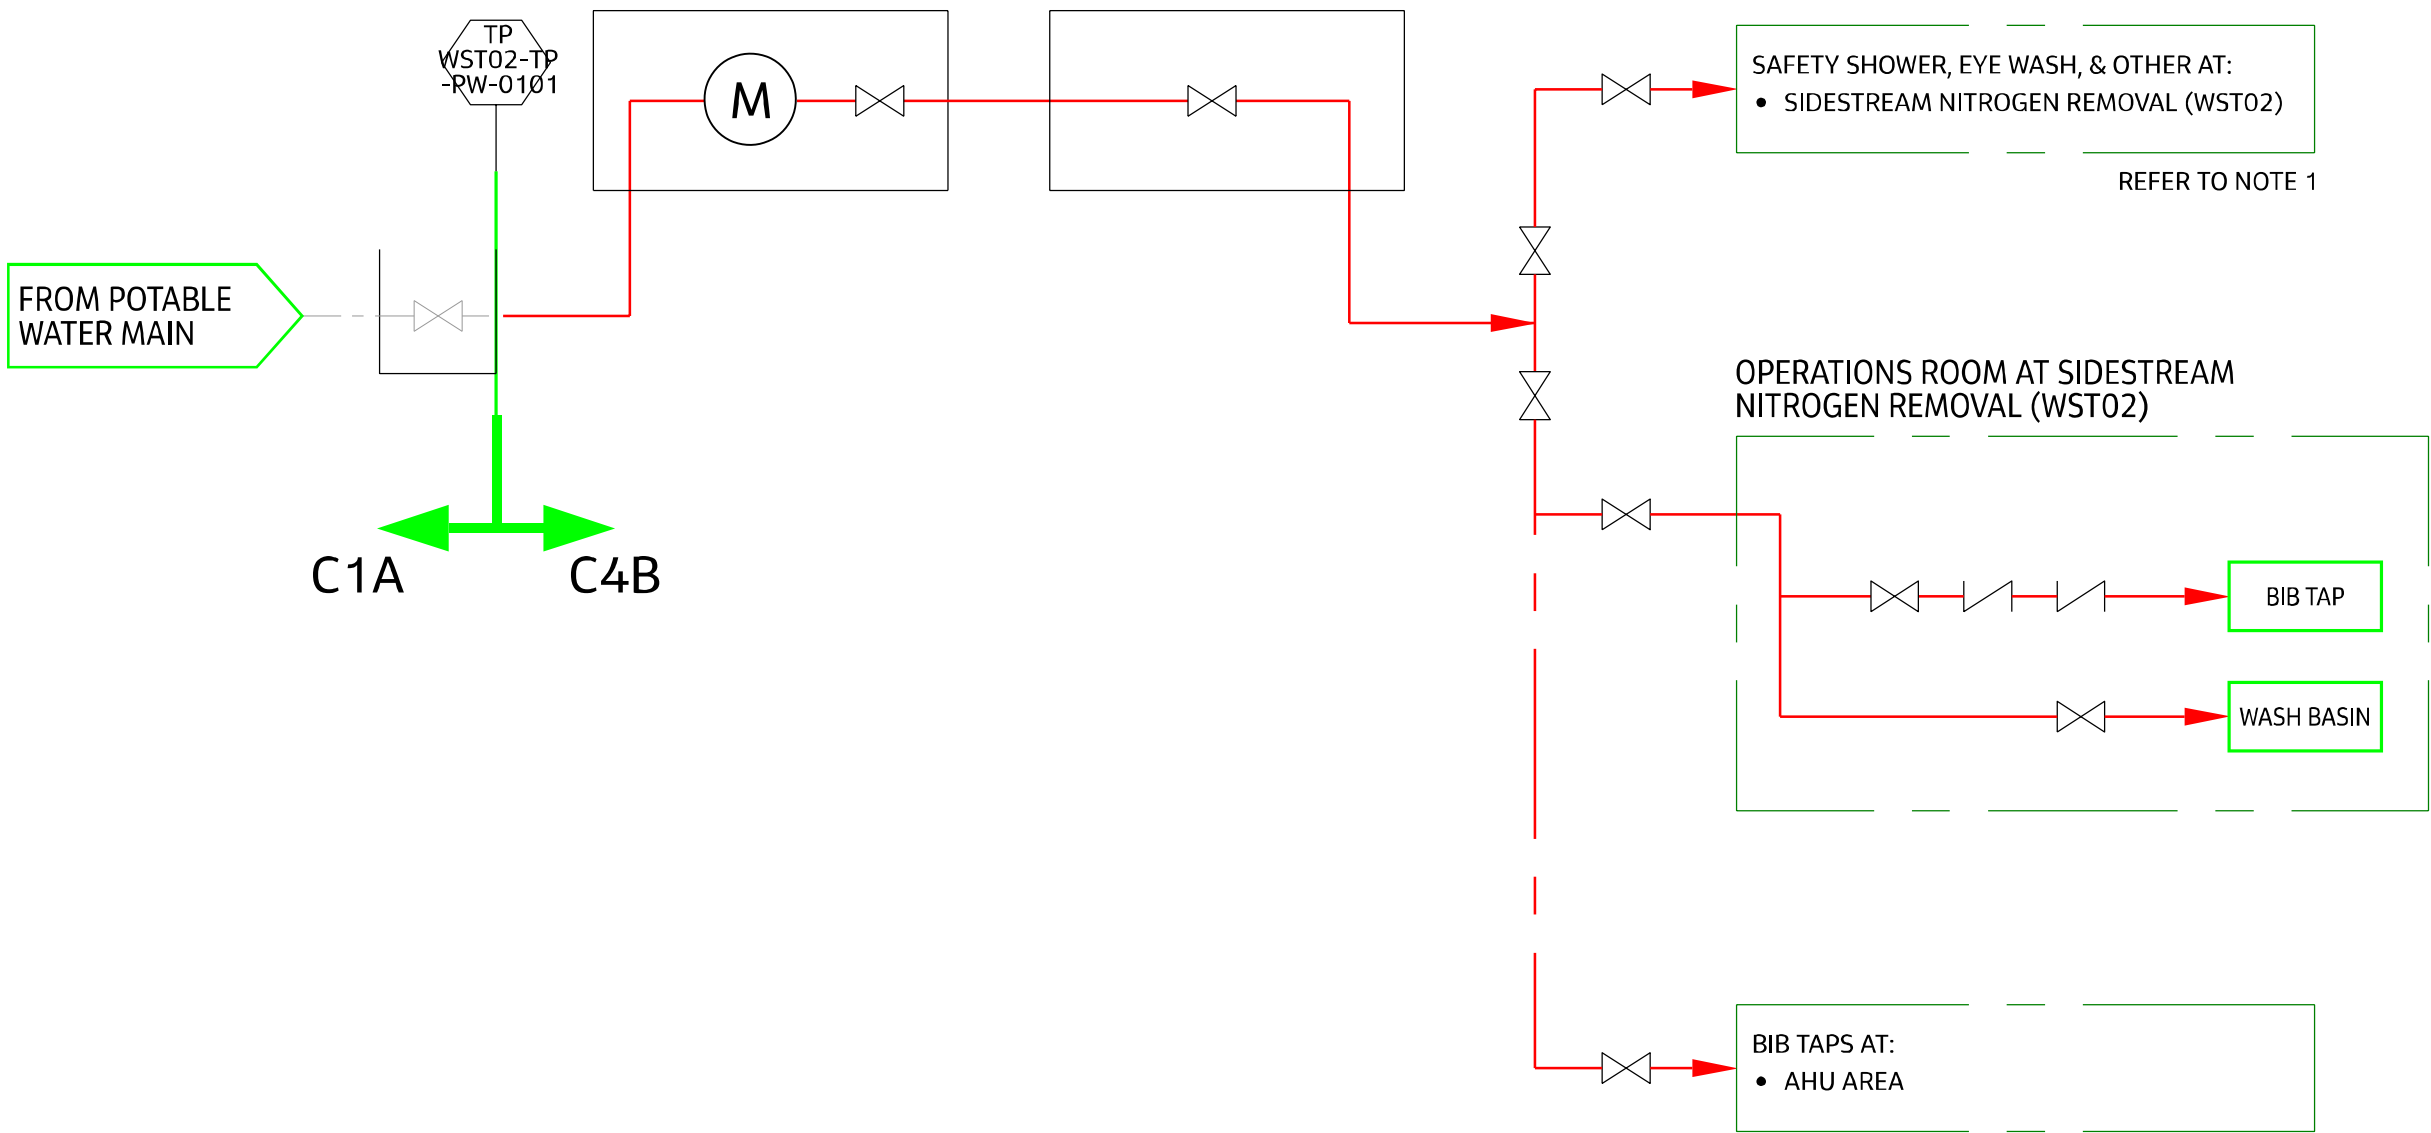

PLUMBING SCHEMATIC

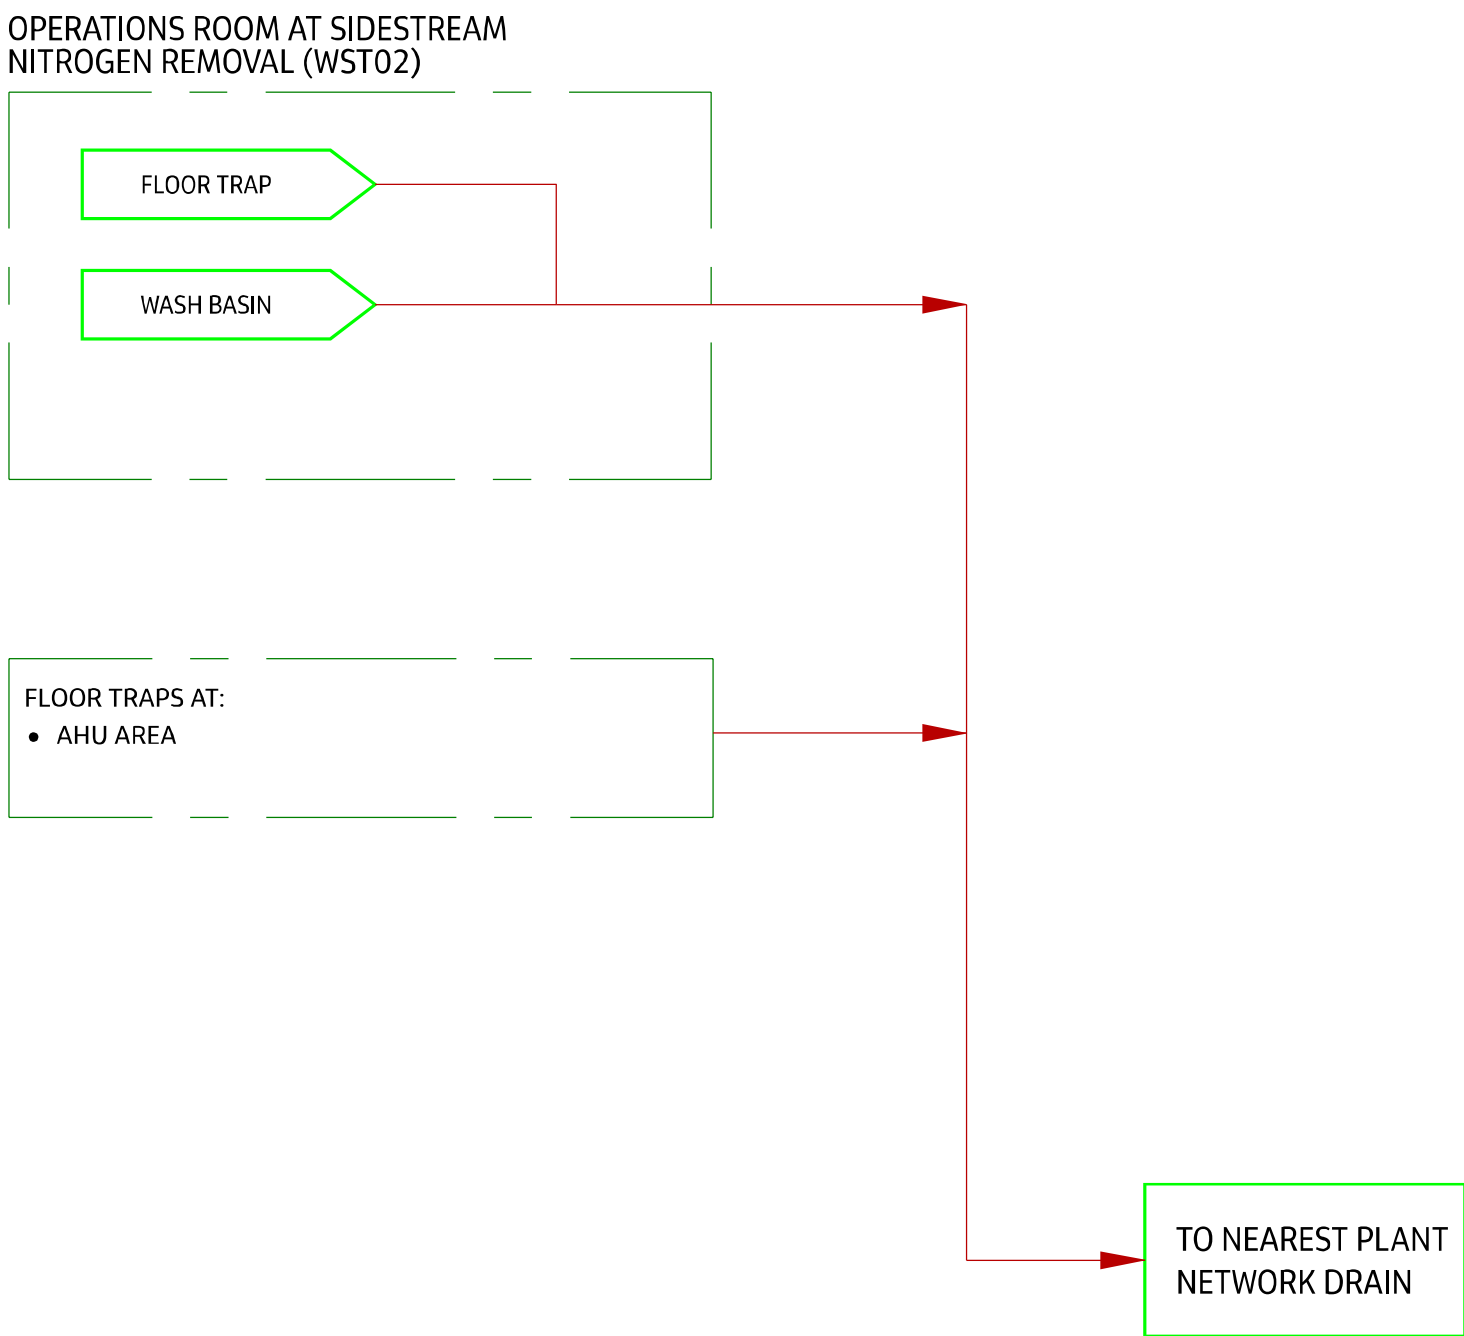

SANITARY SYSTEM SCHEMATIC

- NOTE:-
1. PROVIDE ALL OTHER POTABLE WATER SERVICE CONNECTION FOR THE PROCESS SYSTEM THAT ARE SHOWN ON THE P&ID DRAWINGS.
 2. QUANTITIES, LOCATION, NUMBER OF STOREY SHOWN ARE FOR INDICATIVE PURPOSES ONLY.
 3. THE SCHEMATIC IS INDICATIVE AND THE CONTRACTOR SHALL BE RESPONSIBLE FOR CONFIRMING THE FINAL QUANTITIES AND CONFIGURATION THAT COMPLY WITH THE LATEST REVISION OF THE CODE OF PRACTICE FOR INSTALLATION OF ELECTRICAL FIRE ALARM SYSTEMS AND FIRE CODE AT THE TIME OF CONSTRUCTION.
 4. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING DESIGN DETAILS TO THE S.O. FOR APPROVAL PRIOR TO INSTALLATION.

TENDER

T1	20/05/22	ISSUED FOR TENDER	HKT	HKT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



SINGAPORE'S
NATIONAL
WATER AGENCY

PROGRAMME MANAGER:



A JOINT VENTURE DELIVERING THE DTSS2 PROJECT

CONSULTANT:



CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE:

SIDESTREAM NITROGEN REMOVAL (WST02)
SCHEMATIC FOR PLUMBING
AND SANITARY SYSTEM

DRAFTED: EZ	DESIGNED: EZ	SHEET SIZE: A1
DRAFTING CHECK: HKT	DESIGN CHECK: HKT	SCALE: NTS
DATE: 03/07/19	REVIEWED: HKT	PBS: 131101

CONTRACT:	DRAWING NUMBER:	
C4B	PUB-DTSS2-TWRP	
	SHEET NUMBER:	REVISION:
	WST02-B-7701	T1

THIS DRAWING IS COPYRIGHT