


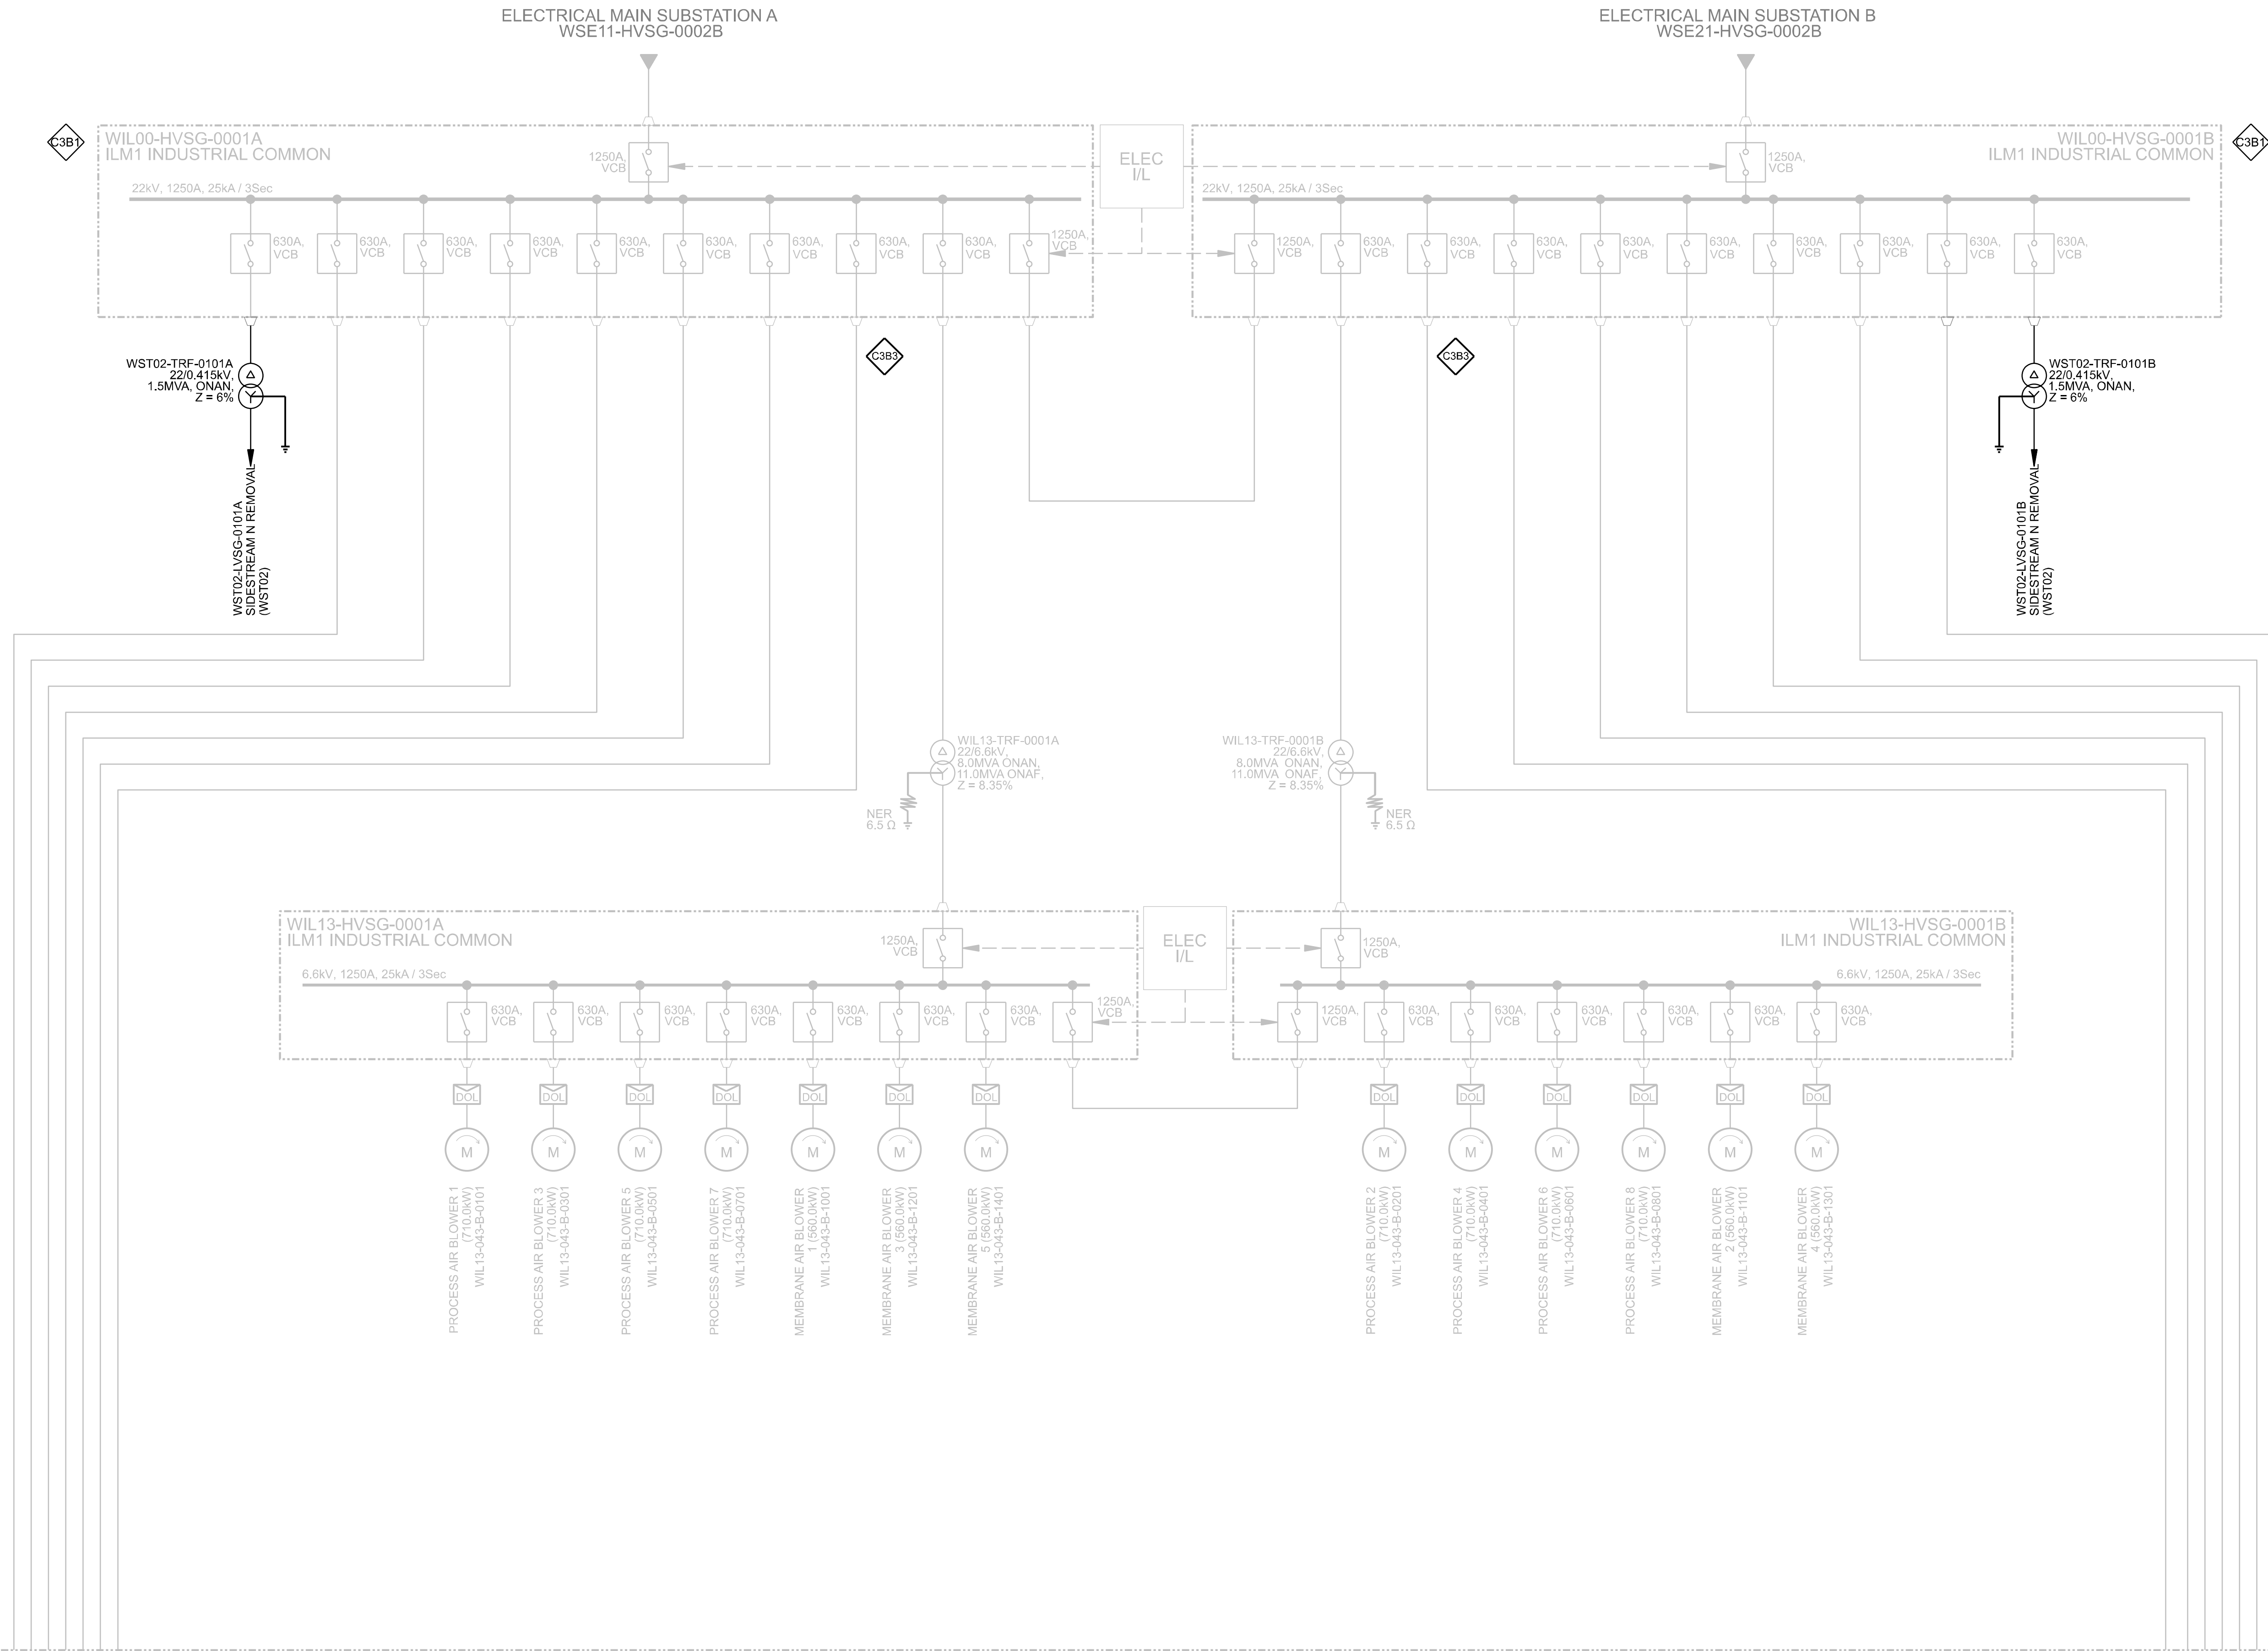

MATCHLINE, SEE DRAWING WIL00-E-7001

NOTES:

1. THE OVERALL SINGLE LINE DIAGRAM ILLUSTRATES THE ELECTRICAL DISTRIBUTION SYSTEM OF THE FACILITY.
2. THE CONTRACTOR SHALL REFER TO THE SPECIFICATIONS AND DETAILED SINGLE LINE DIAGRAMS FOR THE FULL REQUIREMENTS OF THE RESPECTIVE SWITCHGEAR AND MOTOR CONTROL CENTRES.
3. LV SWITCHGEARS DIRECTLY FED FROM TRANSFORMERS SHALL ALL HAVE AUTOMATIC TRANSFER CONTROL AS PER SPECIFICATION. HV SWITCHGEARS SHALL HAVE INTERLOCK SCHEME WITH MOMENTARY PARALLEL OF SOURCES AS PER SPECIFICATION.
4. SHORT CIRCUIT RATING OF THE SWITCHGEAR SHALL BE SELECTED BY THE CONTRACTOR BASED ON THE SHORT CIRCUIT STUDY. CONTRACTOR'S LEW SHALL ENDORSE THE SHORT CIRCUIT STUDY.

TENDER

|     |          |                   |          |            |
|-----|----------|-------------------|----------|------------|
| T1  | 20/05/22 | ISSUED FOR TENDER | LBL      | LF         |
| REV | DATE     | DESCRIPTION       | REVIEWED | AUTHORISED |

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)  
DTSS PHASE 2

DRAWING TITLE:

INDUSTRIAL LM1  
SINGLE LINE DIAGRAM  
OVERALL  
SHEET 1 OF 13

|                       |                        |                   |
|-----------------------|------------------------|-------------------|
| DRAFTED:<br>DB        | DESIGNED:<br>GR        | SHEET SIZE:<br>A1 |
| DRAFTING CHECK:<br>DW | DESIGN CHECK:<br>SK/PC | SCALE:<br>NA      |
| DATE:<br>20/05/22     | REVIEWED:<br>LBL       | PBS:<br>131101    |

|                  |                                                                    |                 |
|------------------|--------------------------------------------------------------------|-----------------|
| CONTRACT:<br>C4B | DRAWING NUMBER:<br>PUB-DTSS2-TWRP<br>SHEET NUMBER:<br>WIL00-E-7000 | REVISION:<br>T1 |
|------------------|--------------------------------------------------------------------|-----------------|

THIS DRAWING IS COPYRIGHT