


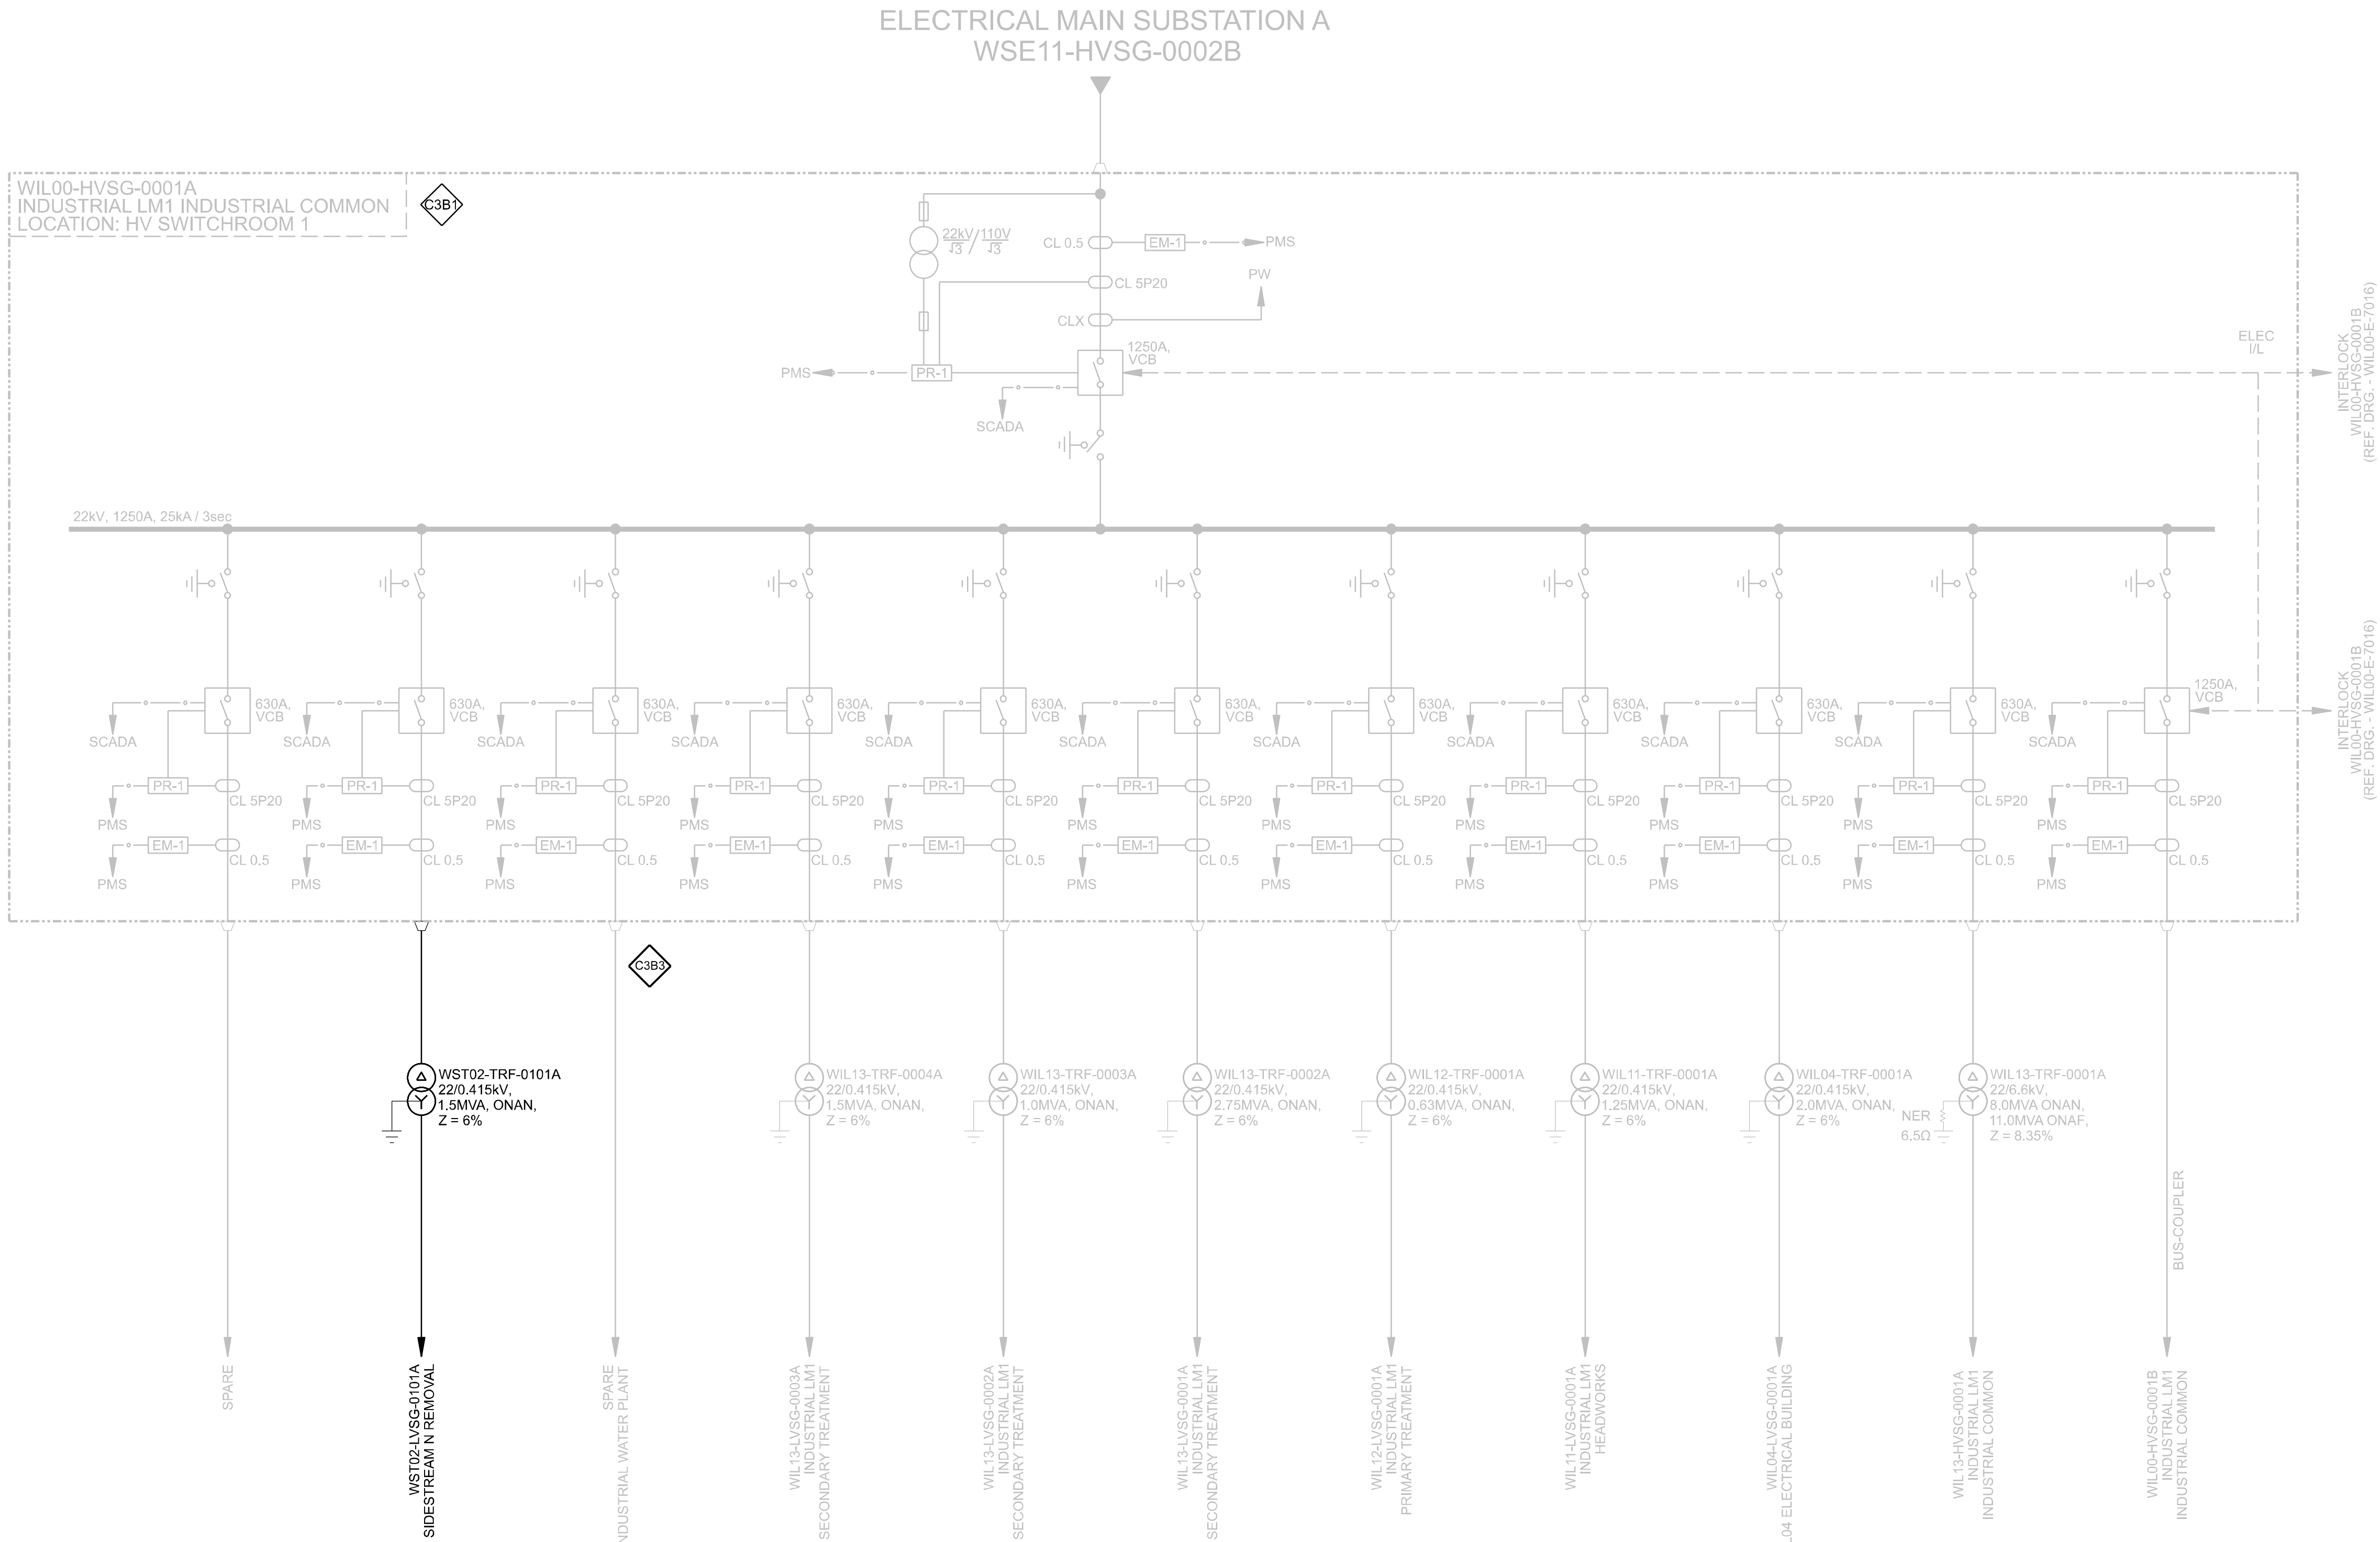

- NOTES:
- RATINGS SHOWN ON DRAWINGS ARE INDICATIVE ONLY. CONTRACTOR SHALL VERIFY AND UPSIZE THE RATINGS, IF REQUIRED BASED ON EQUIPMENT SELECTION, AND IN ACCORDANCE WITH THE SPECIFICATIONS AND ALL LOCAL CODES AND REGULATIONS.
 - THE CONTRACTOR SHALL SIZE AND SELECT THE TYPE OF THE CABLES BASED ON EQUIPMENT SELECTION, AND IN ACCORDANCE WITH THE SPECIFICATIONS AND ALL LOCAL CODES AND REGULATIONS.
 - PROTECTION RELAYS AND ENERGY METERS SHALL BE IN ACCORDANCE WITH THE GENERAL SPECIFICATIONS.
 - THE CONTRACTOR SHALL PROPOSE PROTECTION RELAY DESIGN AND COORDINATE WITH EXISTING SYSTEM IN ACCORDANCE WITH THE SPECIFICATIONS.

TENDER

T1	20/05/22	ISSUED FOR TENDER	LBL	LF
REV	DATE	DESCRIPTION	REVIEWED / AUTHORISED	
CLIENT:				
 SINGAPORE'S NATIONAL WATER AGENCY				
PROGRAMME MANAGER:				
 AECOM A JOINT VENTURE DELIVERING THE DTSS2 PROJECT				
CONSULTANT:				
 CH2M HILL Singapore Pte Ltd				
PROJECT TITLE:				
TUAS WATER RECLAMATION PLANT (TWRP) DTSS PHASE 2				
DRAWING TITLE:				
INDUSTRIAL LM1 SINGLE LINE DIAGRAM HV SWITCHGEAR WIL00-HVSG-0001A				
DRAFTED: DB	DESIGNED: GR	SHEET SIZE: A1		
DRAFTING CHECK: DW	DESIGN CHECK: SK/PC	SCALE: NA		
DATE: 20/05/22	REVIEWED: LBL	PBS:	131101	
CONTRACT:	DRAWING NUMBER:			
C4B	PUB-DTSS2-TWRP			
SHEET NUMBER: WIL00-E-7015		REVISION: T1		
THIS DRAWING IS COPYRIGHT				