


ELECTRICAL MAIN SUBSTATION B
WSE21-HVSG-0002B

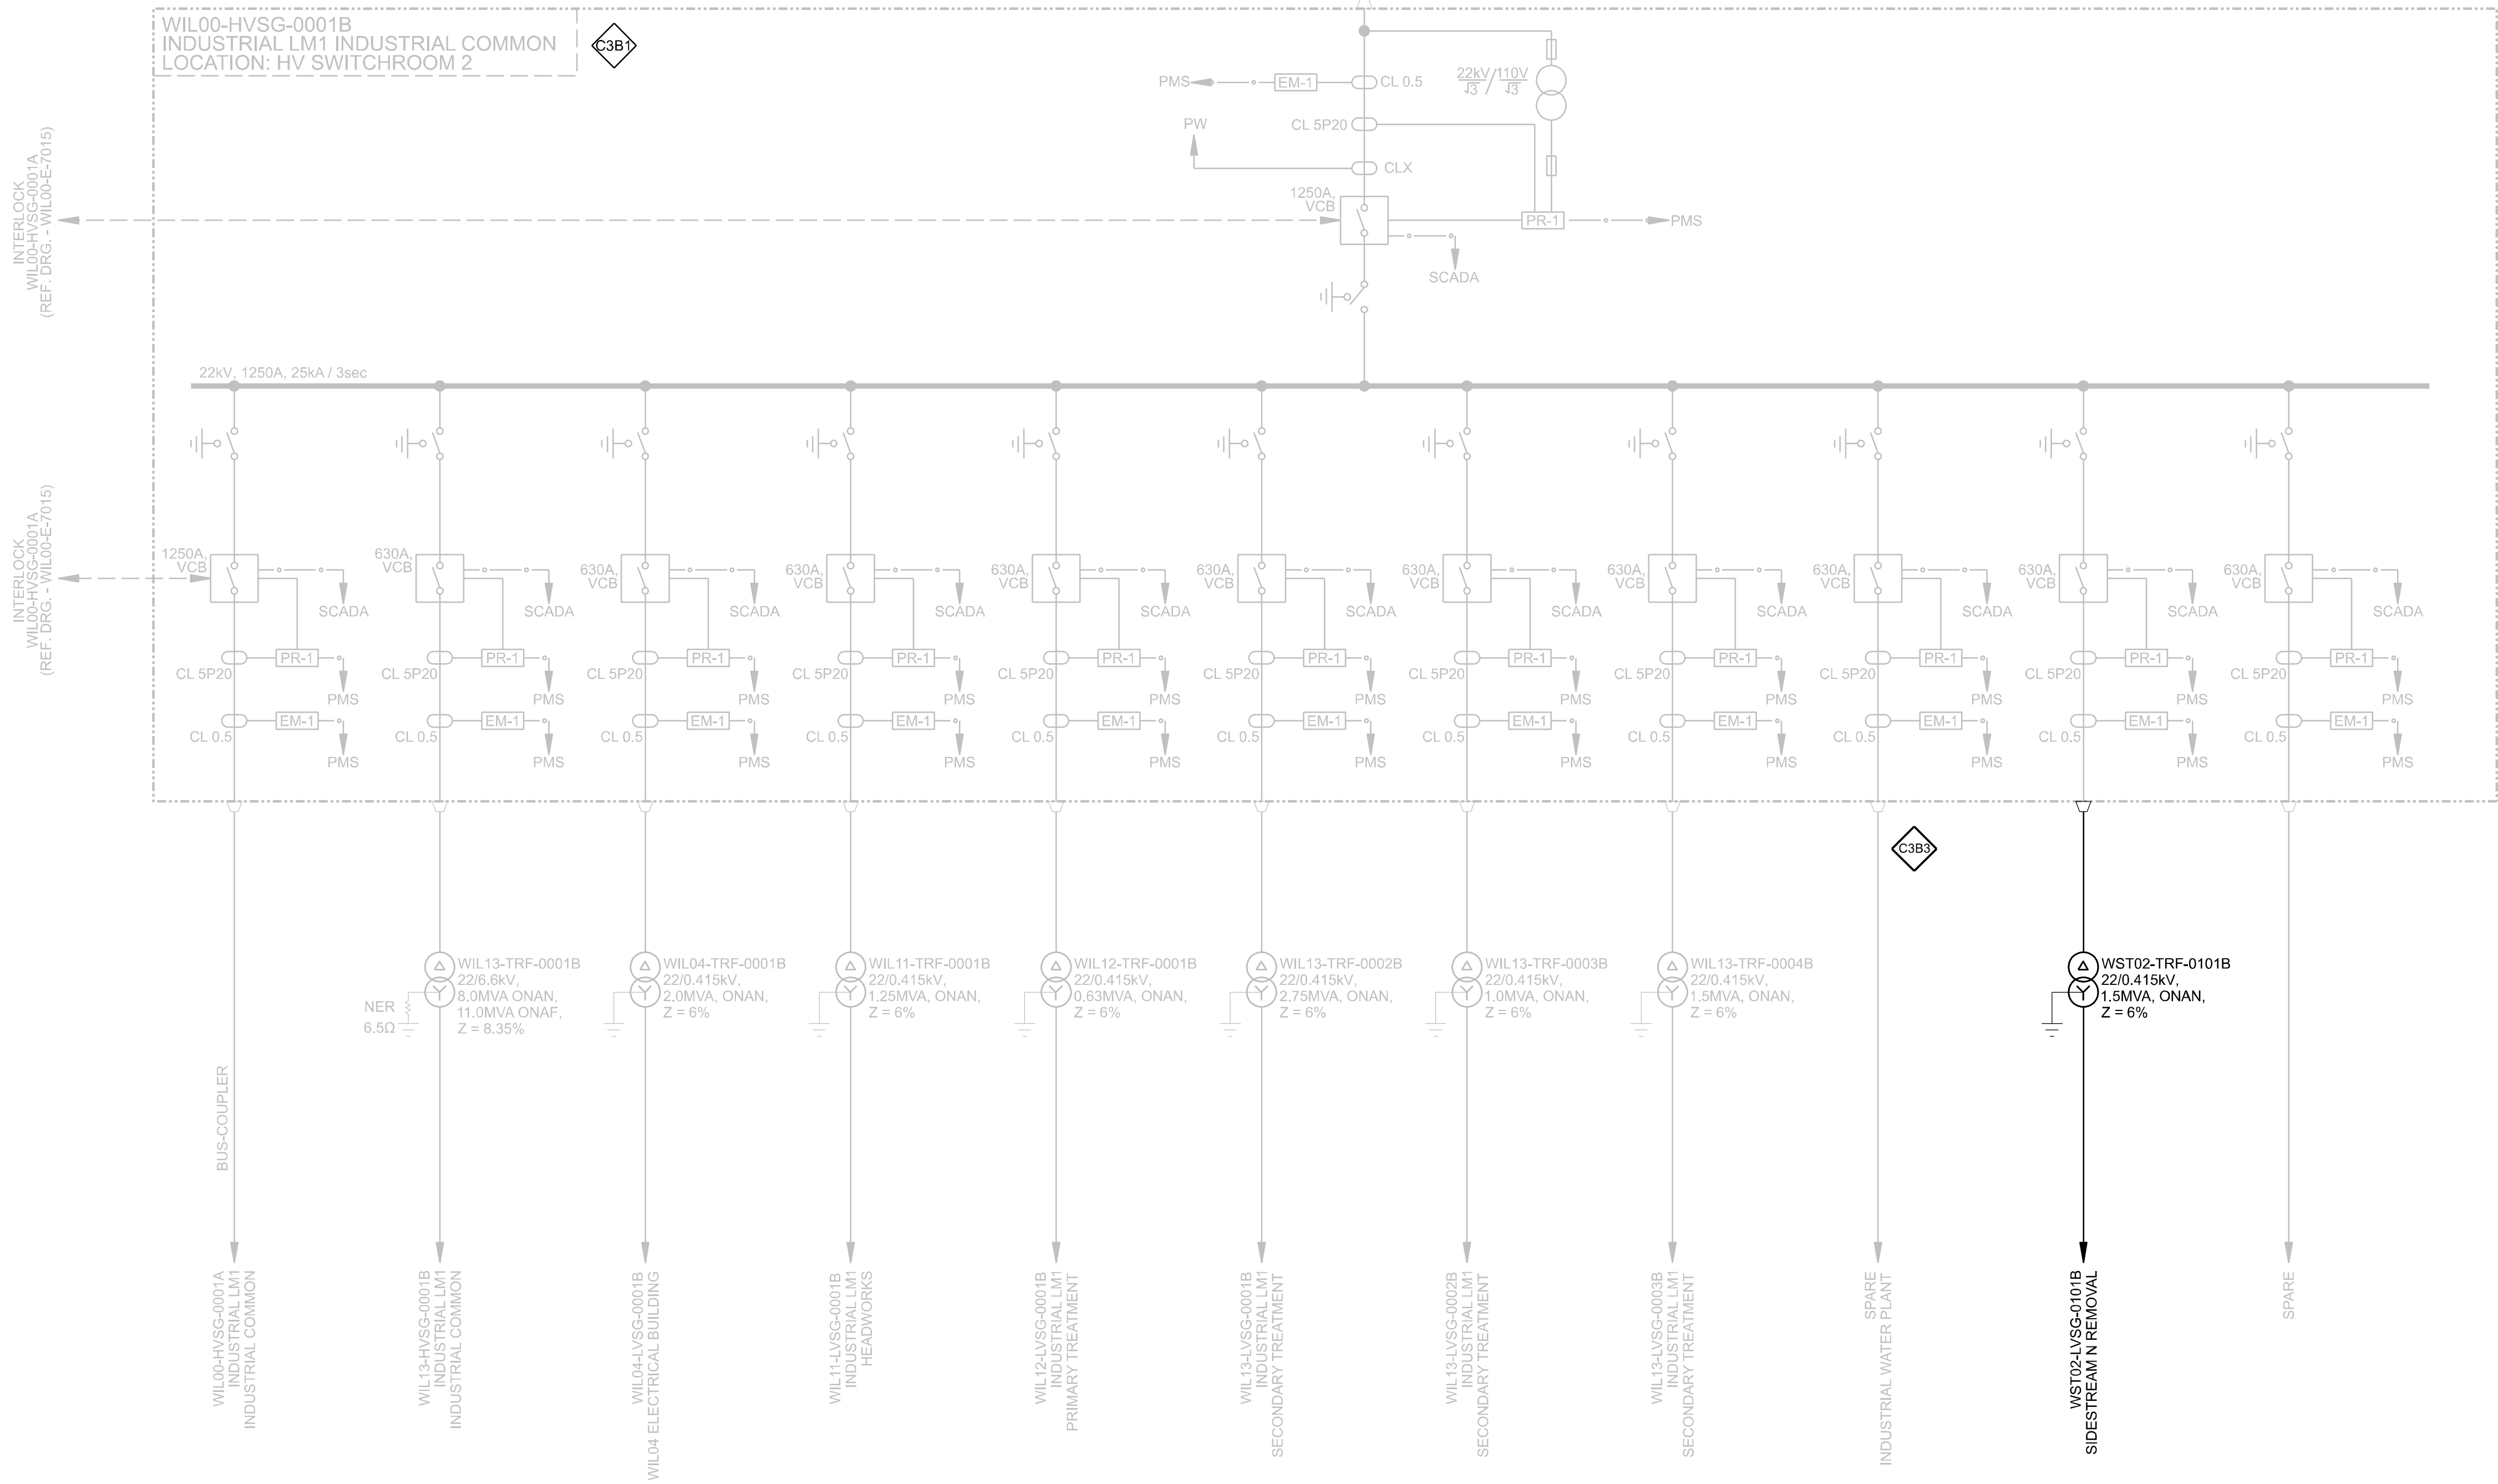

NOTES:

- RATINGS SHOWN ON DRAWINGS ARE INDICATIVE ONLY. CONTRACTOR SHALL VERIFY AND UPSIZE THE RATINGS, IF REQUIRED BASED ON EQUIPMENT SELECTION, AND IN ACCORDANCE WITH THE SPECIFICATIONS AND ALL LOCAL CODES AND REGULATIONS.
- THE CONTRACTOR SHALL SIZE AND SELECT THE TYPE OF THE CABLES BASED ON EQUIPMENT SELECTION, AND IN ACCORDANCE WITH THE SPECIFICATIONS AND ALL LOCAL CODES AND REGULATIONS.
- PROTECTION RELAYS AND ENERGY METERS SHALL BE IN ACCORDANCE WITH THE GENERAL SPECIFICATIONS.
- THE CONTRACTOR SHALL PROPOSE PROTECTION RELAY DESIGN AND COORDINATE WITH EXISTING SYSTEM IN ACCORDANCE WITH THE SPECIFICATIONS.

TENDER

T1	20/05/22	ISSUED FOR TENDER	LBL LF
REV	DATE	DESCRIPTION	REVIEWED / AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE:

INDUSTRIAL LM1
SINGLE LINE DIAGRAM
HV SWITCHGEAR
WIL00-HVSG-0001B

DRAFTED: DB	DESIGNED: GR	SHEET SIZE: A1
DRAFTING CHECK: DW	DESIGN CHECK: SK/PC	SCALE: NA
DATE: 20/05/22	REVIEWED: LBL	PBS: 131101

CONTRACT: C4B	DRAWING NUMBER: PUB-DTSS2-TWRP	REVISION: T1
SHEET NUMBER: WIL00-E-7016		

THIS DRAWING IS COPYRIGHT