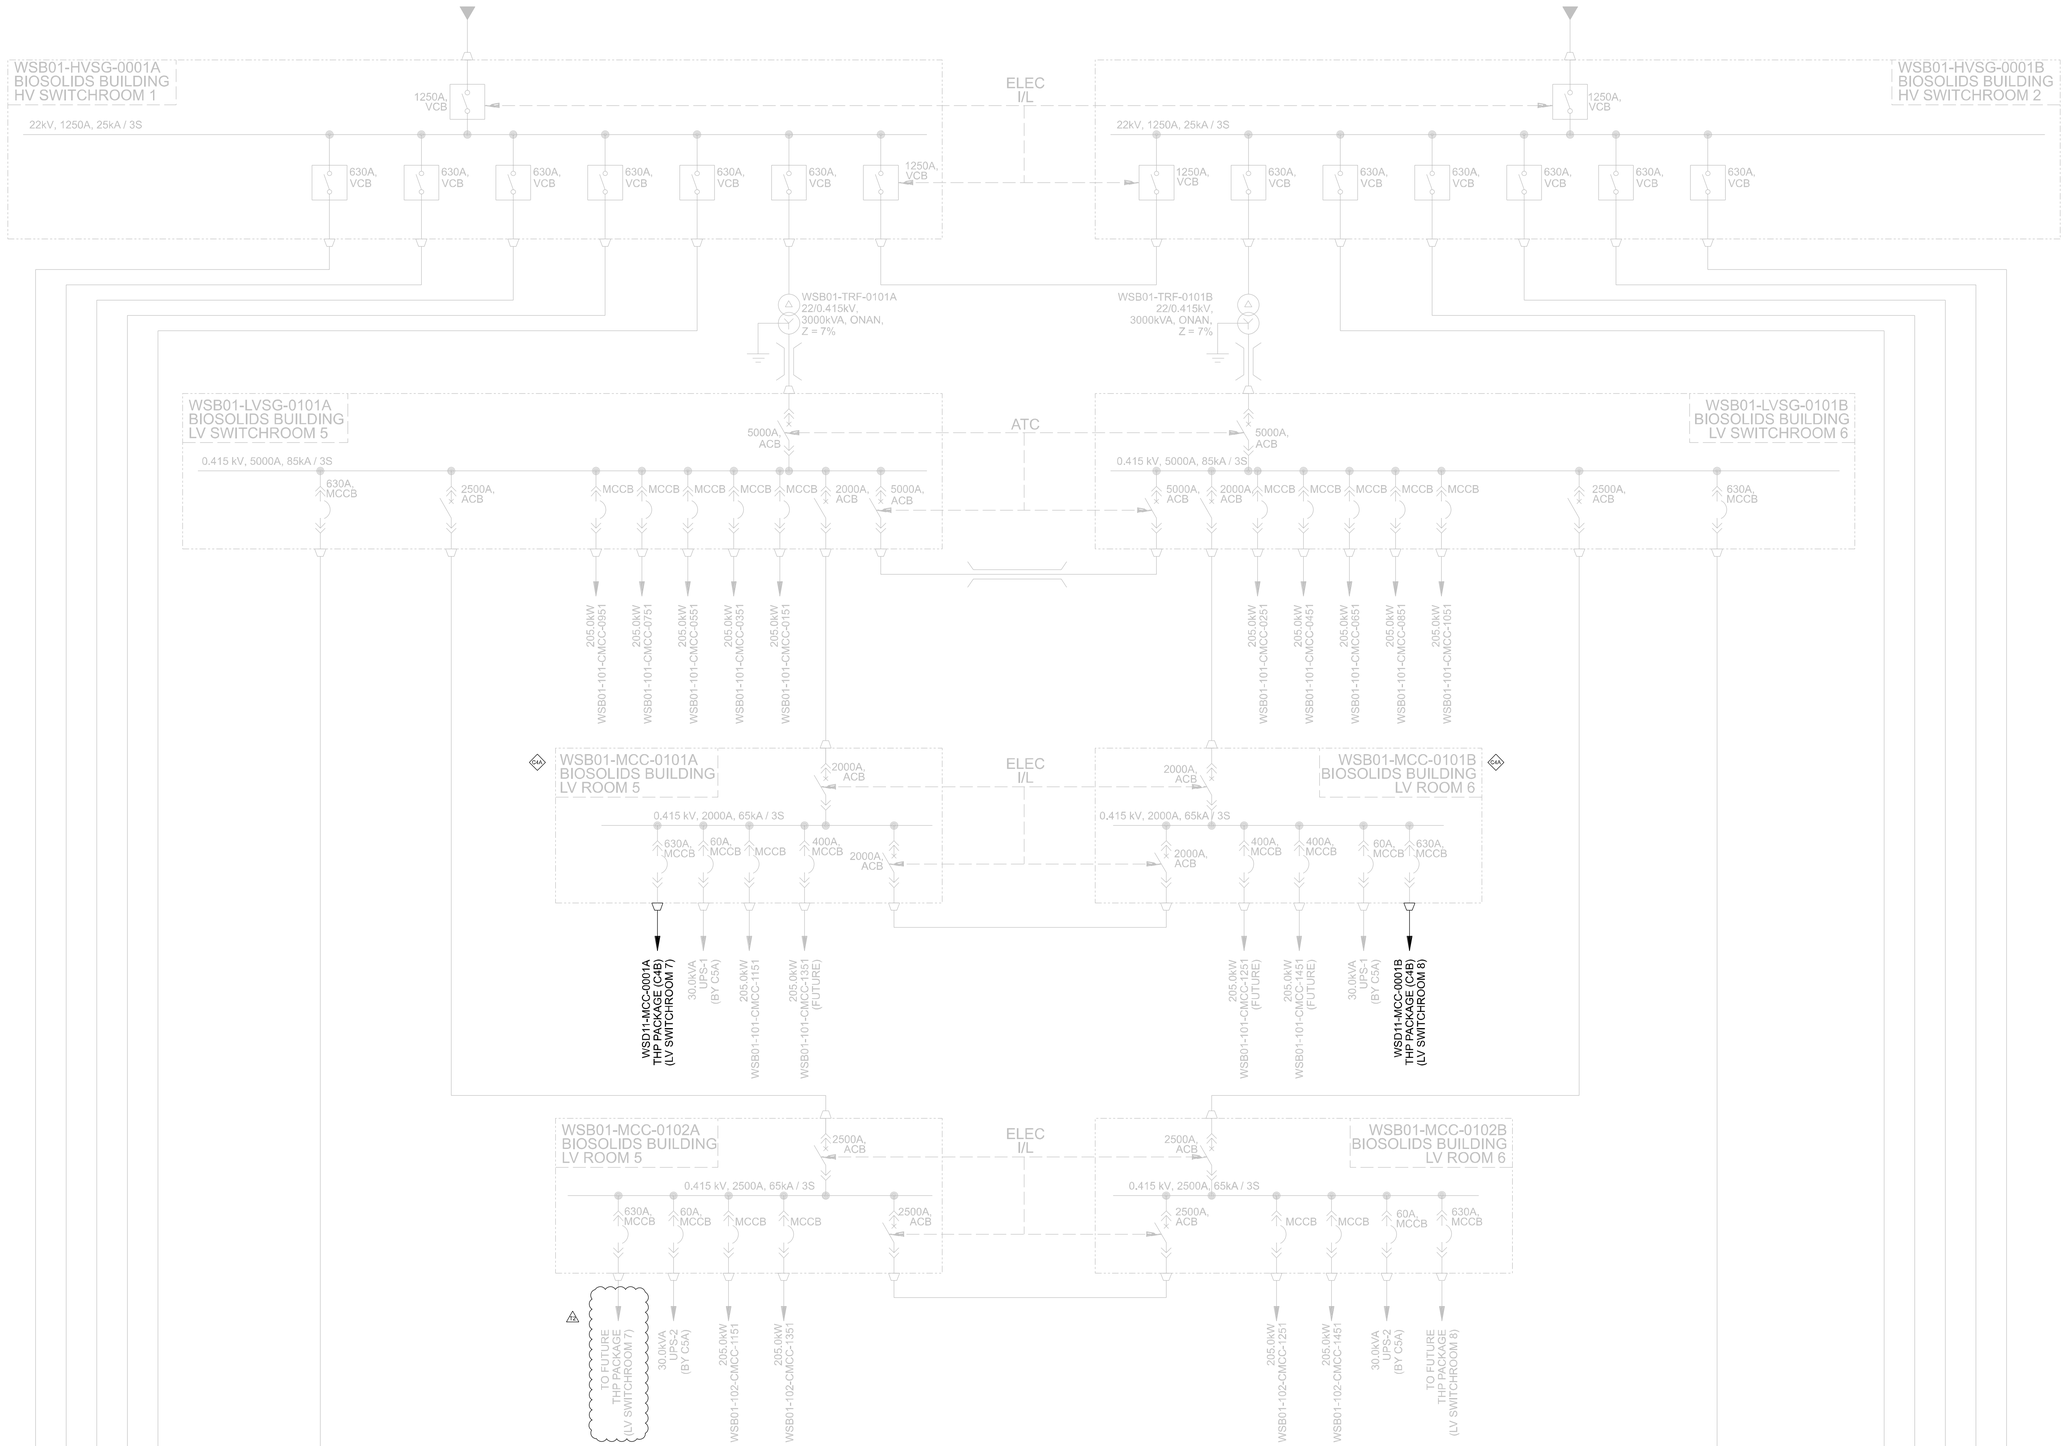

MATCHLINE, SEE DRAWING WSB01-E-7001

NOTES:

1. THE OVERALL SINGLE LINE DIAGRAM ILLUSTRATES THE ELECTRICAL DISTRIBUTION SYSTEM OF THE FACILITY.
2. THE CONTRACTOR SHALL REFER TO THE SPECIFICATIONS AND DETAILED SINGLE LINE DIAGRAMS FOR THE FULL REQUIREMENTS OF THE RESPECTIVE SWITCHGEAR AND MOTOR CONTROL CENTRES.
3. SWITCHGEAR DIRECTLY FED FROM TRANSFORMERS SHALL HAVE AUTOMATIC TRANSFER CONTROL AS SPECIFIED IN THE SPECIFICATIONS.
4. SHORT CIRCUIT RATING OF THE SWITCHGEAR SHALL BE SELECTED BY THE CONTRACTOR BASED ON THE SHORT CIRCUIT STUDY. CONTRACTOR'S LEW SHALL ENDORSE THE SHORT CIRCUIT STUDY.
5. PROTECTION RELAYS AND ENERGY METERS SHALL BE IN ACCORDANCE WITH THE GENERAL SPECIFICATIONS.

TENDER

REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED
T2	25/11/22	ISSUED FOR TENDER C4B (2ND STAGE)	LBL	GOT
T1	20/11/22	ISSUED FOR TENDER	LBL	GOT

CLIENT:
PUB SINGAPORE'S NATIONAL WATER AGENCY

PROGRAMME MANAGER:
binnies AECOM
A JOINT VENTURE DELIVERING THE DTSS2 PROJECT

CONSULTANT:
Jacobs
CH2M HILL Singapore Pte Ltd

PROJECT TITLE:
TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE
BIOSOLIDS
SINGLE LINE DIAGRAM
OVERALL

DRAFTED:	DESIGNED:	SHEET SIZE:
GD	JK	A1
DRAFTING CHECK:	DESIGN CHECK:	SCALE:
JR	MA/AK	NA
DATE:	REVIEWED:	PBS:
25/11/22	RP	131101

CONTRACT: C4B
DRAWING NUMBER: PUB-DTSS2-TWRP
SHEET NUMBER: WSB01-E-7000
REVISION: T2

THIS DRAWING IS COPYRIGHT