


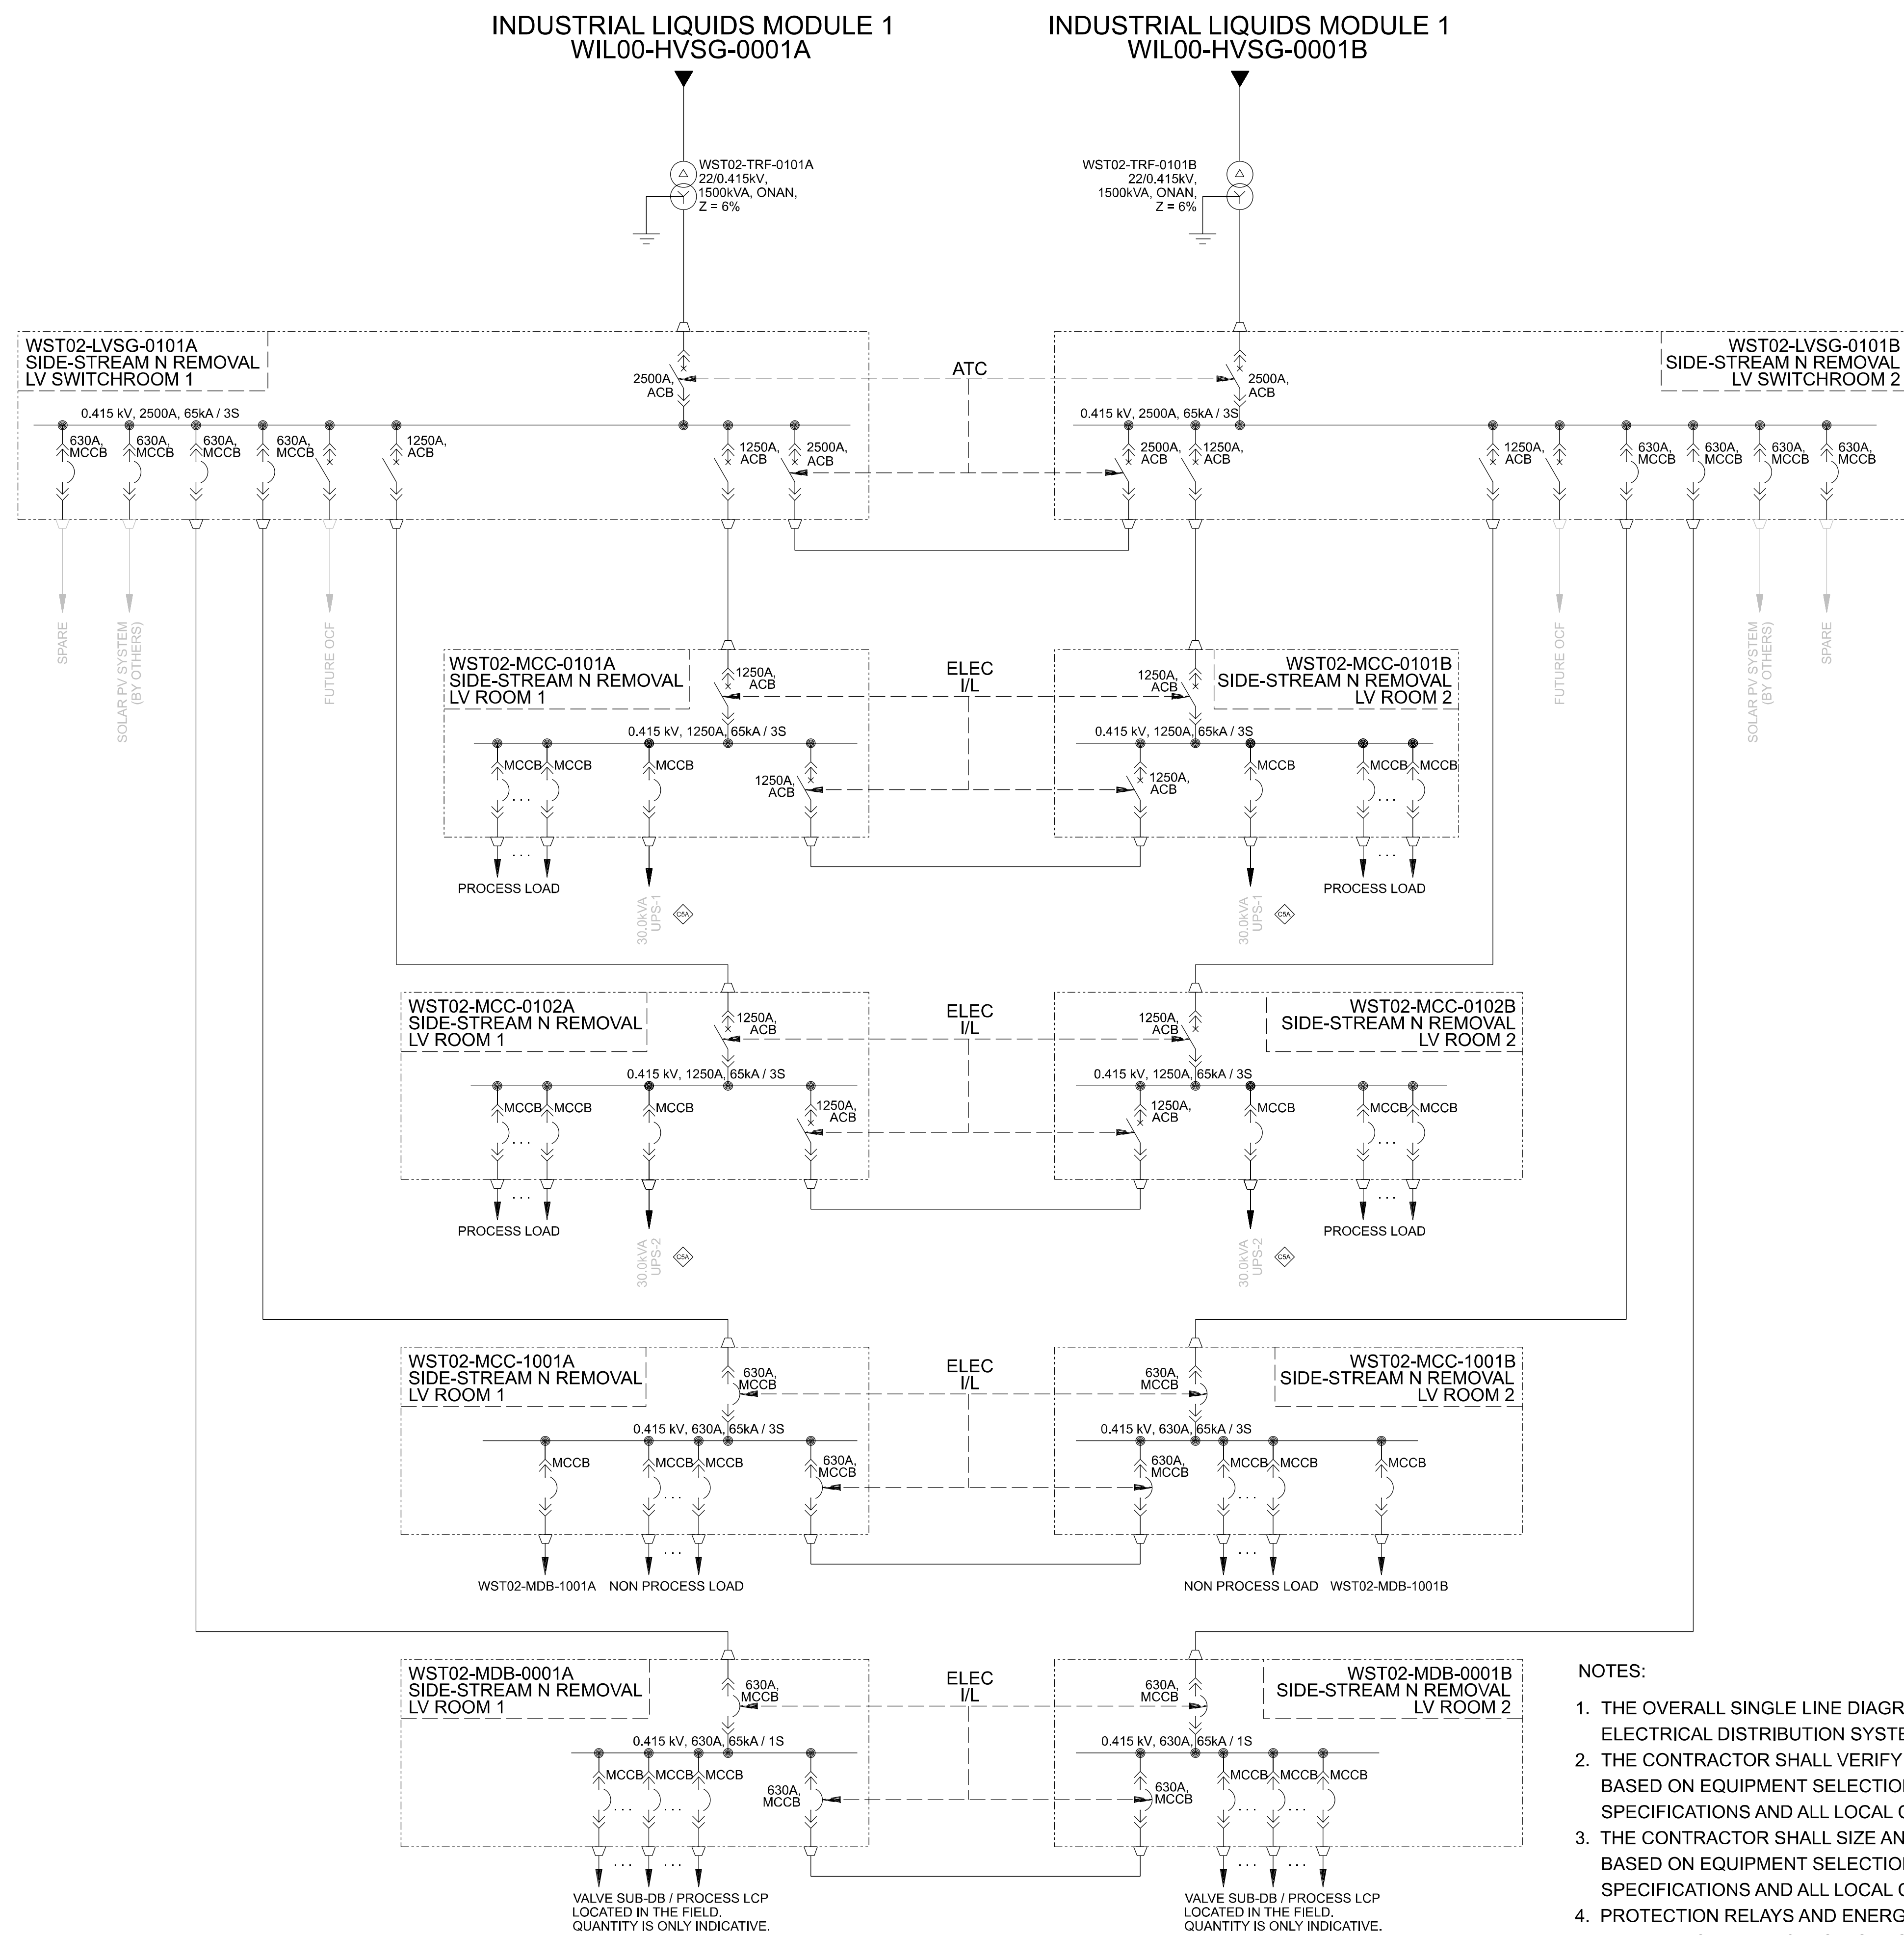

- NOTES:
1. THE OVERALL SINGLE LINE DIAGRAM ILLUSTRATES THE MINIMUM ELECTRICAL DISTRIBUTION SYSTEM OF THE FACILITY.
 2. THE CONTRACTOR SHALL VERIFY AND UPSIZE THE RATINGS, IF REQUIRED BASED ON EQUIPMENT SELECTION, AND IN ACCORDANCE WITH THE SPECIFICATIONS AND ALL LOCAL CODES AND REGULATIONS.
 3. THE CONTRACTOR SHALL SIZE AND SELECT THE TYPE OF THE CABLES BASED ON EQUIPMENT SELECTION, AND IN ACCORDANCE WITH THE SPECIFICATIONS AND ALL LOCAL CODES AND REGULATIONS.
 4. PROTECTION RELAYS AND ENERGY METERS SHALL BE IN ACCORDANCE WITH THE GENERAL SPECIFICATIONS.
 5. SWITCHGEAR DIRECTLY FED FROM TRANSFORMERS SHALL HAVE AUTOMATIC TRANSFER CONTROL AS SPECIFIED IN THE SPECIFICATIONS.
 6. MINIMUM SHORT CIRCUIT RATING SHALL BE AS SHOWN ON DRAWING AND VERIFIED BY THE CONTRACTOR'S SHORT CIRCUIT STUDY. CONTRACTOR'S LEW SHALL ENDORSE THE SHORT CIRCUIT STUDY.

TENDER

T1	20/05/22	ISSUED FOR TENDER	LBL	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:

Jacobs.
CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

SIDESTREAM N REMOVAL SINGLE LINE DIAGRAM OVERALL

DRAFTED: GD	DESIGNED: JK	SHEET SIZE: A1
DRAFTING CHECK: JR	DESIGN CHECK: MA/AK	SCALE: NA
DATE: 20/05/22	REVIEWED: LBL	PBS: 131101
CONTRACT: C4B	DRAWING NUMBER: PUB-DTSS2-TWRP	
	SHEET NUMBER: WST02-E-7000	REVISION: T1

THIS DRAWING IS COPYRIGHT