


BIOSOLIDS BUILDING
PROCESS XLV ROOM (PART OF)

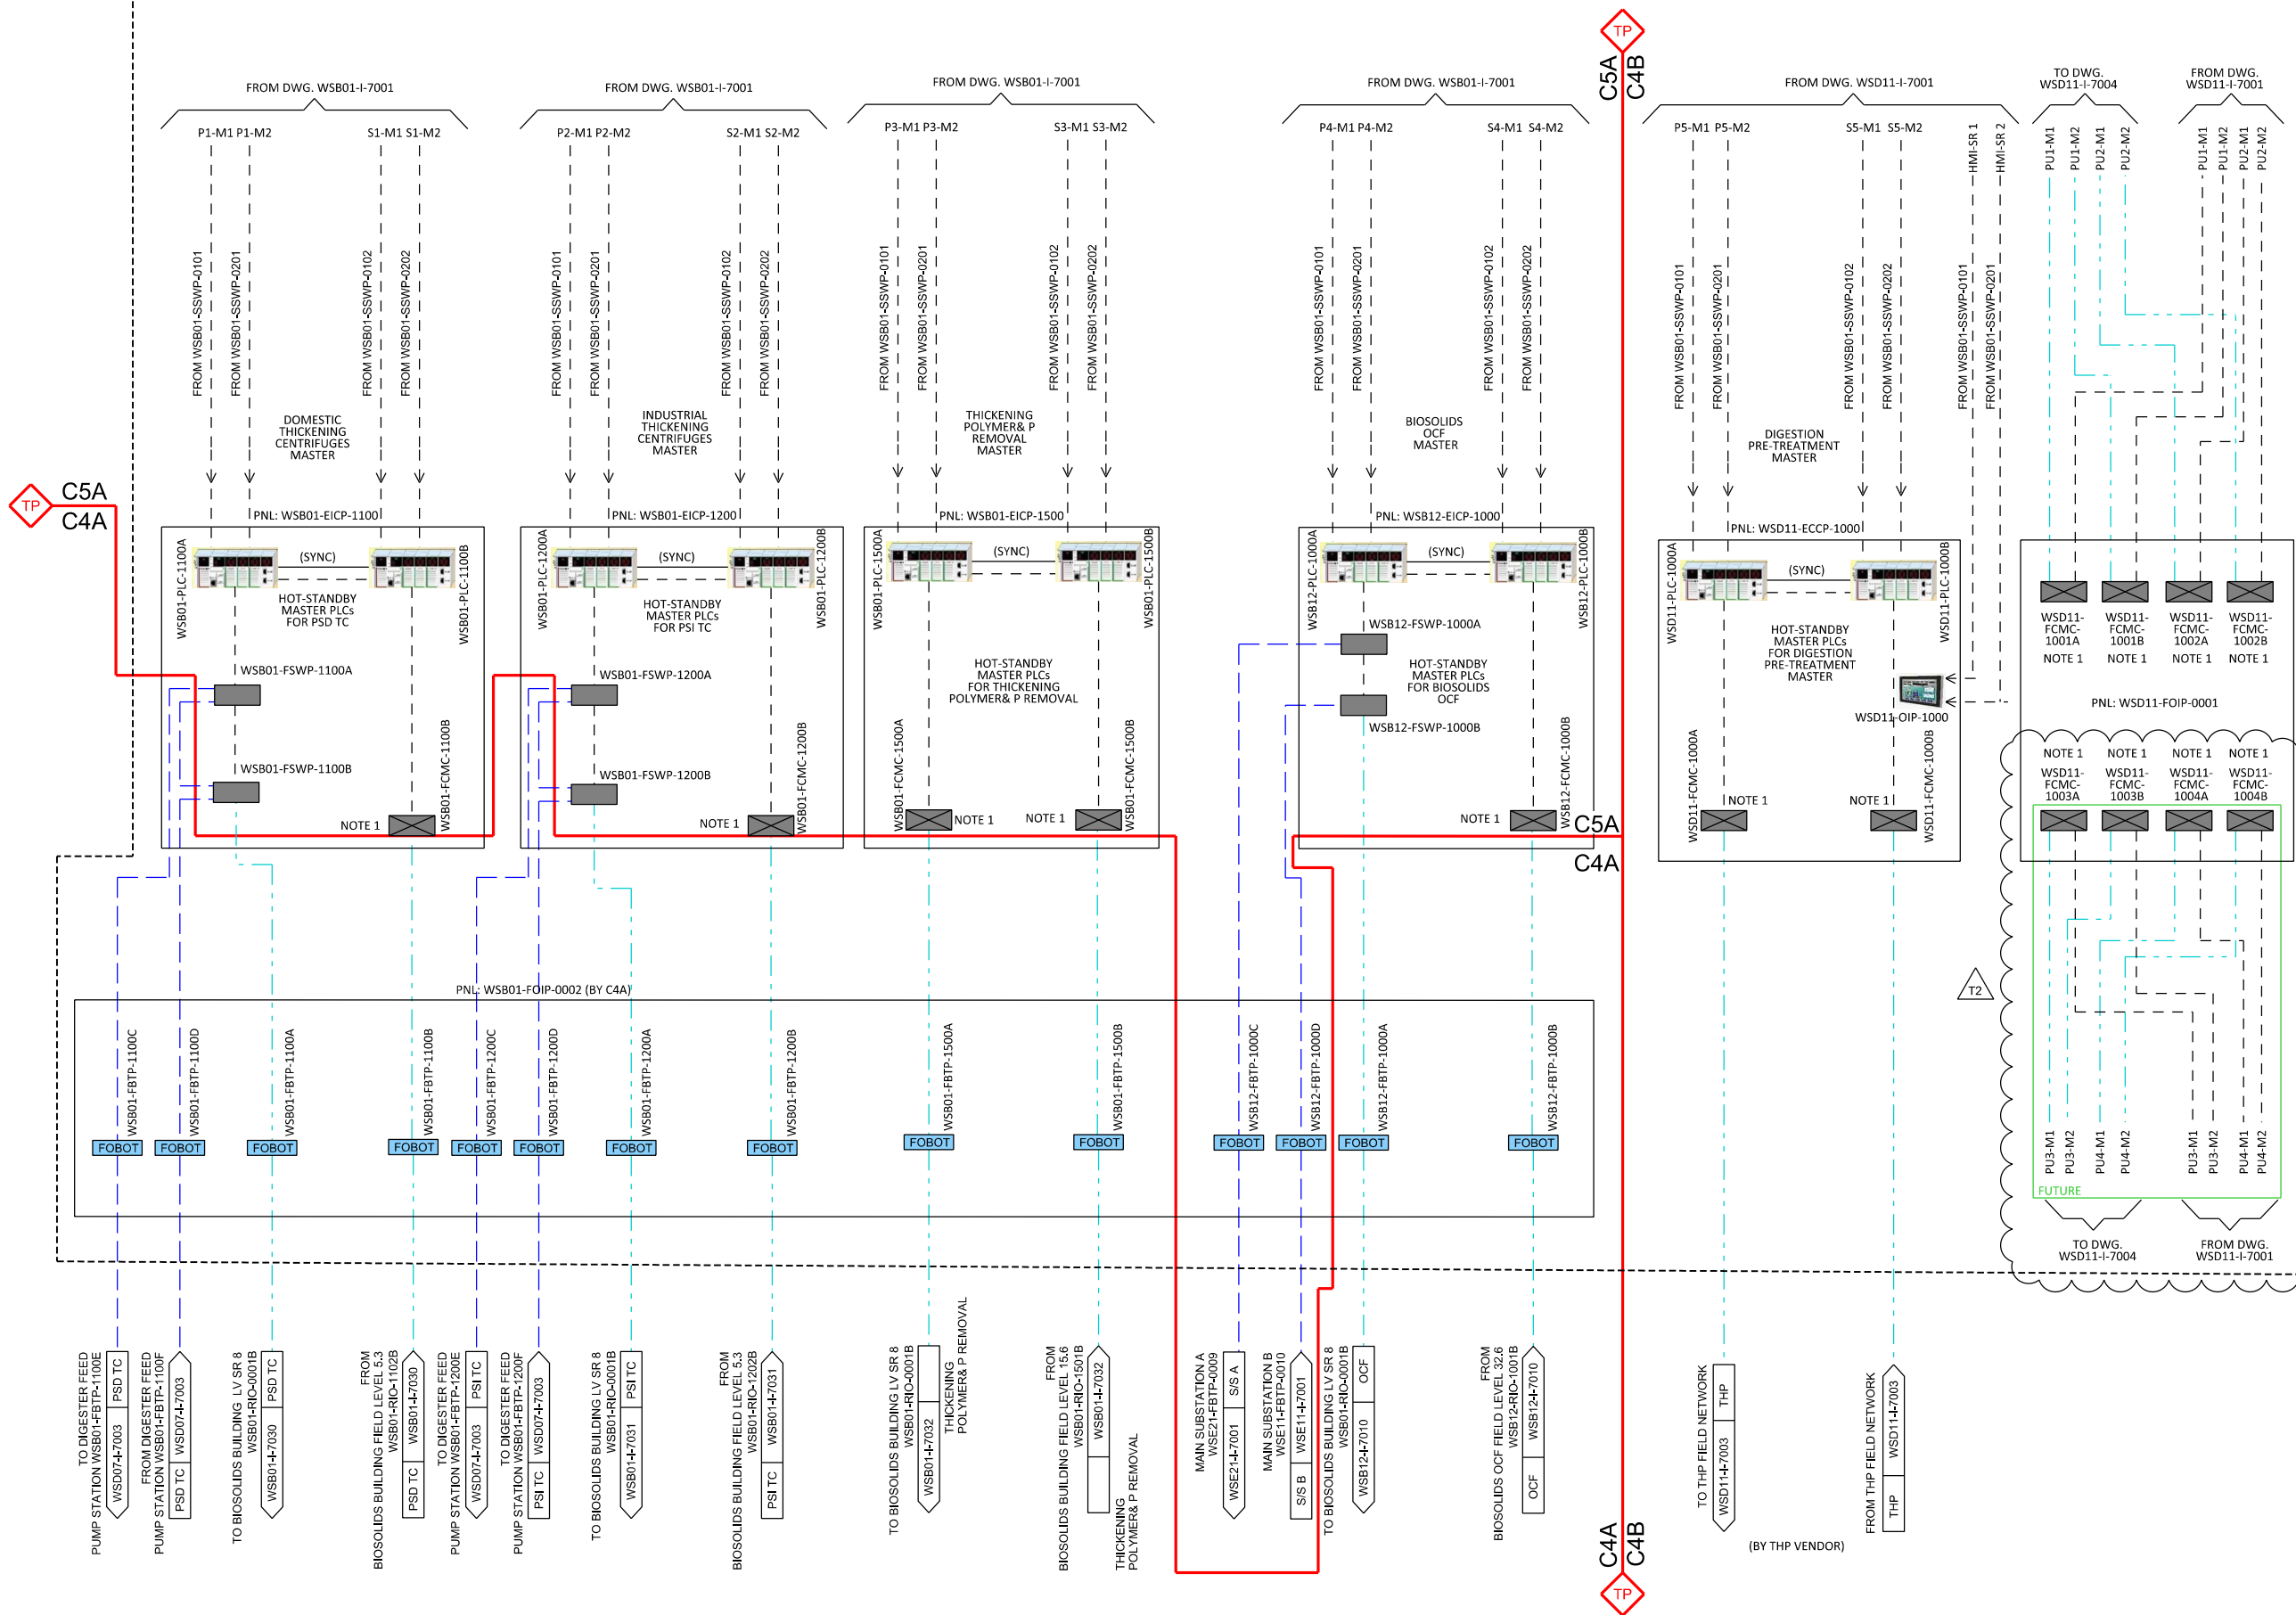

CABLE LEGEND:

- SINGLE-MODE F/O CABLES
- MULTI-MODE F/O CABLES

NOTES:

- MEDIA CONVERTER SHALL BE USED ONLY IF CONTROL SYSTEM MANUFACTURER DOES NOT OFFER VERSION WITH DIRECT FIBRE OPTIC CONNECTION.

REFERENCES:
GENERAL NOTES: 131101-WSW00-4-0010
LEGEND : 131101-WSW00-4-0011

TENDER

T2	25/11/22	ISSUED FOR TENDER C4B (2ND STAGE)	JL	GOT
T1	20/05/22	ISSUED FOR TENDER C4B	JL	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE:

CONTROL NETWORK DIAGRAM
BIOSOLIDS BUILDING
PROCESS XLV ROOM
PART-2

DRAFTED: PA	DESIGNED: SK	SHEET SIZE: A1
DRAFTING CHECK: RS	DESIGN CHECK: AT	SCALE: NTS
DATE: 25/11/22	REVIEWED: JL	PBS: 131101

CONTRACT:	DRAWING NUMBER:
C4B	PUB-DTSS2-TWRP
SHEET NUMBER:	REVISION:
WSD11-I-7002	T2

THIS DRAWING IS COPYRIGHT