


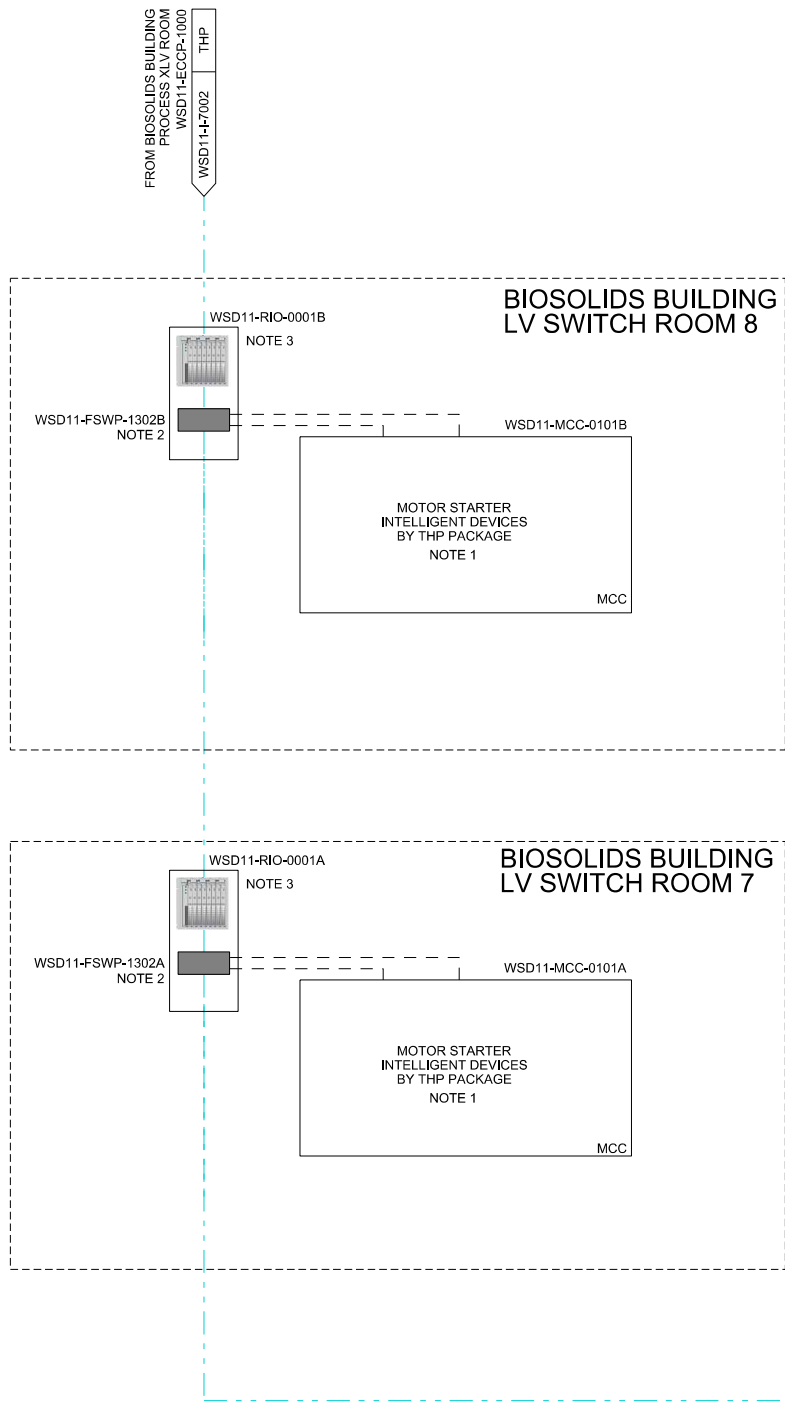

CABLE LEGEND:

- SINGLE-MODE F/O CABLES
- MULTI-MODE F/O CABLES

NOTES:

- QUANTITY OF INTELLIGENT DEVICES BY MCC VENDOR AND INTERNAL MCC NETWORK TOPOLOGY DEPEND ON SELECTED MCC VENDOR BY THIS CONTRACTOR.
- FIELD ETHERNET SWITCH SHALL BE MIN. OF 16 PORT INDUSTRIAL SWITCH.
- THE CONTROL NETWORK SHOWN IN THIS SCHEMATIC IS A NOTIONAL DESIGN AND THE QUANTITY OF RIO IS INDICATIVE ONLY. THE CONTRACTOR SHALL PROVIDE FIELD NETWORK AND FIELD PANELS (RIO PANELS) THAT COMPLY WITH THE DESIGN AND BUILD REQUIREMENTS FOR A FULLY FUNCTIONING COMPLETE SYSTEM.

REFERENCES:

GENERAL NOTES: 131101-WSW004-0010
LEGEND : 131101-WSW004-0011

TENDER

T1	20/05/22	ISSUED FOR TENDER C4B	JL	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE:

CONTROL NETWORK DIAGRAM
THP FIELD & MCC

DRAFTED: PA	DESIGNED: SK	SHEET SIZE: A1
DRAFTING CHECK: RS	DESIGN CHECK: AT	SCALE: NTS
DATE: 20/05/22	REVIEWED: JL	PBS: 131101

CONTRACT: C4B	DRAWING NUMBER: PUB-DTSS2-TWRP	REVISION: T1
------------------	-----------------------------------	-----------------

THIS DRAWING IS COPYRIGHT