


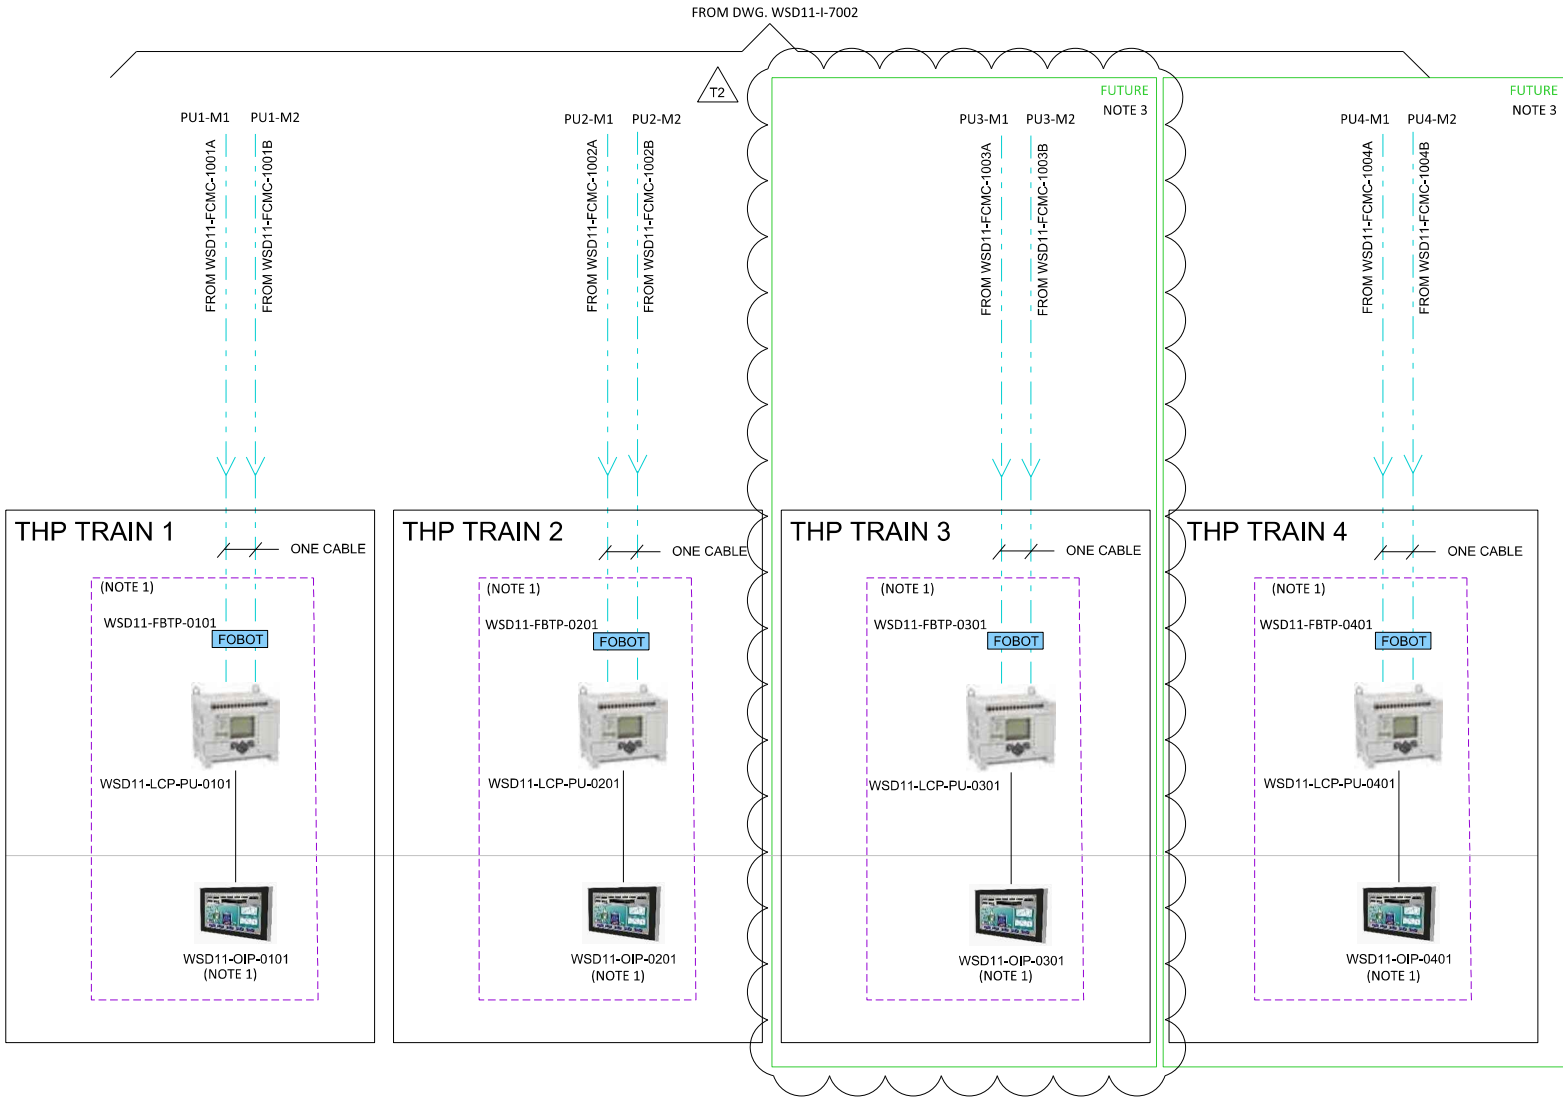

CABLE LEGEND:

- SINGLE-MODE F/O CABLES
- MULTIMODE F/O CABLES

NOTES:

1. LCP PANELS, THP PLC, FBTP, FIELD ETHERNET SWITCH (FSWP) AND OIP SHALL BE PROVIDED AS A MINIMUM ACCORDING TO D&B REQUIREMENTS BY THIS CONTRACTOR. LCP SHALL BE INSTALLED AT EACH THP TRAIN AT THE FIELD.
2. THE CONTROL NETWORK SHOWN IN THIS SCHEMATIC IS A NOTIONAL DESIGN, THE CONTRACTOR SHALL PROVIDE FIELD CONTROL NETWORK AND FIELD PANELS (RIO PANELS) THAT COMPLY WITH THE DESIGN AND BUILD REQUIREMENTS FOR A FULLY FUNCTIONING COMPLETE SYSTEM. IF THE CONTRACTOR PROPOSE TO PROVIDE RIO PANEL FOR EACH THP TRAIN, THE CONTRACTOR SHALL PROVIDE ACCORDINGLY FOR FUNCTIONING OF COMPLETE SYSTEM.
3. THIS IS INDICATIVE CONNECTION FOR FUTURE PANEL. THE CONTRACTOR SHALL ONLY ALLOCATE A SPACE FOR FUTURE PANEL. PANEL, THP PLC AND ETC. ARE NOT REQUIRED TO BE PROVIDED IN THIS CONTRACT.

REFERENCES:

GENERAL NOTES: 131101-WSW004-0010
LEGEND : 131101-WSW004-0011

TENDER

T2	25/11/22	ISSUED FOR TENDER C4B (2ND STAGE)	JL	GOT
T1	20/05/22	ISSUED FOR TENDER C4B	JL	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

CONTROL NETWORK DIAGRAM
THP TRAINS LCP

DRAFTED: PA	DESIGNED: SK	SHEET SIZE: A1
DRAFTING CHECK: RS	DESIGN CHECK: AT	SCALE: NTS
DATE: 25/11/22	REVIEWED: JL	PBS: 131101

CONTRACT:	DRAWING NUMBER:
C4B	PUB-DTSS2-TWRP
SHEET NUMBER:	REVISION:
WSD11-I-7004	T2

THIS DRAWING IS COPYRIGHT