


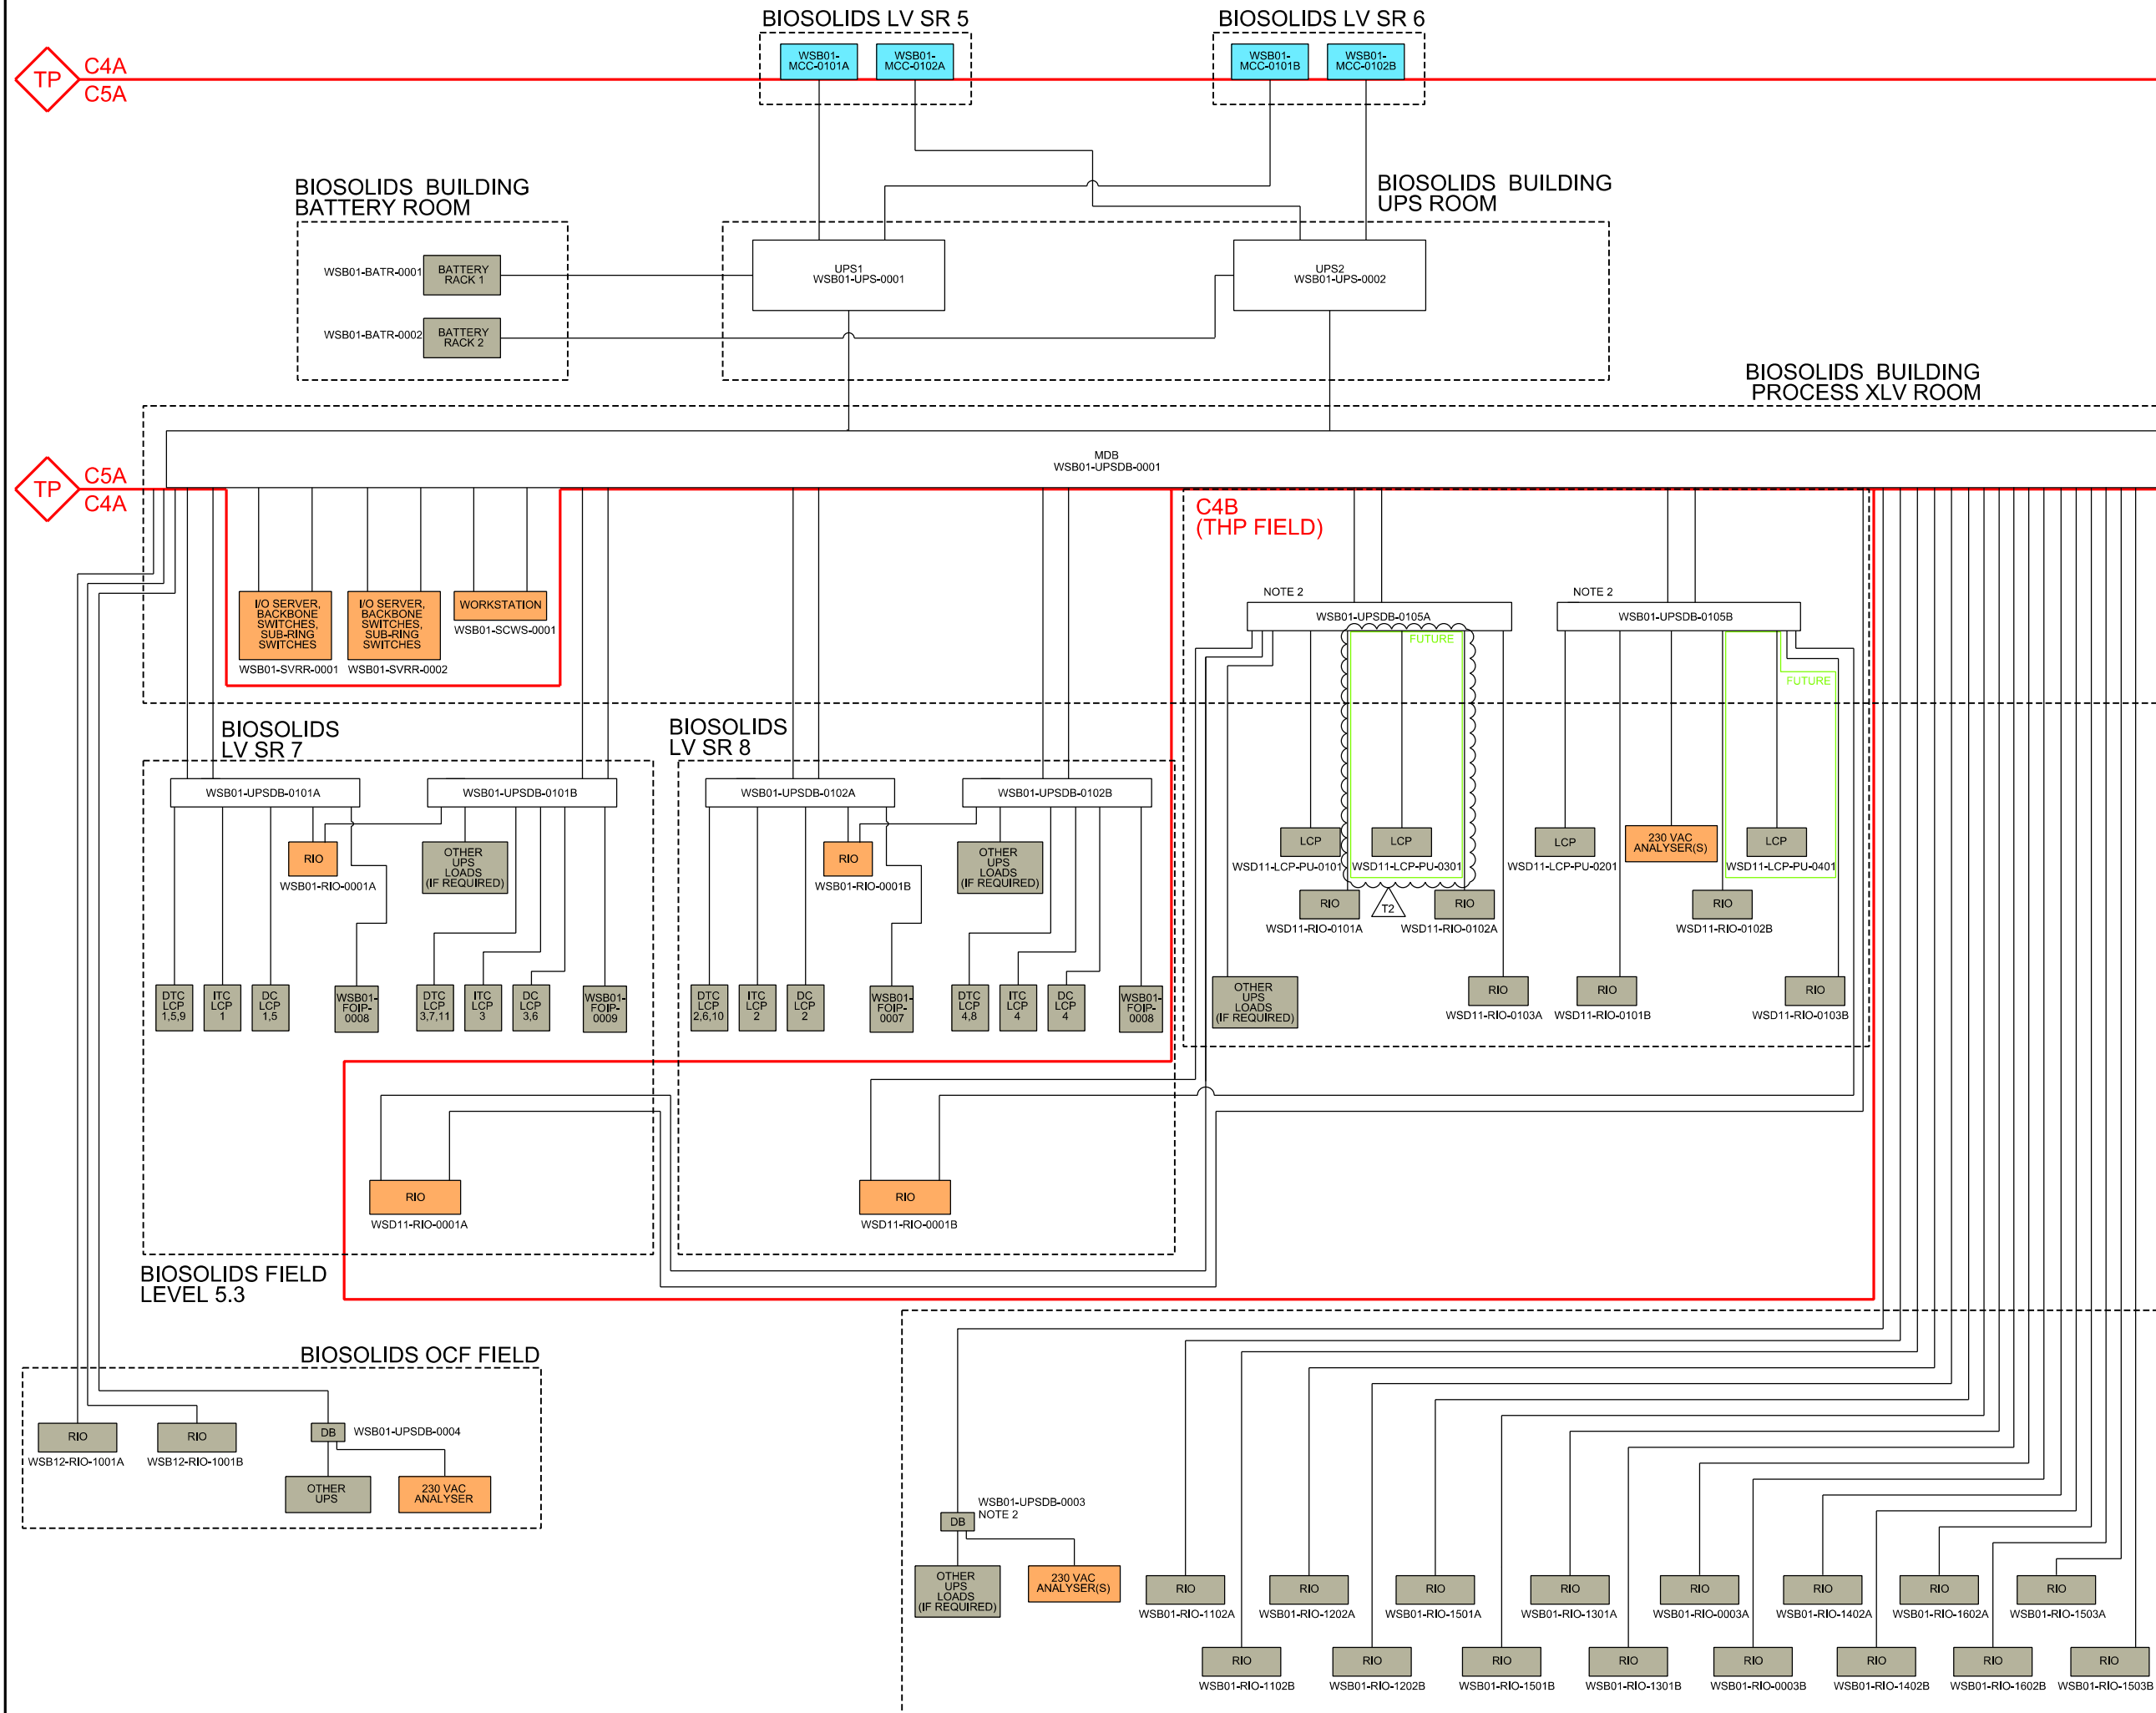

- NOTES:
1. UPS AND BATTERIES ARE PROVIDED BY C5A CONTRACTOR.
 2. FIELD DBs SHALL BE PROVIDED AT THE FIELD BY C4B AS REQUIRED BASED ON POWER REQUIREMENTS AND GEOGRAPHICAL LOCATION. FIELD DBs SHALL BE EITHER 3 PHASE OR 1 PHASE AS DETERMINED BY SPECIFIC LOAD REQUIREMENTS.

TENDER

T2	25/11/22	ISSUED FOR TENDER C4B (2ND STAGE)	JL	GOT
T1	20/05/22	ISSUED FOR TENDER C4B	JL	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE:

POWER SUPPLY
TO MCS AT
BIOSOLIDS BUILDING
PART 1

DRAFTED: PA	DESIGNED: SK	SHEET SIZE: A1
DRAFTING CHECK: RS	DESIGN CHECK: AT	SCALE: NTS
DATE: 25/11/22	REVIEWED: JL	PBS: 131101

CONTRACT: C4B	DRAWING NUMBER: PUB-DTSS2-TWRP SHEET NUMBER: WSD11-I-7030	REVISION: T2
------------------	--	-----------------

THIS DRAWING IS COPYRIGHT