


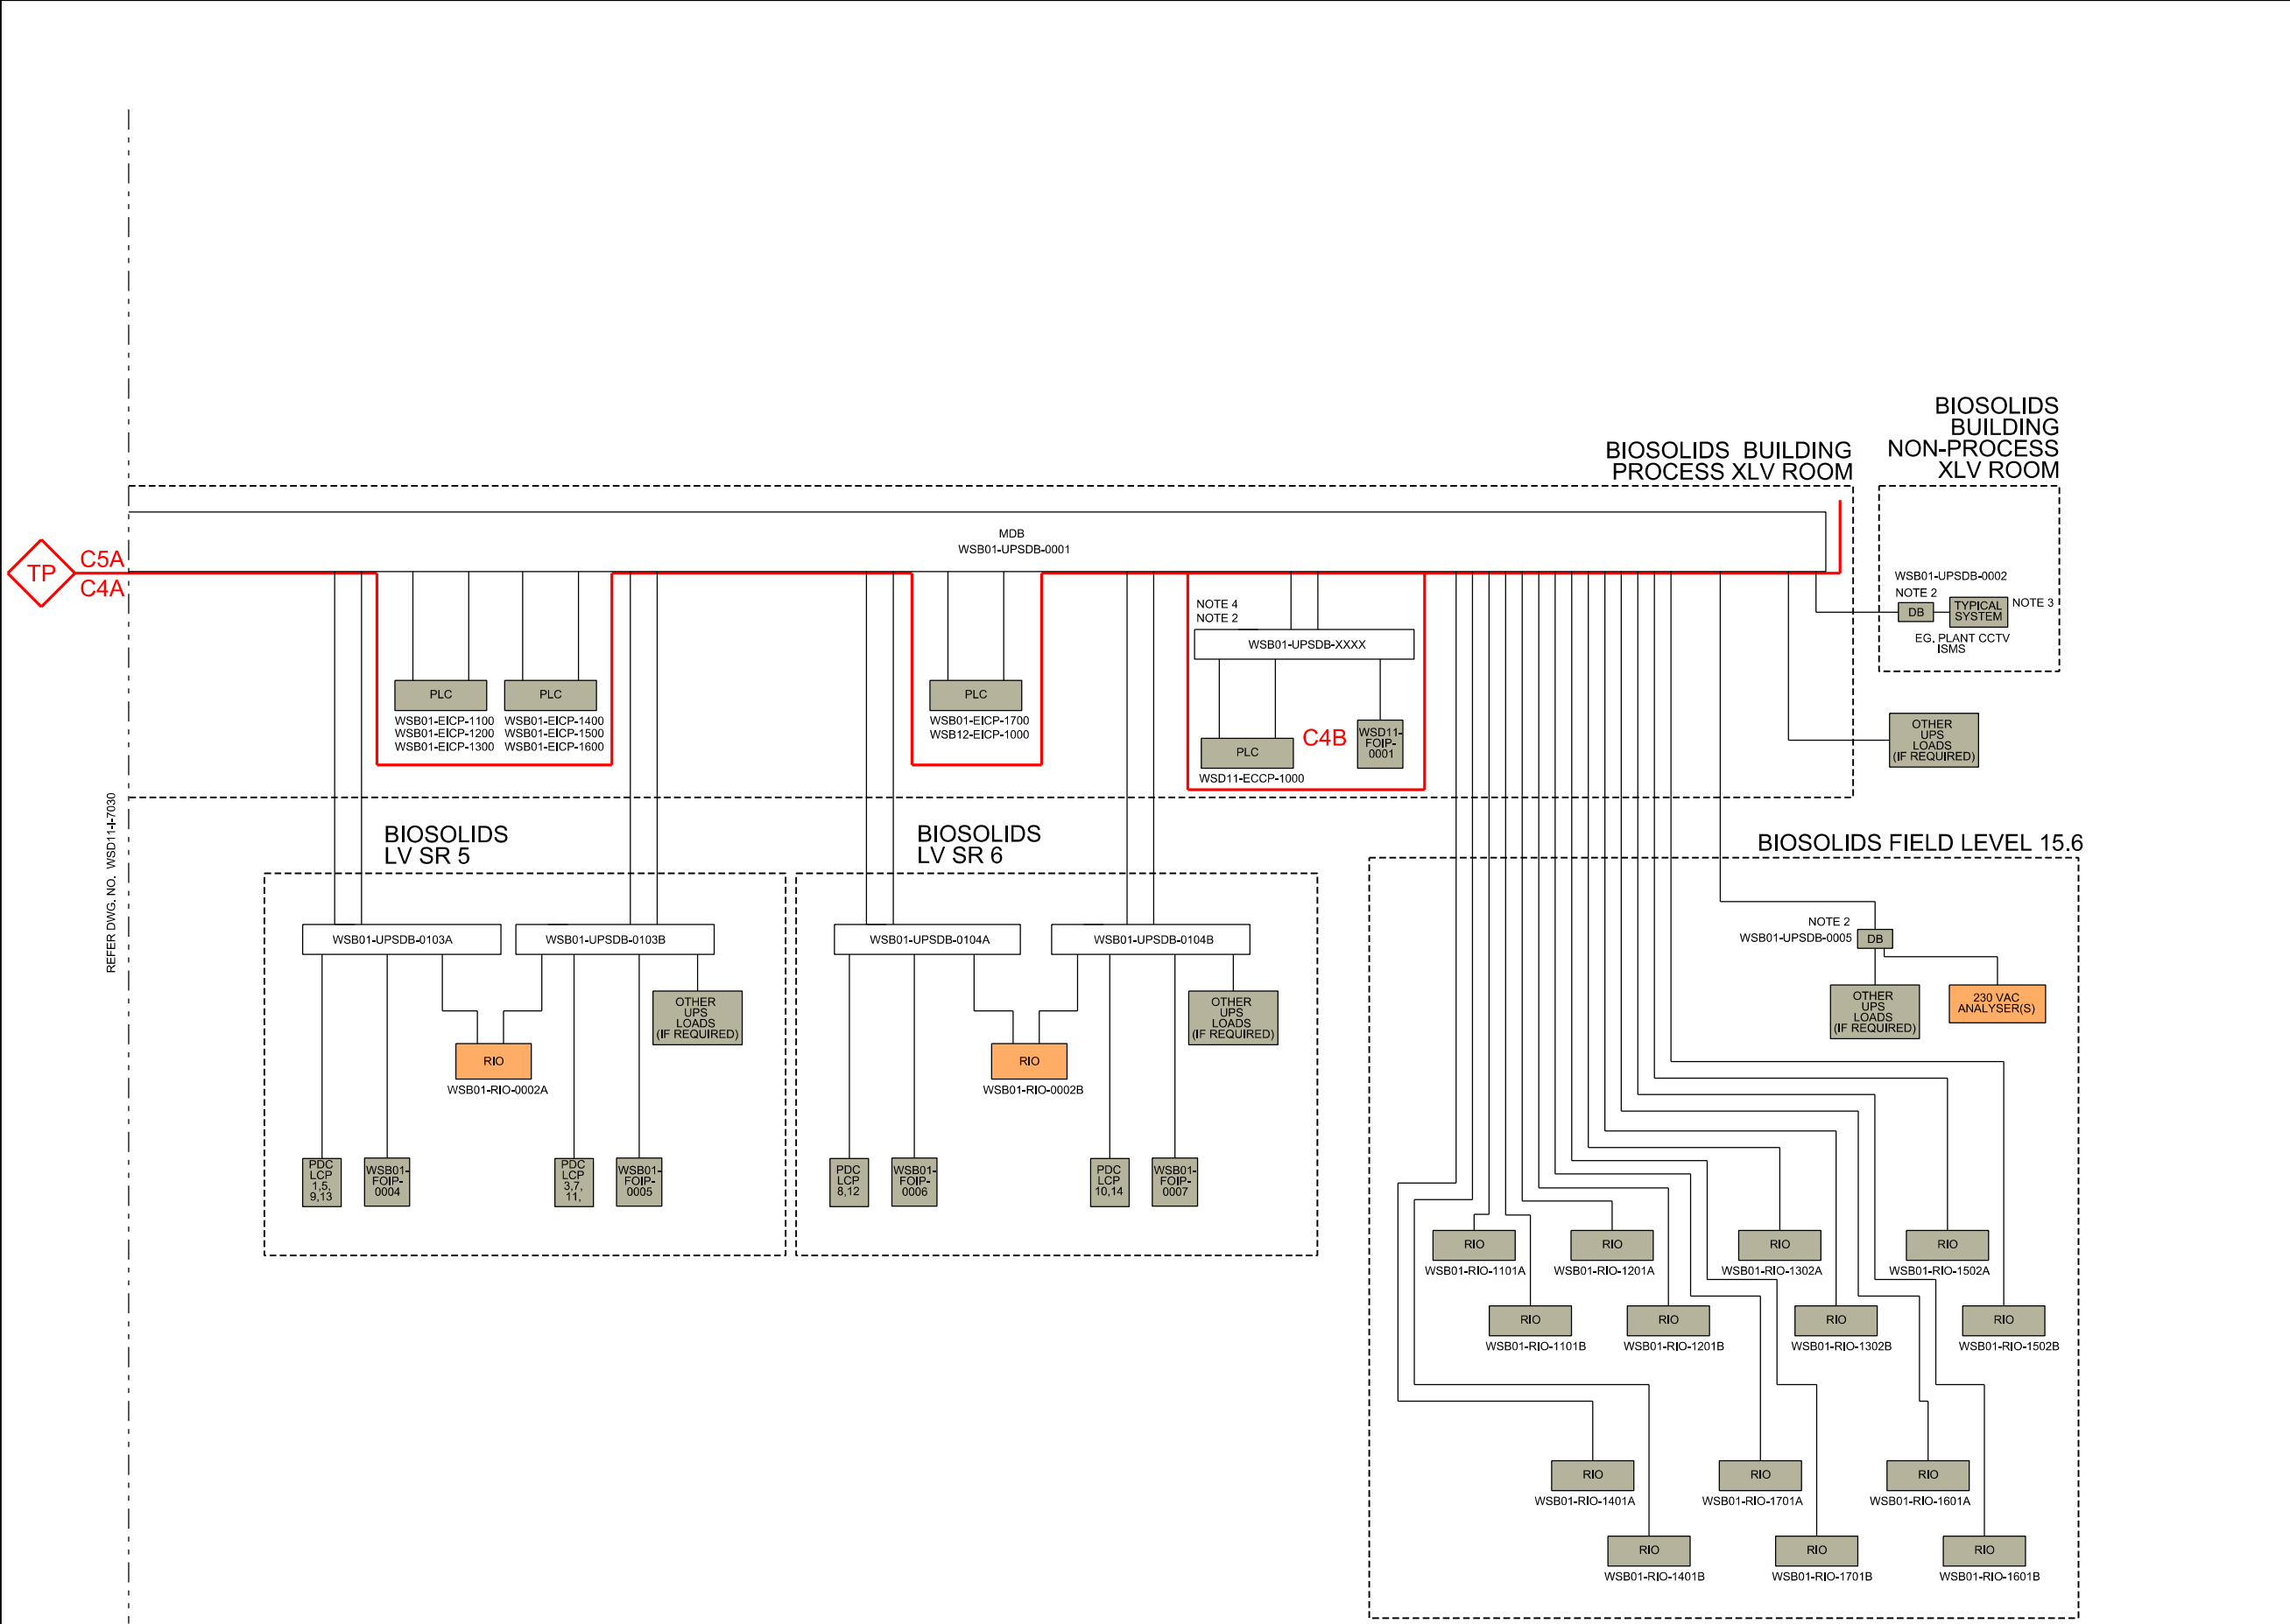

NOTES:

- UPS AND BATTERIES ARE PROVIDED BY C5A CONTRACTOR.
- FIELD DBs SHALL BE PROVIDED AT THE FIELD BY C4B AS REQUIRED BASED ON POWER REQUIREMENTS AND GEOGRAPHICAL LOCATION. FIELD DBs SHALL BE EITHER 3 PHASE OR 1 PHASE AS DETERMINED BY SPECIFIC LOAD REQUIREMENTS.
- REFER TO BUILDING SERVICES SCHEMATIC AND SPECIFICATIONS P7 FOR EQUIPMENT/SYSTEM REQUIRES UPS- SUPPLIED.
- UPSDB TAGGING TO BE DETERMINED AND COORDINATED DURING CONSTRUCTION WITH C4A AND C5A.

ADDENDUM

T1	20/05/22	ISSUED FOR TENDER C4B	JL	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:

PUB

SINGAPORE'S NATIONAL WATER AGENCY

PROGRAMME MANAGER:

bmies

AECOM

A JOINT VENTURE DELIVERING THE DTSS2 PROJECT

CONSULTANT:

Jacobs

CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

POWER SUPPLY
TO MCS AT
BIOSOLIDS BUILDING
PART 2

DRAFTED: PA	DESIGNED: SK	SHEET SIZE: A1
DRAFTING CHECK: RS	DESIGN CHECK: AT	SCALE: NTS
DATE: 20/05/22	REVIEWED: JL	PBS: 131101

CONTRACT:	DRAWING NUMBER:
C4B	PUB-DTSS2-TWRP
SHEET NUMBER:	REVISION:
WSD11-I-7031	T1

THIS DRAWING IS COPYRIGHT