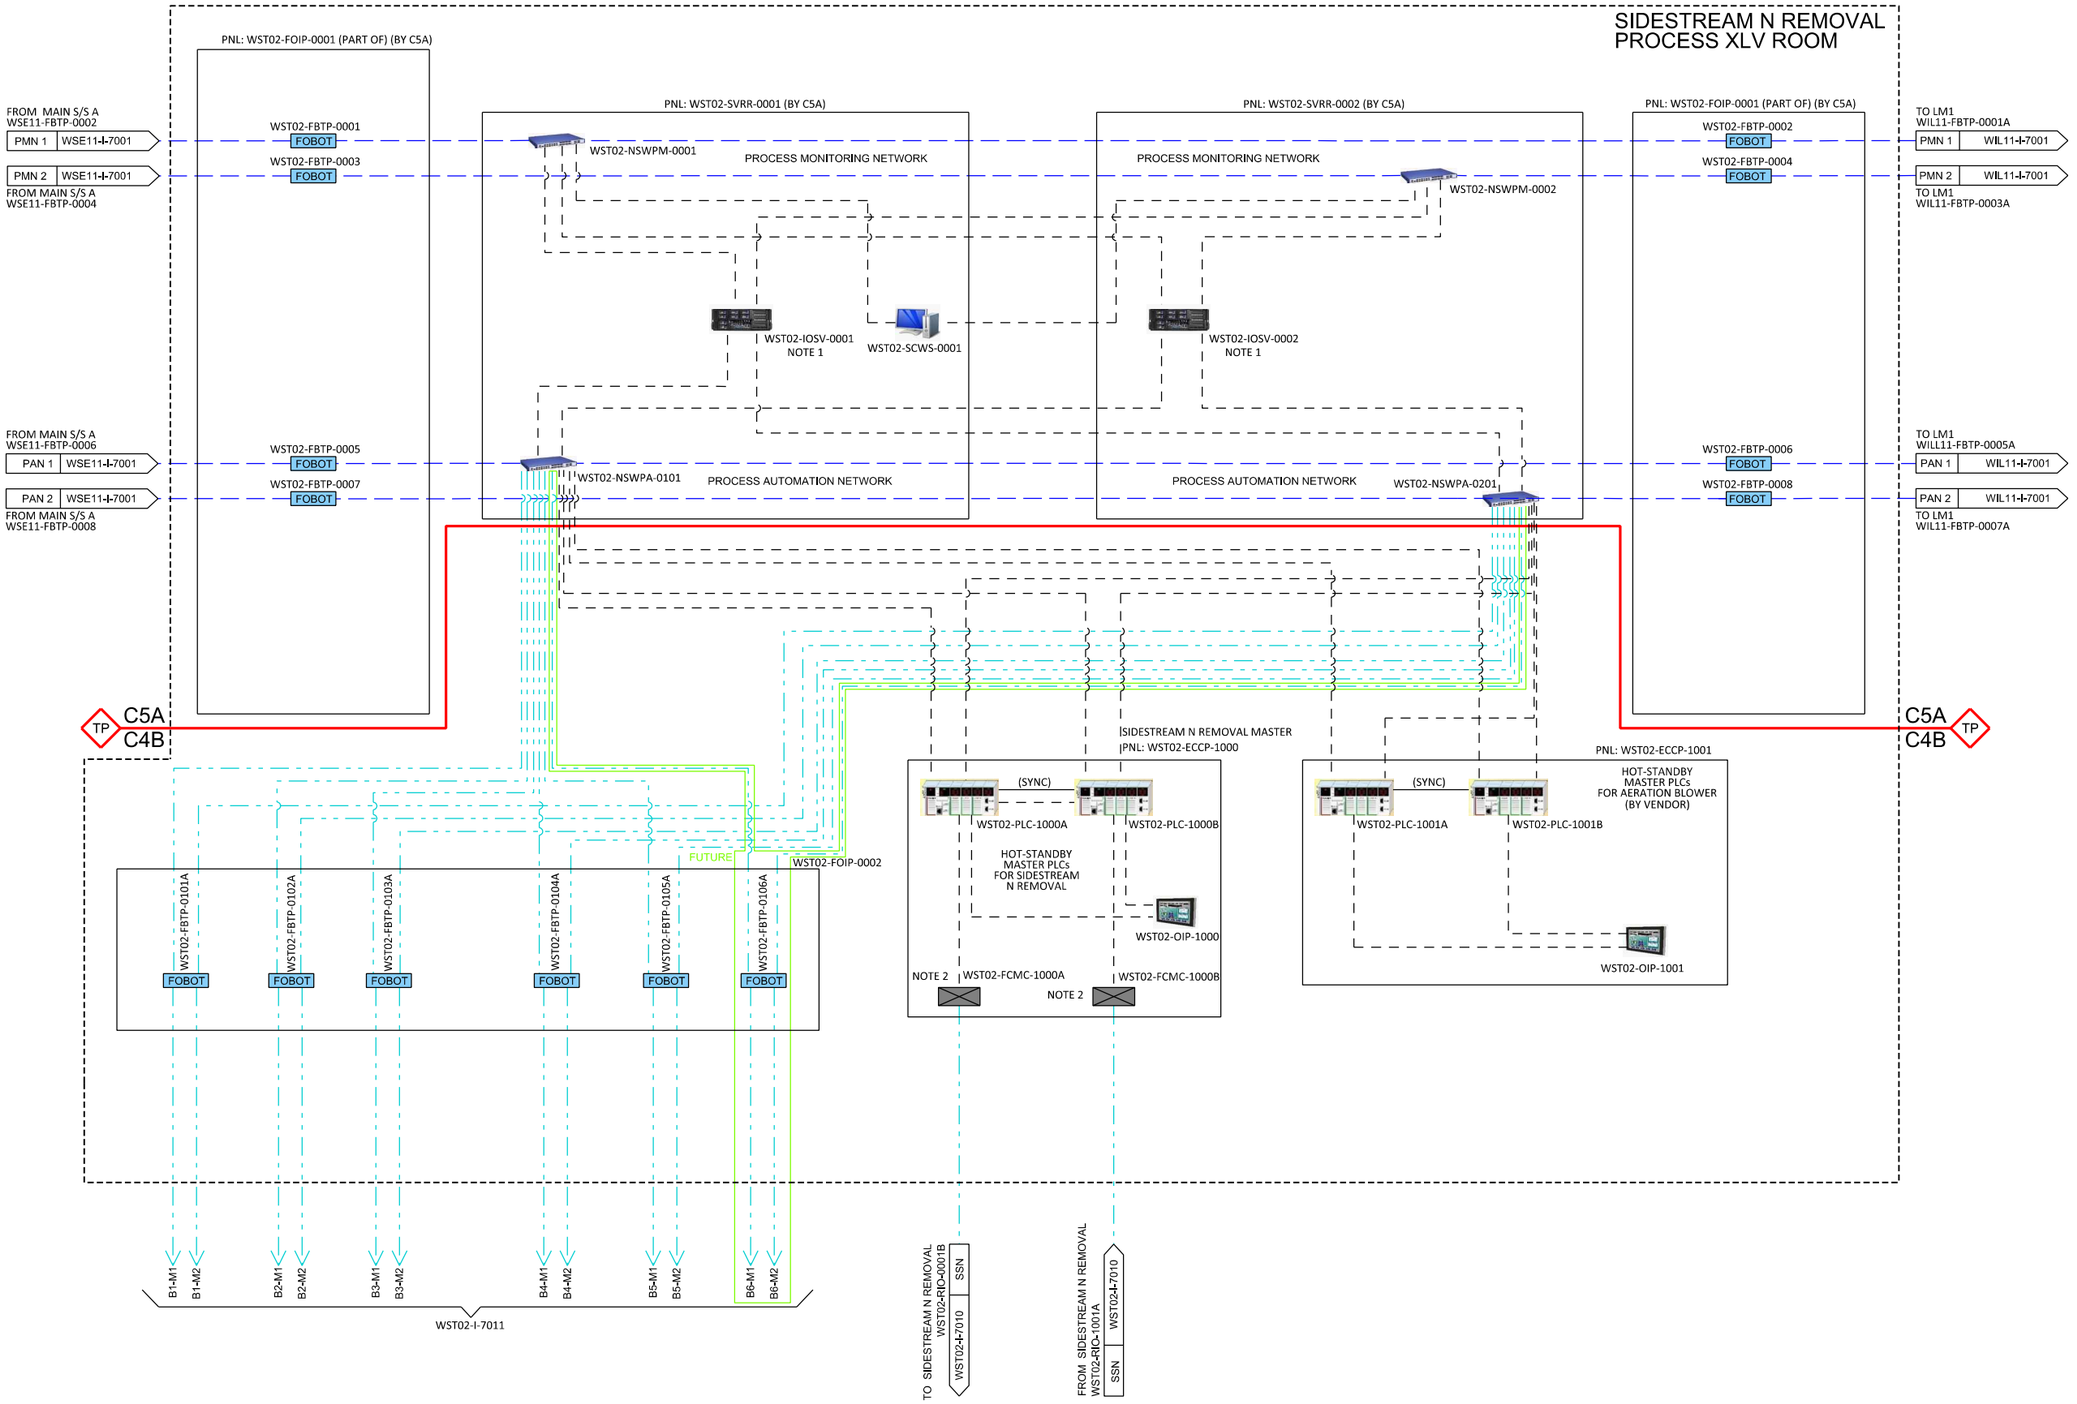

CABLE LEGEND:

- SINGLE-MODE F/O CABLES
- MULTI-MODE F/O CABLES

NOTES:

1. I/O SERVER IS FOR ENTIRE WST02. I/O SERVERS WILL BE PROVIDED WITH SHARED MONITOR, KEYBOARD AND KVM SWITCH (BY C5A, NOT SHOWN).
2. F/O TO COPPER CONVERTER REQUIREMENT DEPENDING ON SIDESTEAM N REMOVAL VENDOR DESIGN CONTROL SYSTEM.

REFERENCES:

GENERAL NOTES: 131101-WSW00-I-0010

LEGEND : 131101-WSW00-I-0011

TENDER

REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED
T1	20/05/22	ISSUED FOR TENDER	JL	GOT

CLIENT:

PUB SINGAPORE'S NATIONAL WATER AGENCY

PROGRAMME MANAGER:

binnies AECOM

A JOINT VENTURE DELIVERING THE DTSS2 PROJECT

CONSULTANT:

Jacobs

CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

CONTROL NETWORK DIAGRAM
SIDESTREAM N REMOVAL
PROCESS XLV ROOM

DRAFTED:	DESIGNED:	SHEET SIZE:
PA	SK	A1
DRAFTING CHECK:	DESIGN CHECK:	SCALE:
RS	AT	NTS
DATE:	REVIEWED:	PBS:
20/05/22	JL	131101

CONTRACT: C4B

DRAWING NUMBER: PUB-DTSS2-TWRP

SHEET NUMBER: WST02-I-7001

REVISION: T1

THIS DRAWING IS COPYRIGHT