


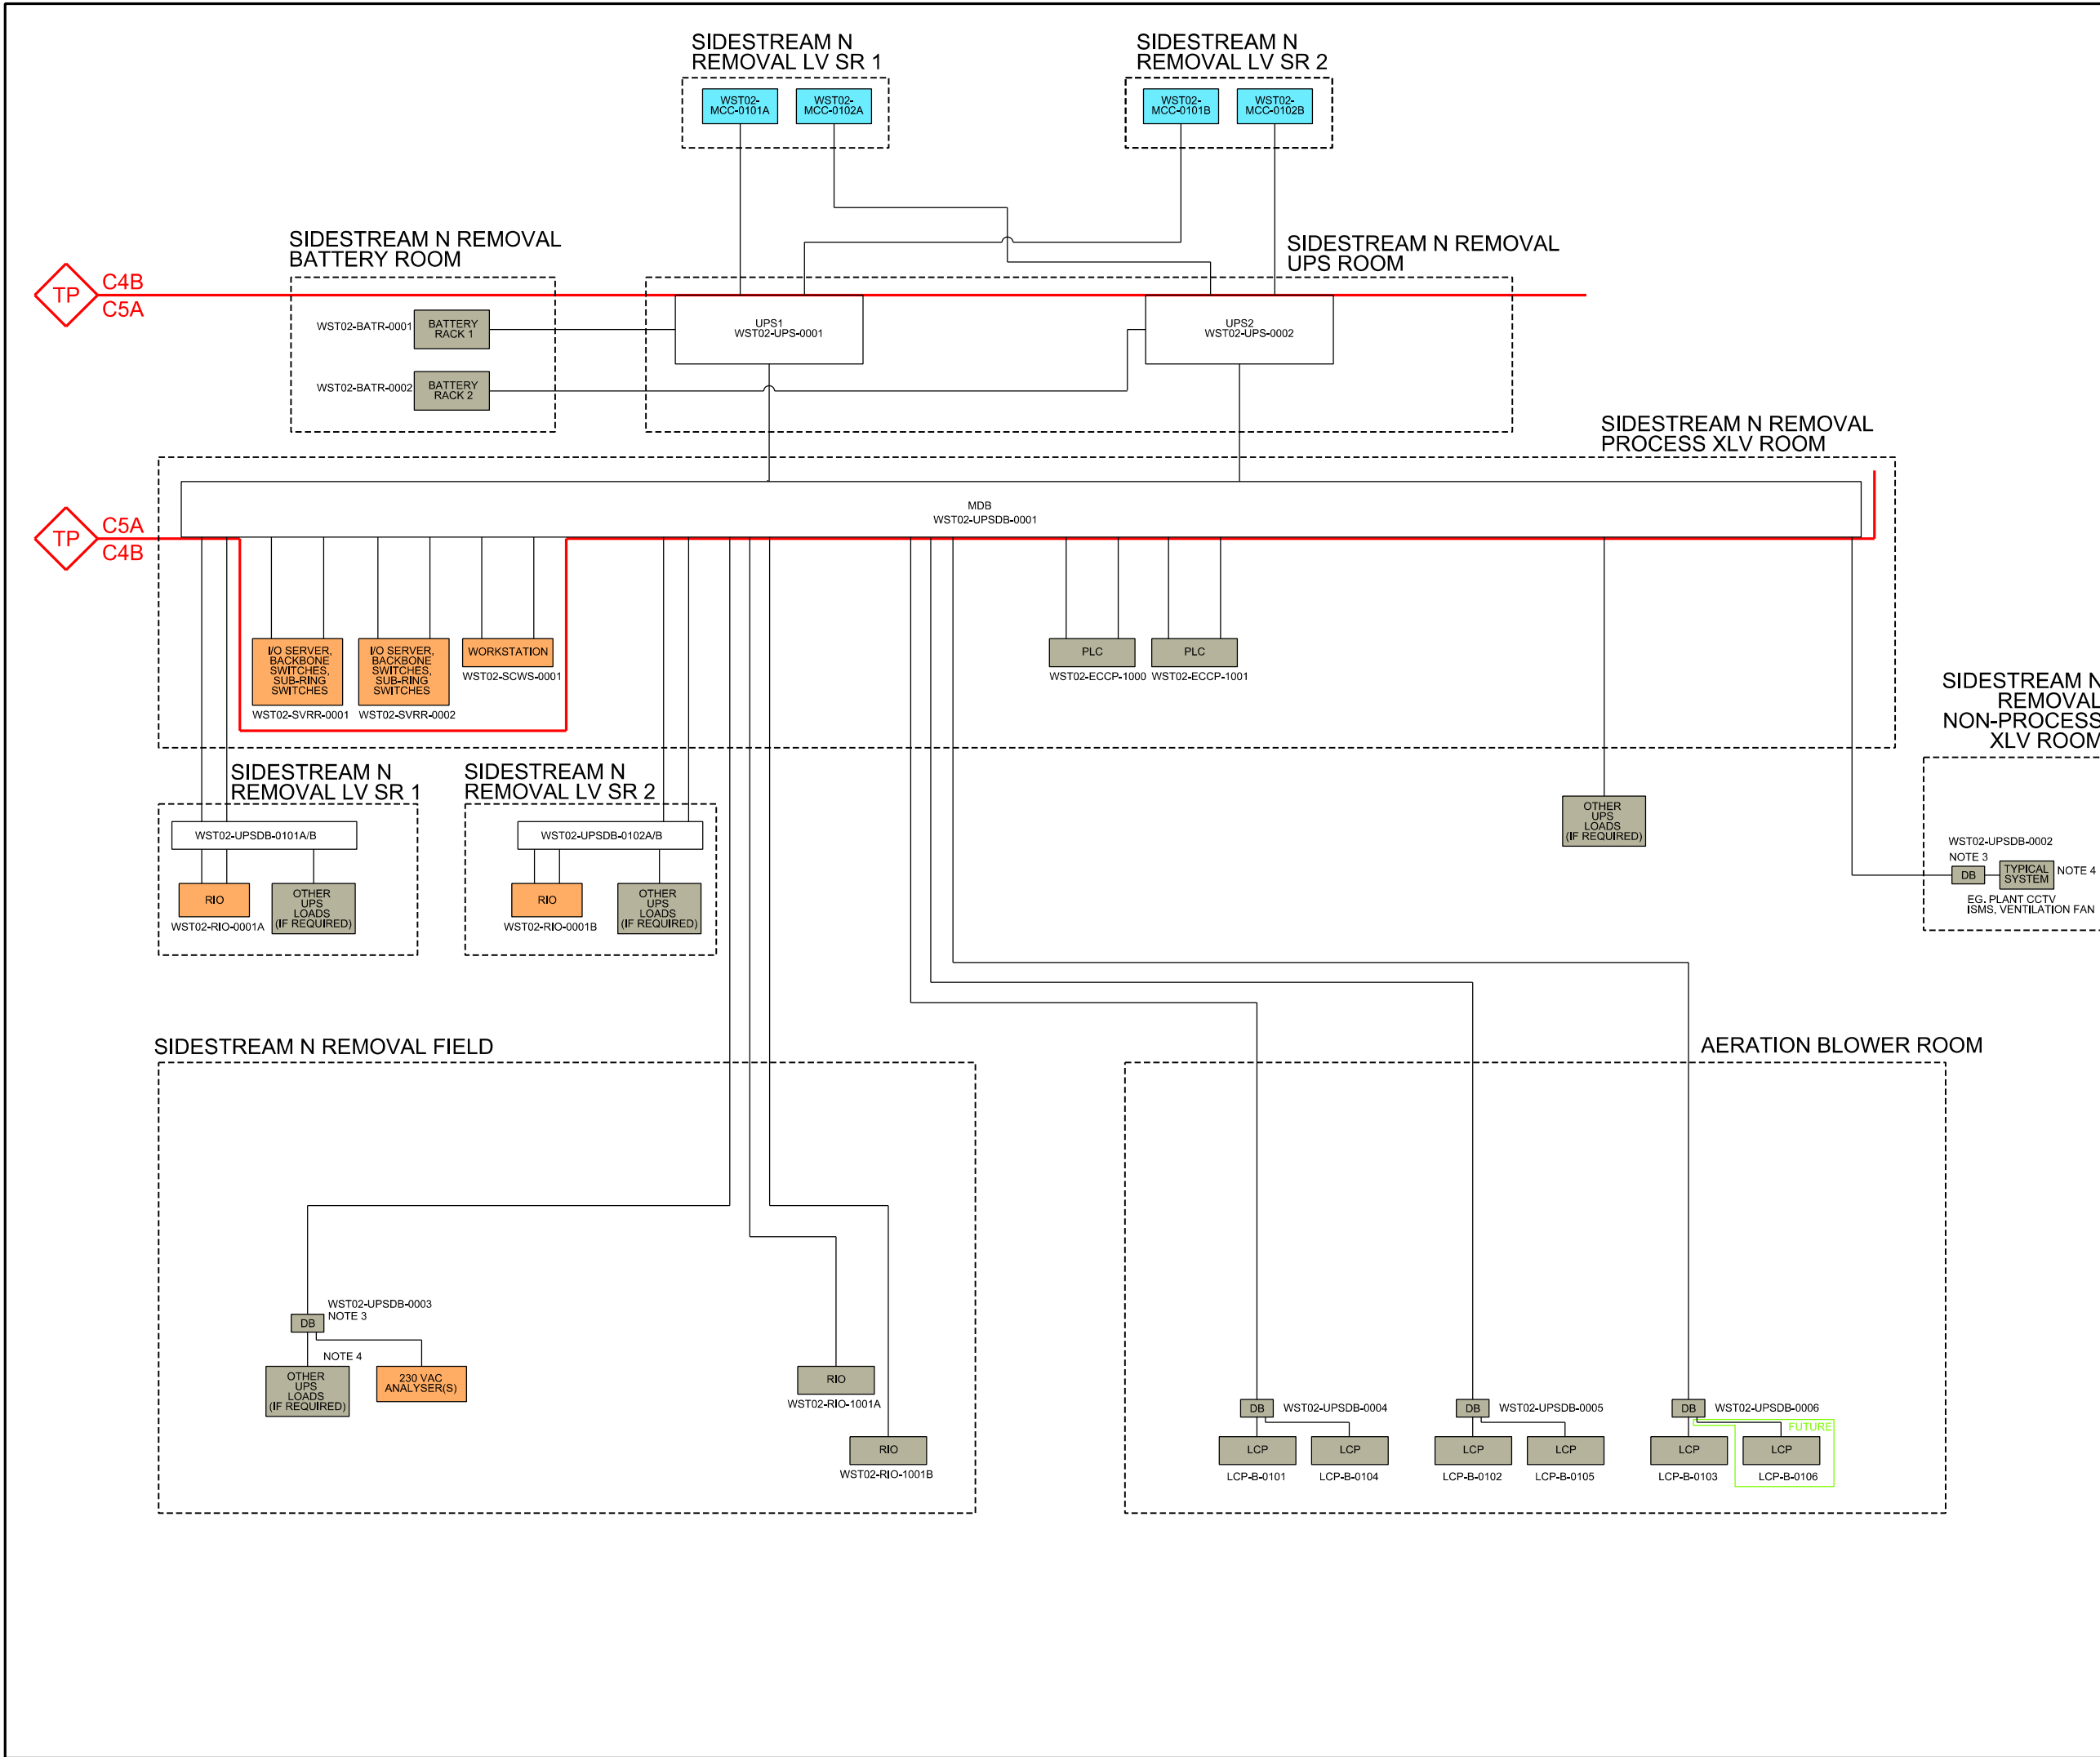

NOTES:

1. INCOMING POWER SUPPLY FROM MCC SHALL REFER TO ELECTRICAL SLD's.
2. UPS AND BATTERIES WILL BE PROVIDED BY C5A CONTRACTOR.
3. FIELD DBs W SHALL BE PROVIDED AT THE FIELD BY C4B AS REQUIRED BASED ON POWER REQUIREMENTS AND GEOGRAPHICAL LOCATION, FIELD DBs SHALL BE EITHER 3 PHASE OR 1 PHASE AS DETERMINED BY SPECIFIC LOAD REQUIREMENTS.
4. REFER TO BUILDING SERVICES SCHEMATIC AND SPECIFICATIONS P7 FOR EQUIPMENT/SYSTEM REQUIRES UPS- SUPPLIED.

TENDER

REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED
T1	20/05/22	ISSUED FOR TENDER C4B	JL	GOT

CLIENT:

PUB SINGAPORE'S NATIONAL WATER AGENCY

PROGRAMME MANAGER:

binnies AECOM A JOINT VENTURE DELIVERING THE DTSS2 PROJECT

CONSULTANT:

Jacobs CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP) DTSS PHASE 2

DRAWING TITLE:

POWER SUPPLY TO MCS AT SIDESTREAM N REMOVAL

DRAFTED:	DESIGNED:	SHEET SIZE:
PA	SK	A1
DRAFTING CHECK:	DESIGN CHECK:	SCALE:
RS	AT	NTS
DATE:	REVIEWED:	PBS:
20/05/22	JL	131101

CONTRACT:

C4B

DRAWING NUMBER:

PUB-DTSS2-TWRP

SHEET NUMBER:

WST02-I-7030

REVISION:

T1

THIS DRAWING IS COPYRIGHT