


TP C5A
C4B

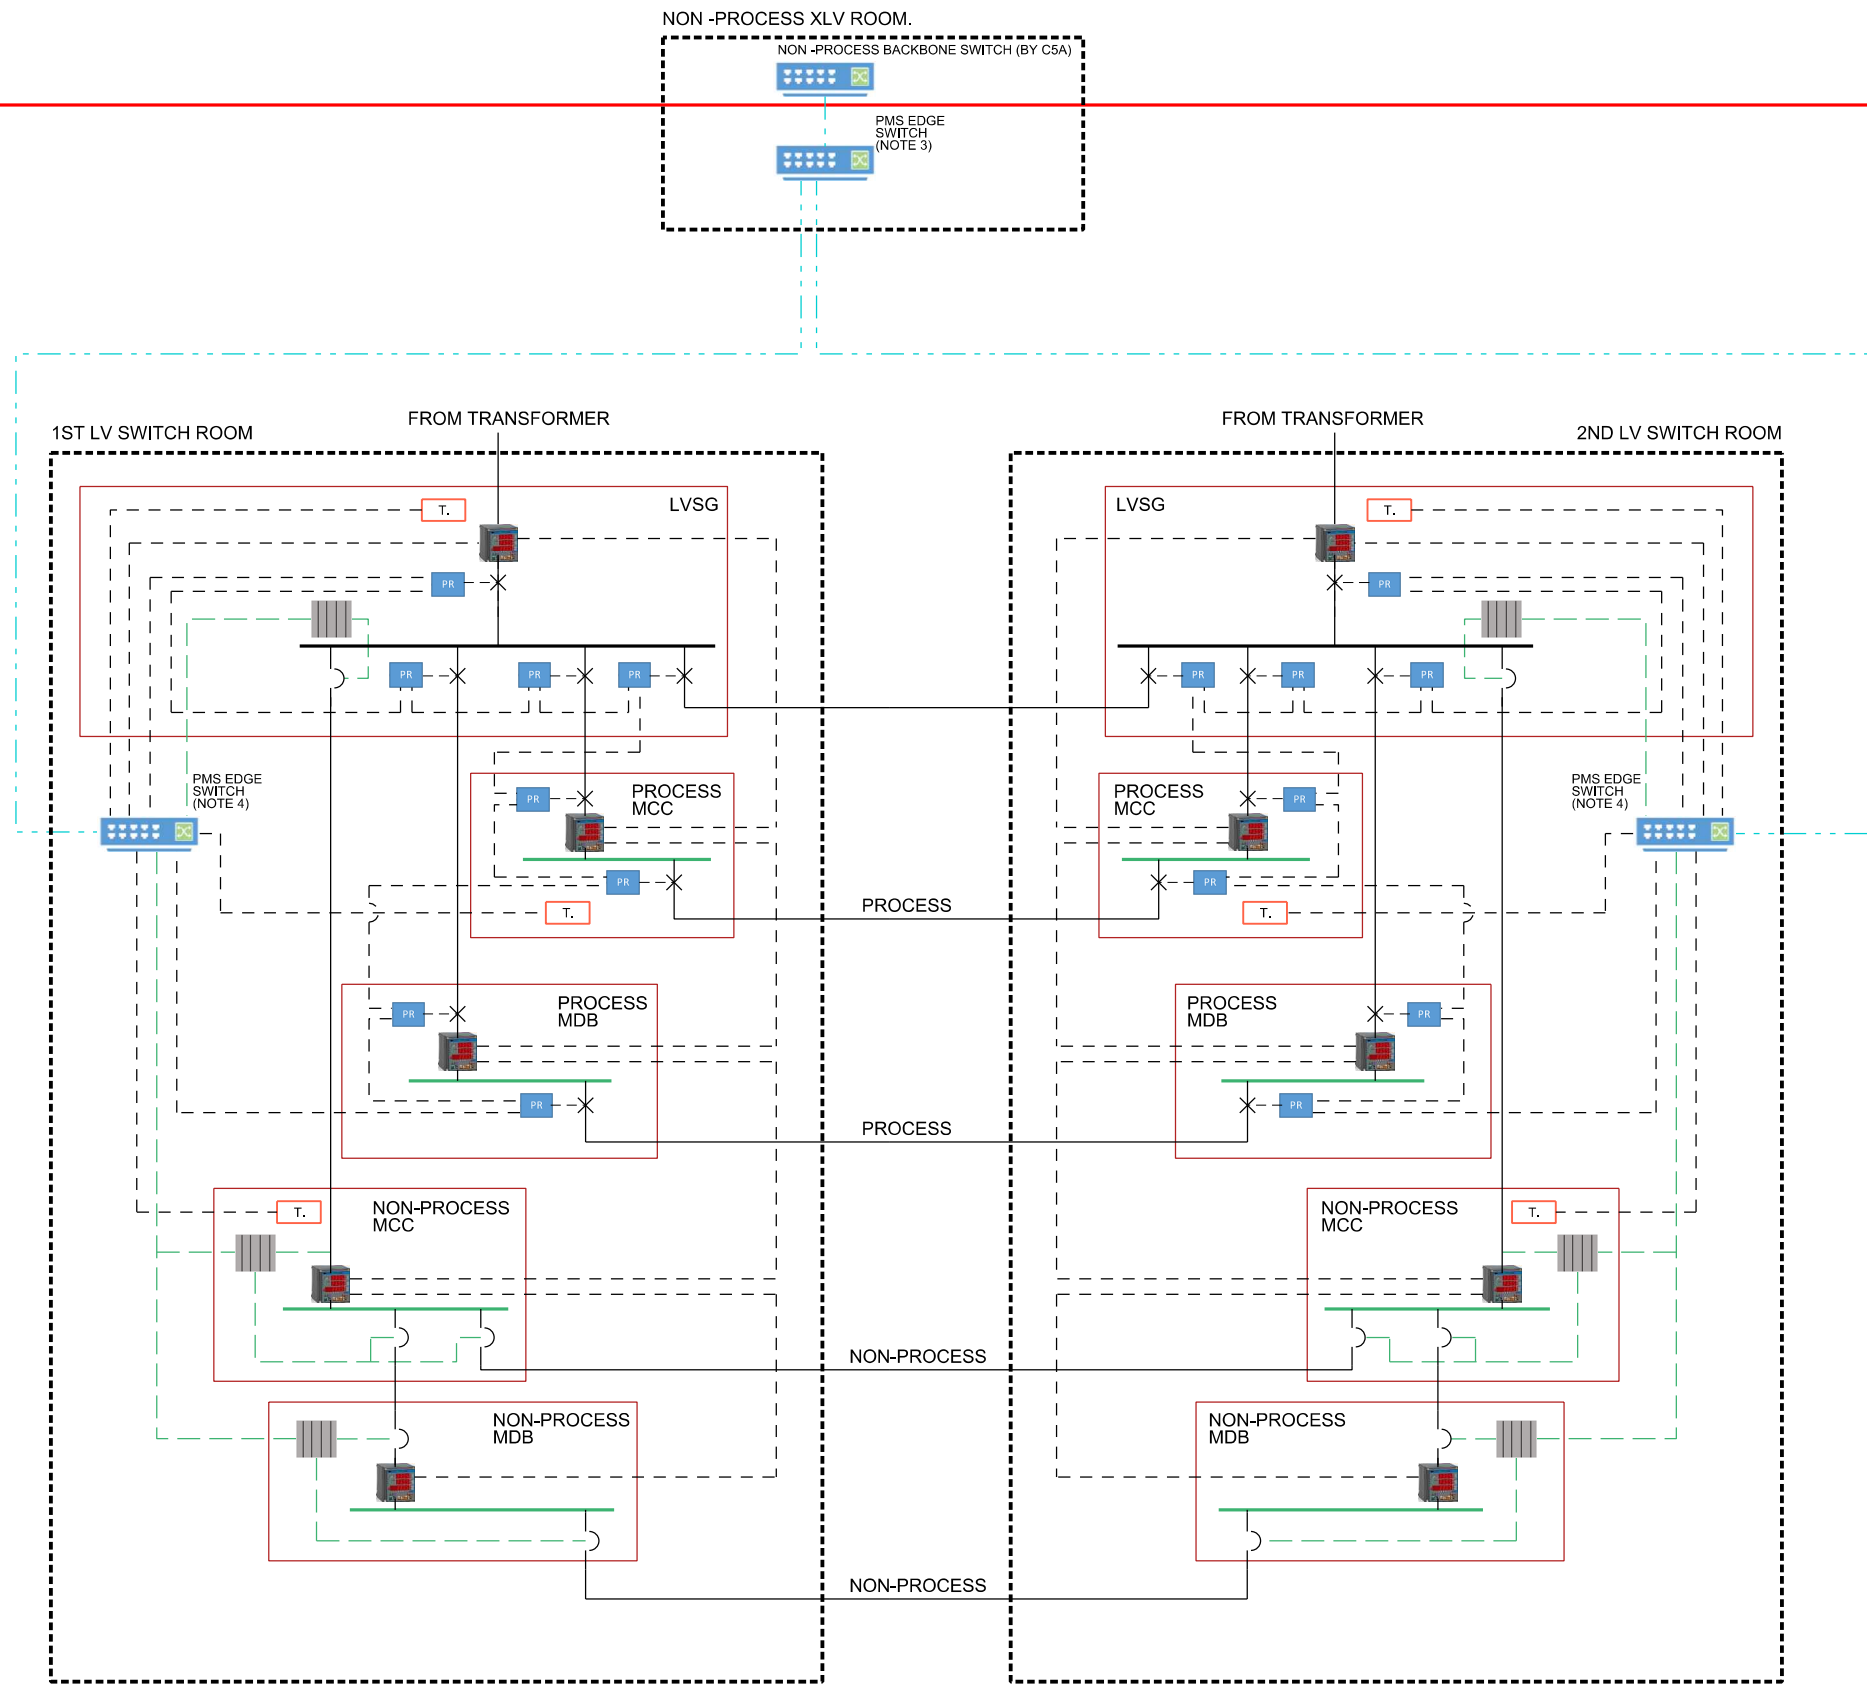

EQUIPMENT LEGEND:

PR	PROTECTION RELAY - TO PMS
X	ACB - ONLY MONITORING AT PMS, NO REMOTE SWITCHING
	MCCB - ONLY MONITORING AT PMS, NO REMOTE SWITCHING
	MODULAR I/O MODULE FOR PMS

CABLE LEGEND:

---	MULTI-MODE F/O CABLES - ETHERNET - TO PMS
---	COPPER CABLE - ETHERNET - TO PMS
---	SIGNAL CABLE - HARDWIRED - TO PMS

NOTES:

- ENERGY METERS AND PROTECTION RELAYS SHALL BE MONITORED BY PMS.
- SCHEMATIC ILLUSTRATES DESIGN INTENT FOR CONNECTION REQUIREMENTS, FOR ACTUAL QUANTITY OF ENERGY METERS, PROTECTION RELAYS AND CIRCUIT BREAKERS SHALL REFER TO ELECTRICAL DRAWINGS.
- MIN ONE (1) PMS EDGE SWITCH SHALL BE PROVIDED IN NON -PROCESS XLV ROOM FOR FACILITY AREA AT C4B CONTRACT TO CONNECT TO NON -PROCESS BACKBONE NETWORK.
- MIN ONE (1) PMS EDGE SWITCH (HOUSED IN A WALL MOUNTED PANEL OUTSIDE OF LVSG) SHALL BE PROVIDED IN EACH LV SWITCH ROOM.

TENDER

T1	20/05/22	ISSUED FOR TENDER C4B	JL	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

TYPICAL
PMS INTERFACE SCHEMATIC
- LOW VOLTAGE SWITCHBOARDS,
MCCS AND GENSET

DRAFTED: PA	DESIGNED: SK	SHEET SIZE: A1
DRAFTING CHECK: RS	DESIGN CHECK: AT	SCALE: N/A
DATE: 20/05/22	REVIEWED: JL	PBS: 131101
CONTRACT: C4B	DRAWING NUMBER: PUB-DTSS2-TWRP	REVISION: T1

THIS DRAWING IS COPYRIGHT