


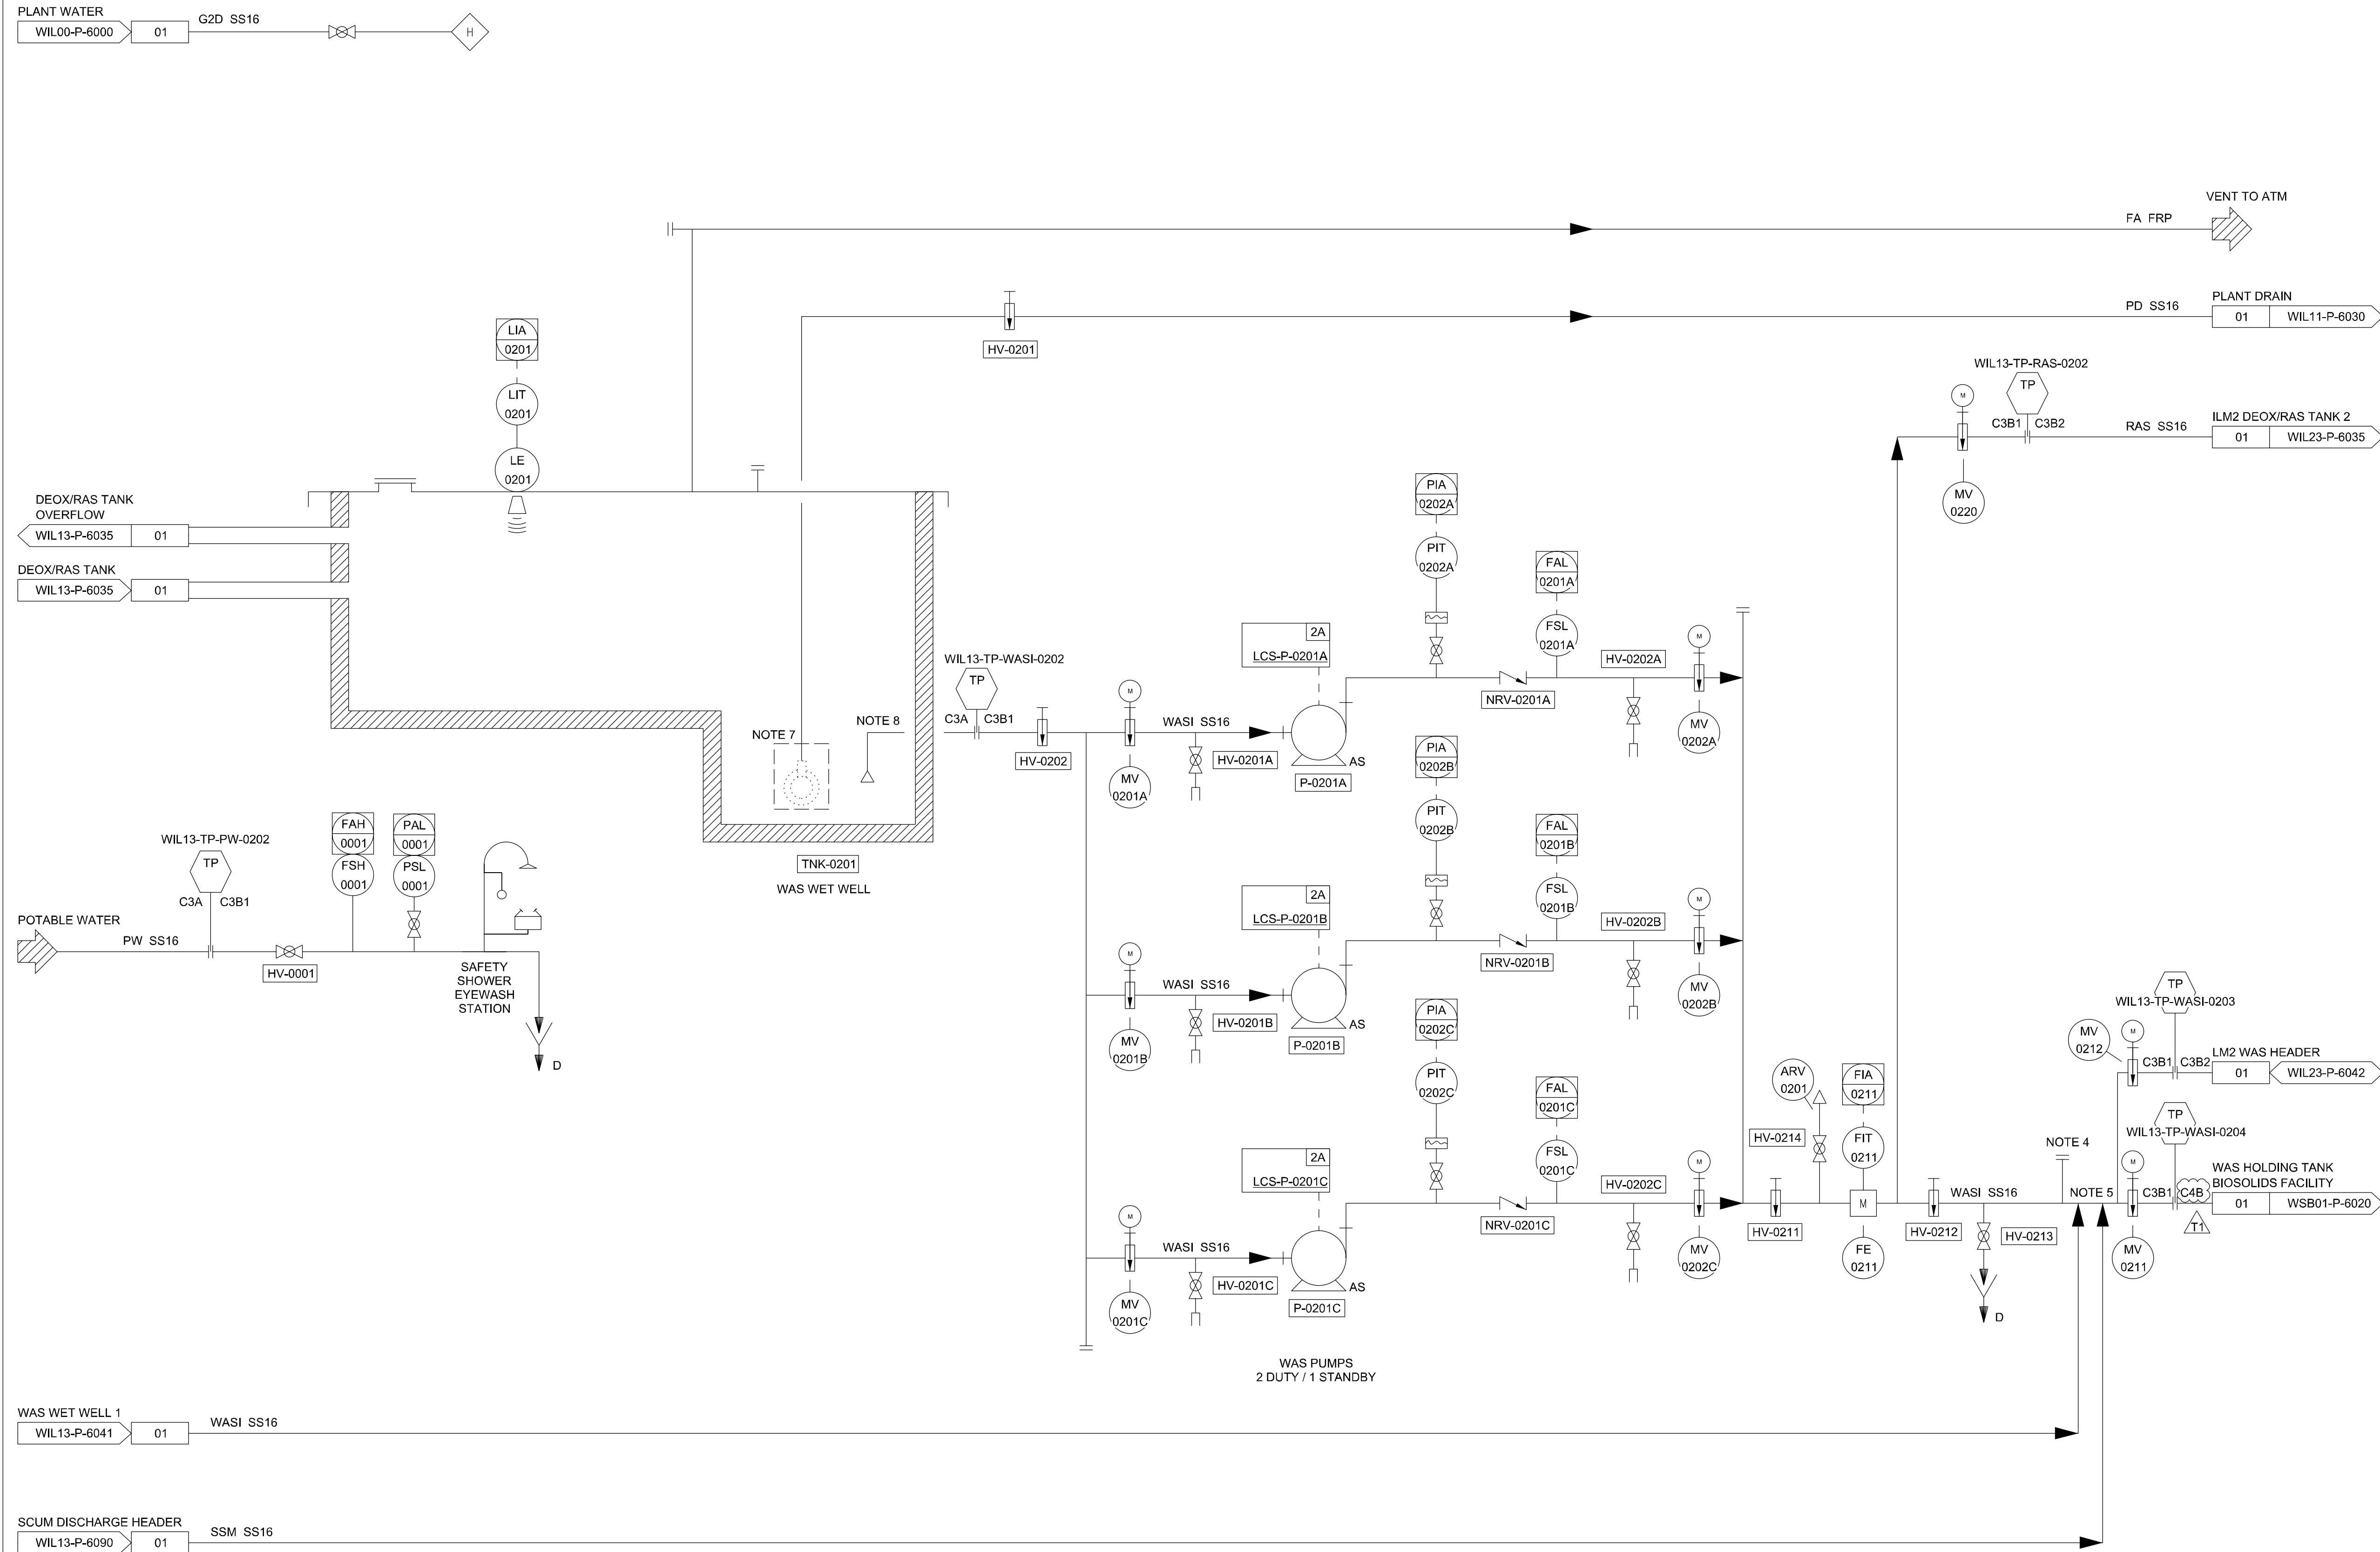

PROCESS UNIT
048

- NOTES:
1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 2. THE CONTRACTOR SHALL PROVIDE THE PIPE / DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 4. JETTING AND RODDING POINTS SHOWN ARE INDICATIVE. CONTRACTOR TO PROVIDE AT NECESSARY LOCATIONS BASED ON ACTUAL PIPE ROUTING.
 5. Y-JOINT TO BE PROVIDED.
 6. DRAINAGE PUMPS ARE PORTABLE TYPE AND ARE NOT INSTALLED. ALL PIPEWORK, GUIDERAILS, DAVIT AND ELECTRICAL SCKET TO BE INSTALLED.
 7. DRAINAGE PUMP NOT INSTALLED. TO BE KEPT IN WAREHOUSE.
 8. DOWNWARD FACING BELLMOUTH TO BE PROVIDED.

TENDER

REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED
T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
T1	17/07/20	ISSUED FOR TENDER C3B1	CN	GOT
T1	24/04/20	ISSUED FOR TENDER C3A	CN	GOT



PROGRAMME MANAGER:

Jacobs
CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

P&ID
WAS PUMPING NO. 2

DRAFTED: BL	DESIGNED: KT	SHEET SIZE: A1
DRAFTING CHECK: DW	DESIGN CHECK: RM	SCALE: NTS
DATE: 08/02/18	REVIEWED: CN	PBS: 131101
CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP WIL13-P-6042	REVISION: T1

THIS DRAWING IS COPYRIGHT