


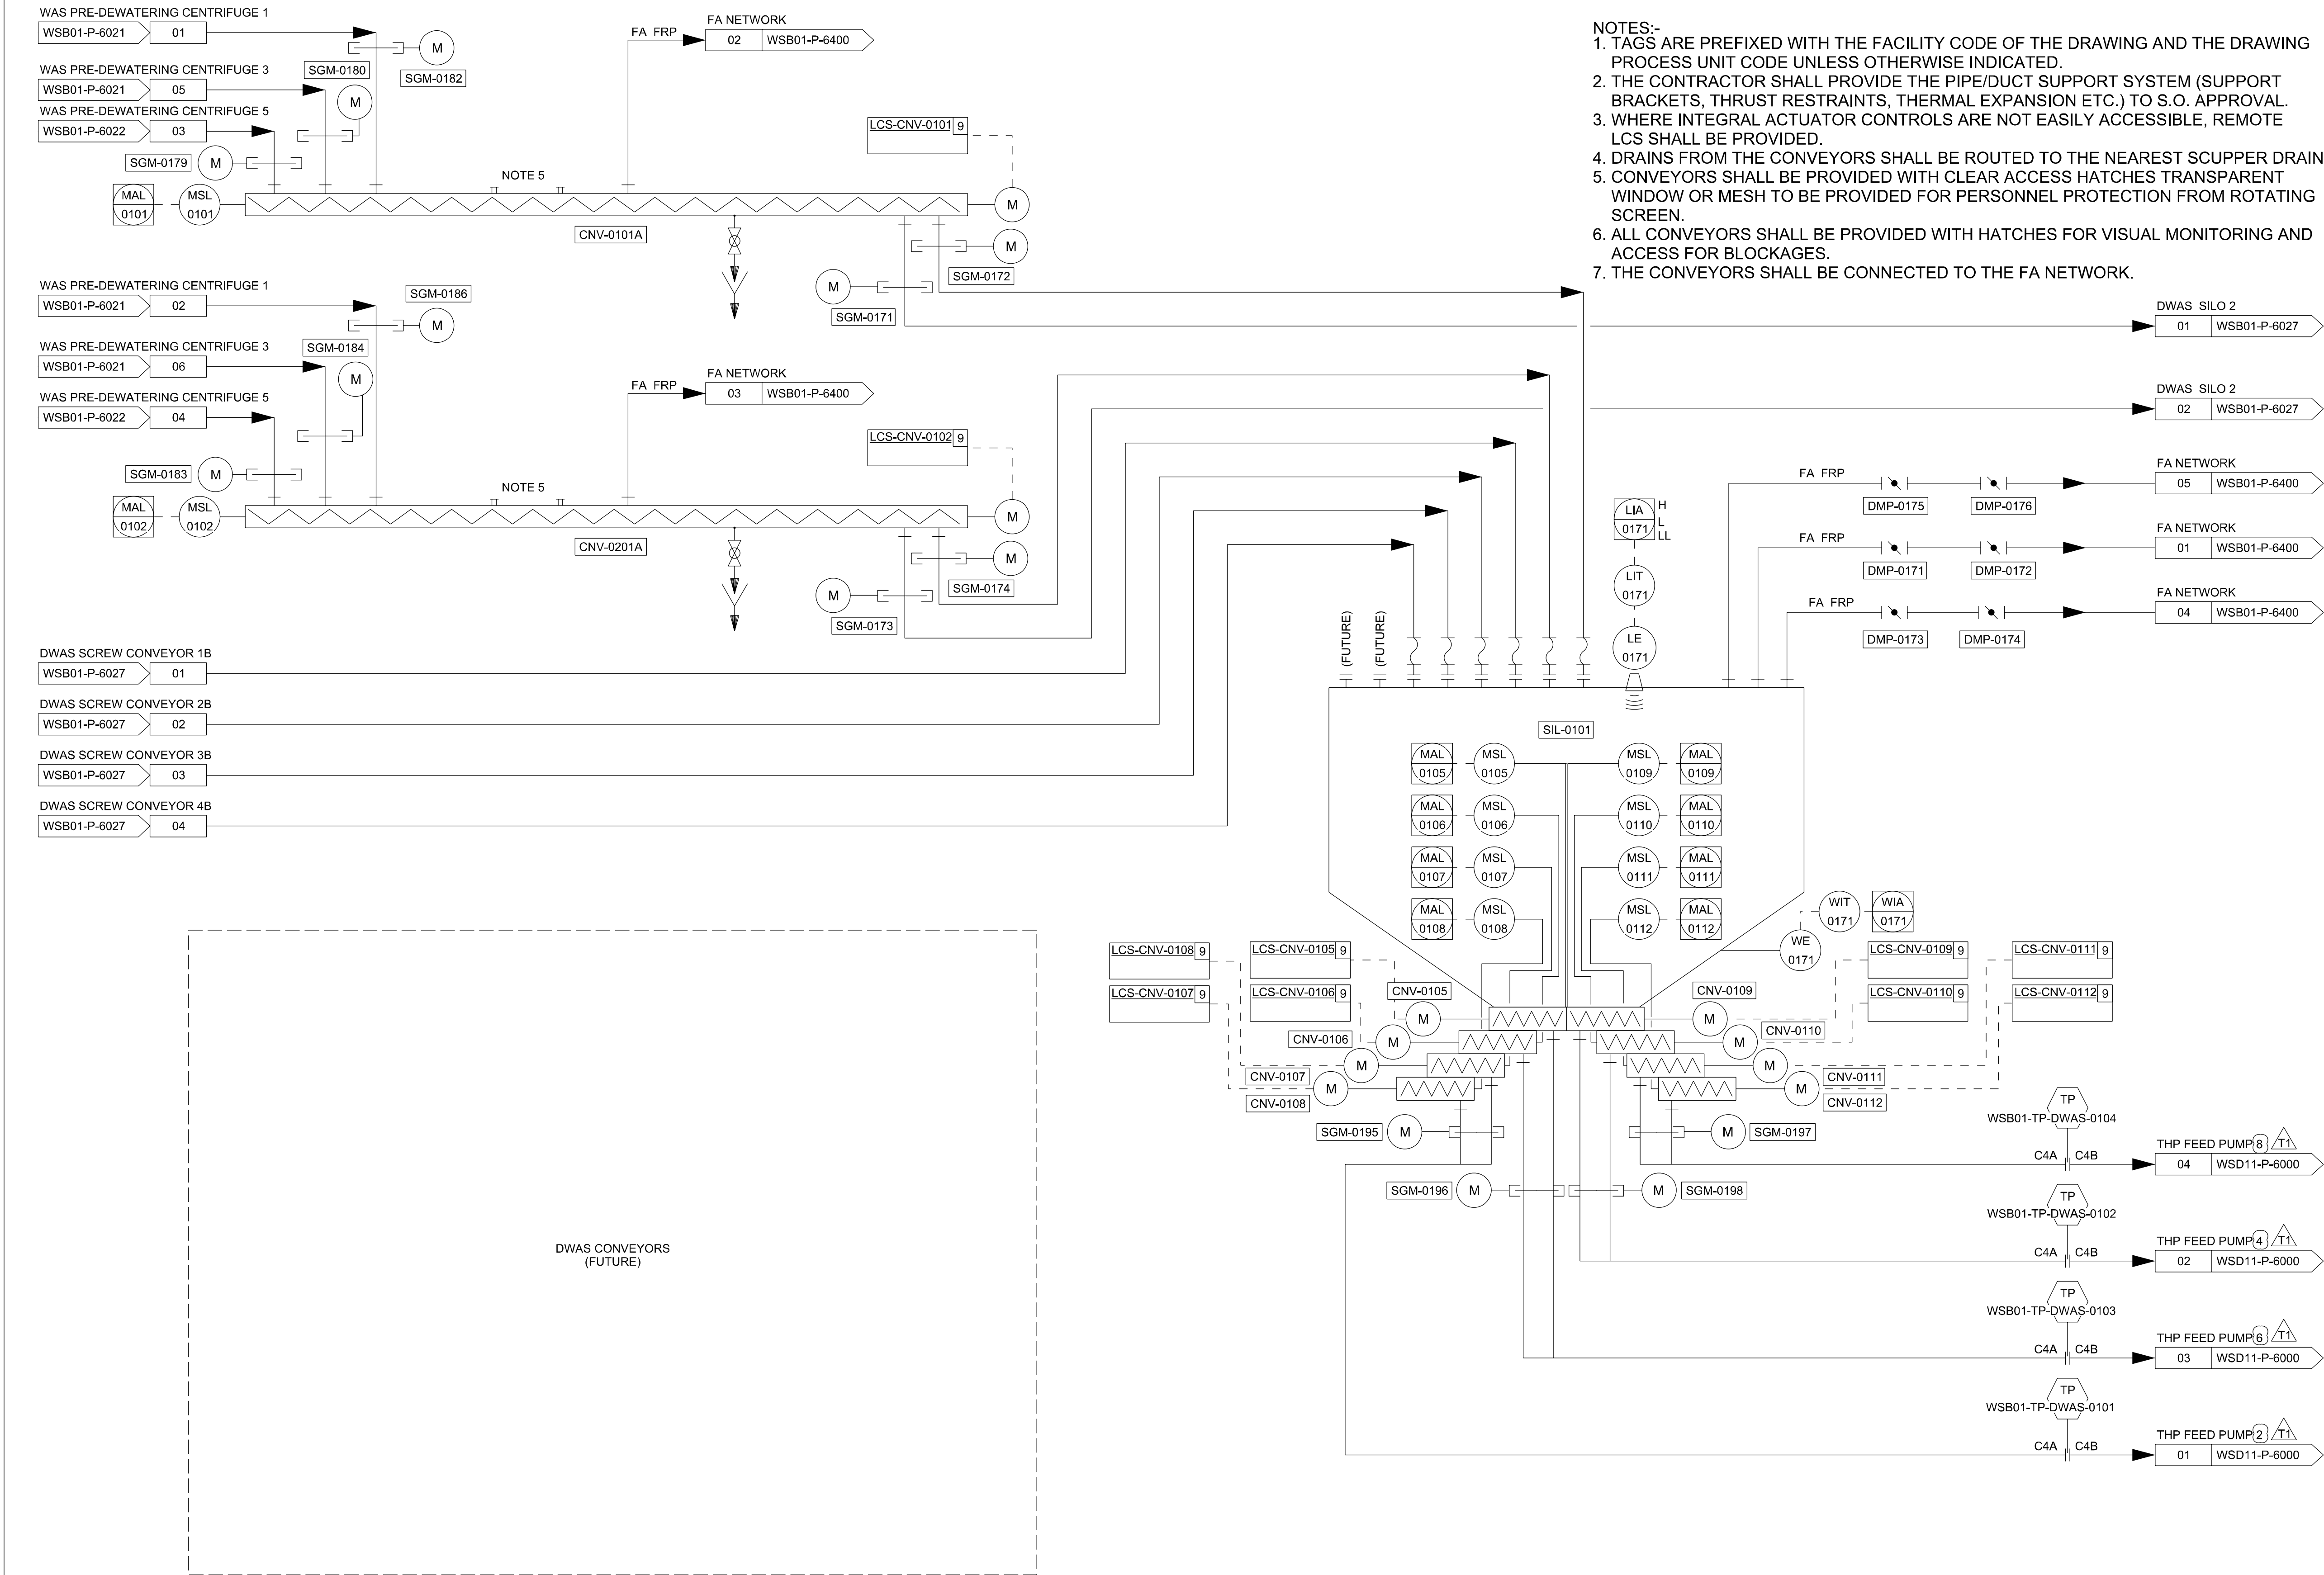

- NOTES:-
1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 2. THE CONTRACTOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 4. DRAINS FROM THE CONVEYORS SHALL BE ROUTED TO THE NEAREST SCUPPER DRAIN.
 5. CONVEYORS SHALL BE PROVIDED WITH CLEAR ACCESS HATCHES TRANSPARENT WINDOW OR MESH TO BE PROVIDED FOR PERSONNEL PROTECTION FROM ROTATING SCREEN.
 6. ALL CONVEYORS SHALL BE PROVIDED WITH HATCHES FOR VISUAL MONITORING AND ACCESS FOR BLOCKAGES.
 7. THE CONVEYORS SHALL BE CONNECTED TO THE FA NETWORK.


TENDER

T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
T2	23/09/19	ISSUED FOR ADDENDUM 1	CN	GOT
T1	23/08/19	ISSUED FOR TENDER C4A	CN	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:

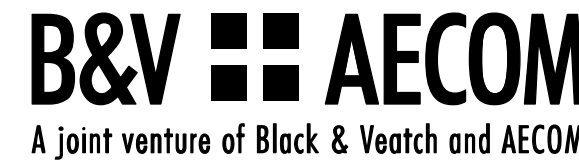

CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

P&ID
DWAS SILO 1 & FEED CONVEYORS

DRAFTED: PS	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101

CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP
-	SHEET NUMBER: WSB01-P-6026
	REVISION: T1

THIS DRAWING IS COPYRIGHT