


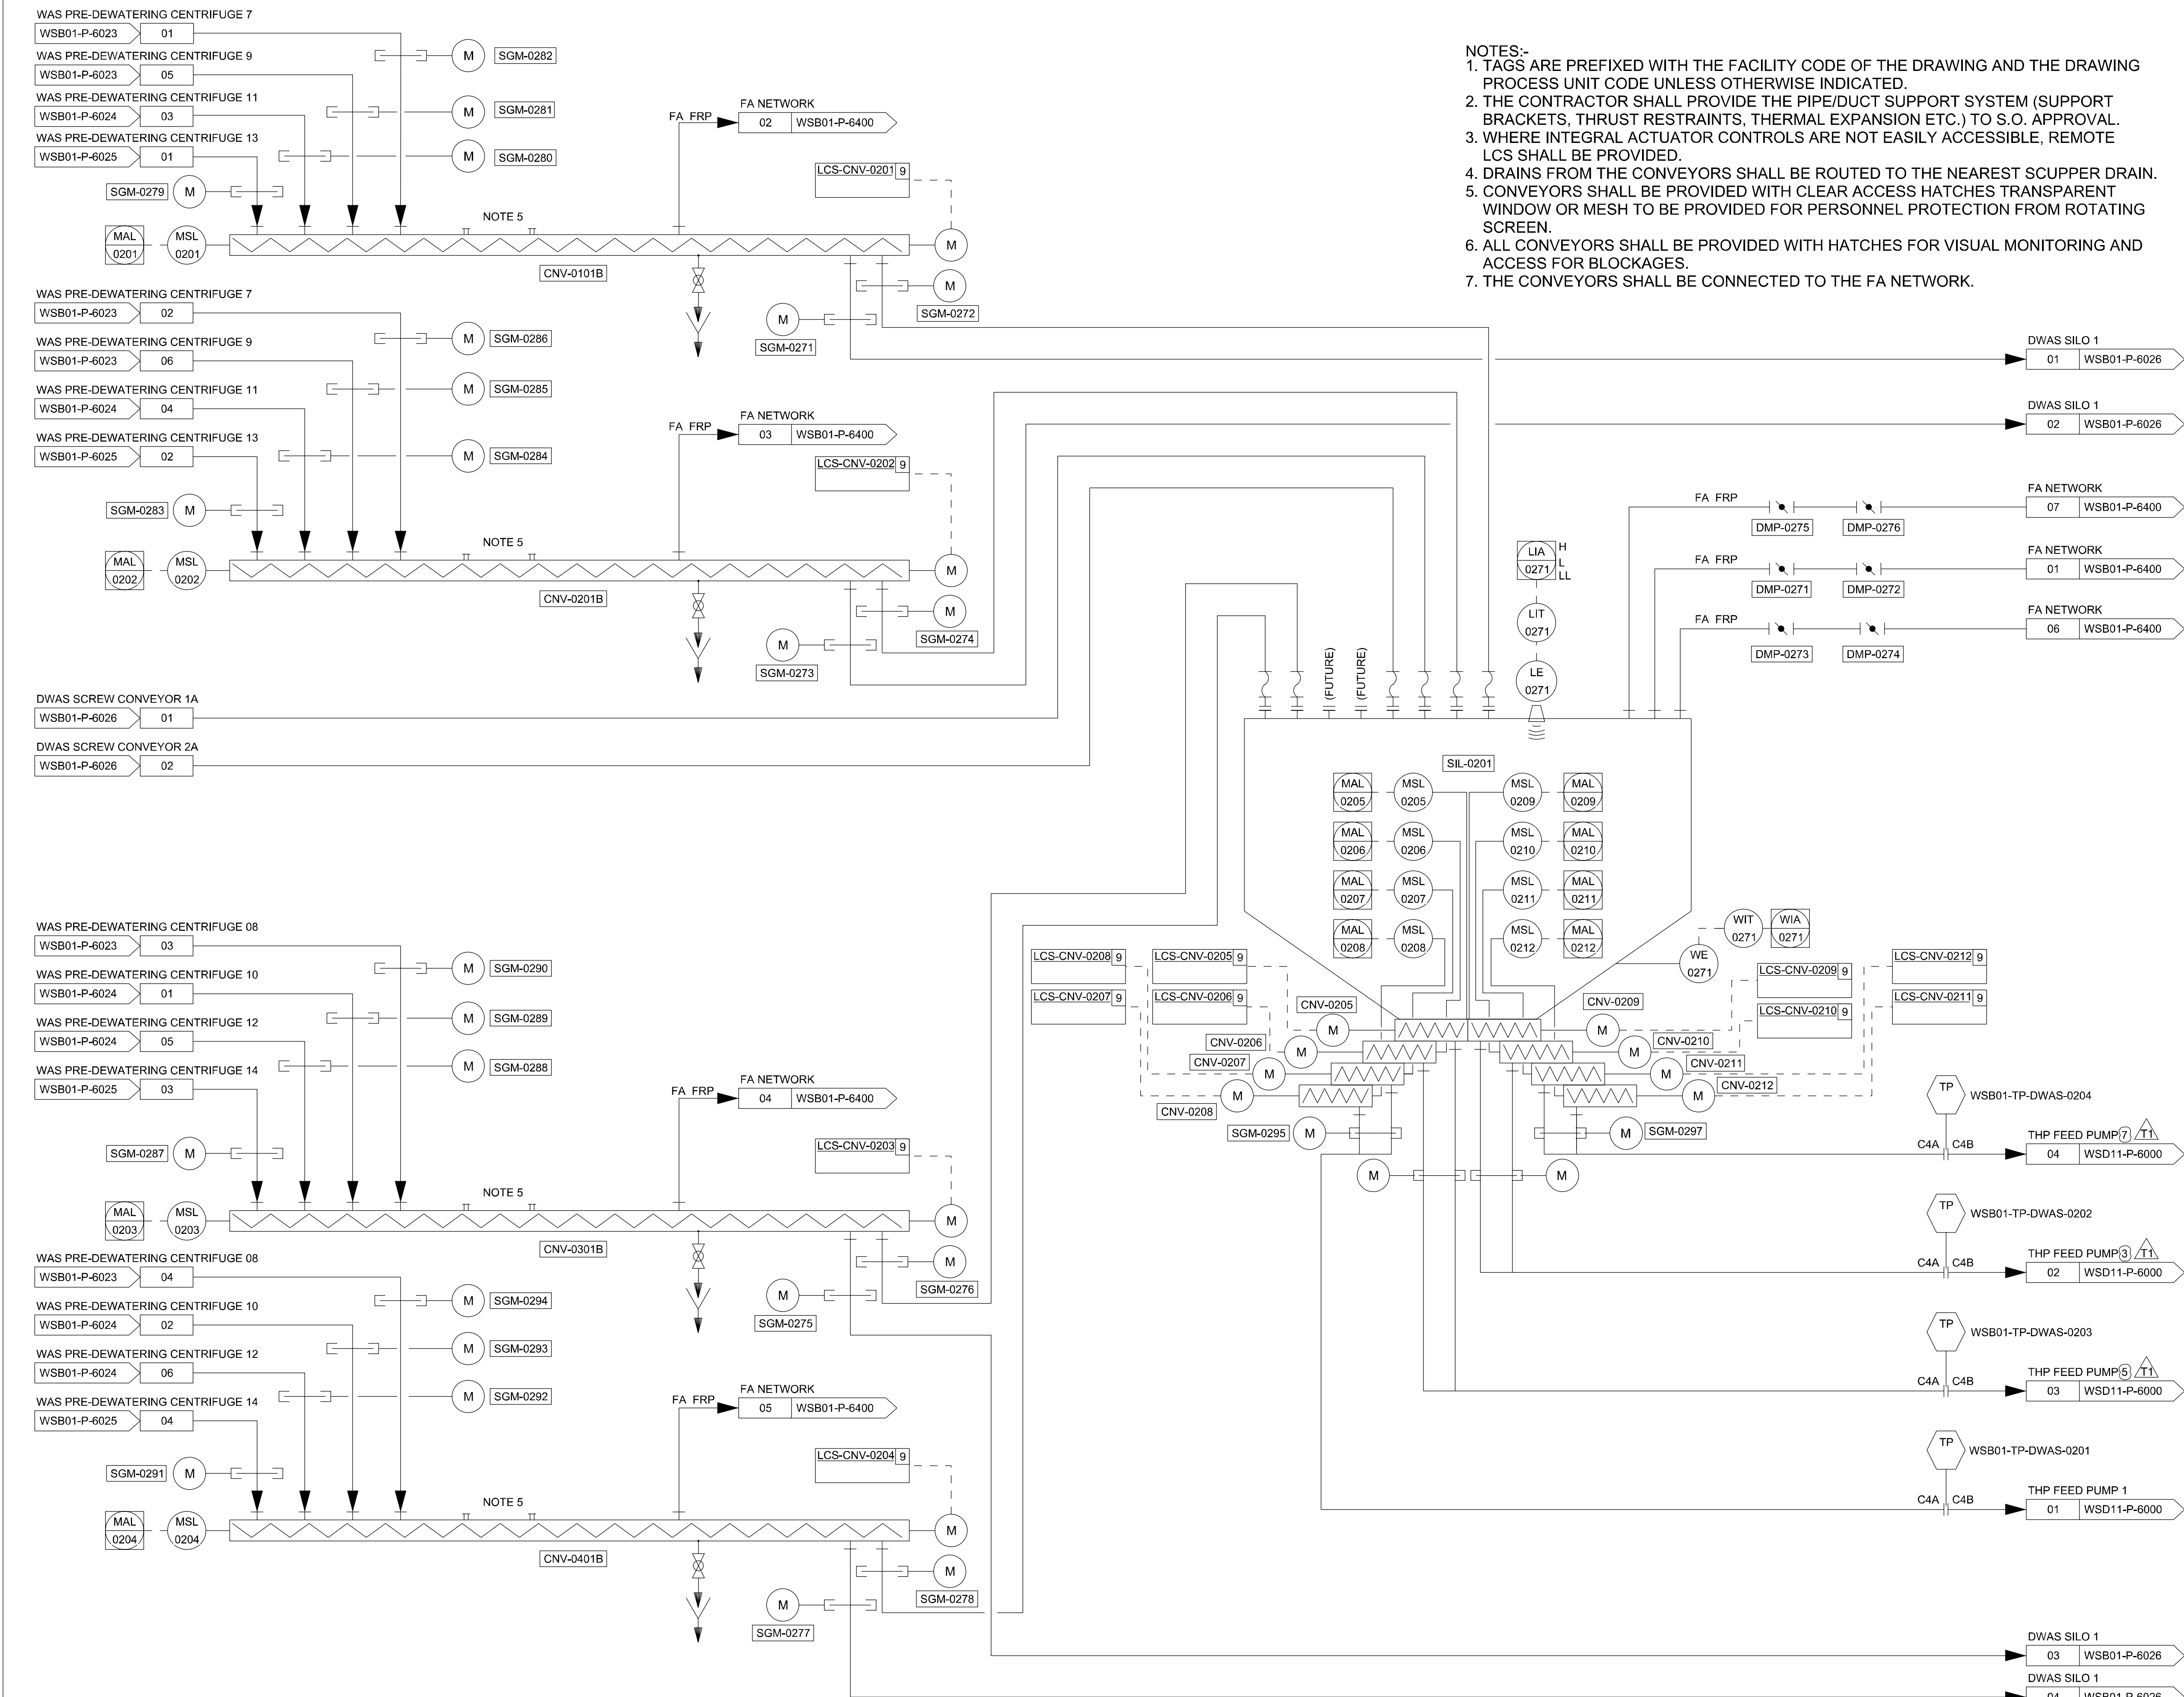

- NOTES:-
1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 2. THE CONTRACTOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 4. DRAINS FROM THE CONVEYORS SHALL BE ROUTED TO THE NEAREST SCUPPER DRAIN.
 5. CONVEYORS SHALL BE PROVIDED WITH CLEAR ACCESS HATCHES TRANSPARENT WINDOW OR MESH TO BE PROVIDED FOR PERSONNEL PROTECTION FROM ROTATING SCREEN.
 6. ALL CONVEYORS SHALL BE PROVIDED WITH HATCHES FOR VISUAL MONITORING AND ACCESS FOR BLOCKAGES.
 7. THE CONVEYORS SHALL BE CONNECTED TO THE FA NETWORK.

PROCESS UNIT
102

DWAS SILO FEED CONVEYORS

DWAS SILO

TENDER

REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED
T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
T2	23/09/19	ISSUED FOR ADDENDUM 1	CN	GOT
T1	23/08/19	ISSUED FOR TENDER C4A	CN	GOT

CLIENT:



PROGRAMME MANAGER:
B&V AECOM
A joint venture of Black & Veatch and AECOM

CONSULTANT:
JACOBS
CH2M HILL Singapore Pte Ltd

PROJECT TITLE:
**TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2**

DRAWING TITLE
**P&ID
DWAS SILO 2 & FEED CONVEYORS**

DRAFTED: PS	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101
CONTRACT: -	DRAWING NUMBER: PUB-DTSS2-TWRP SHEET NUMBER: WSB01-P-6027	REVISION: T1

THIS DRAWING IS COPYRIGHT