


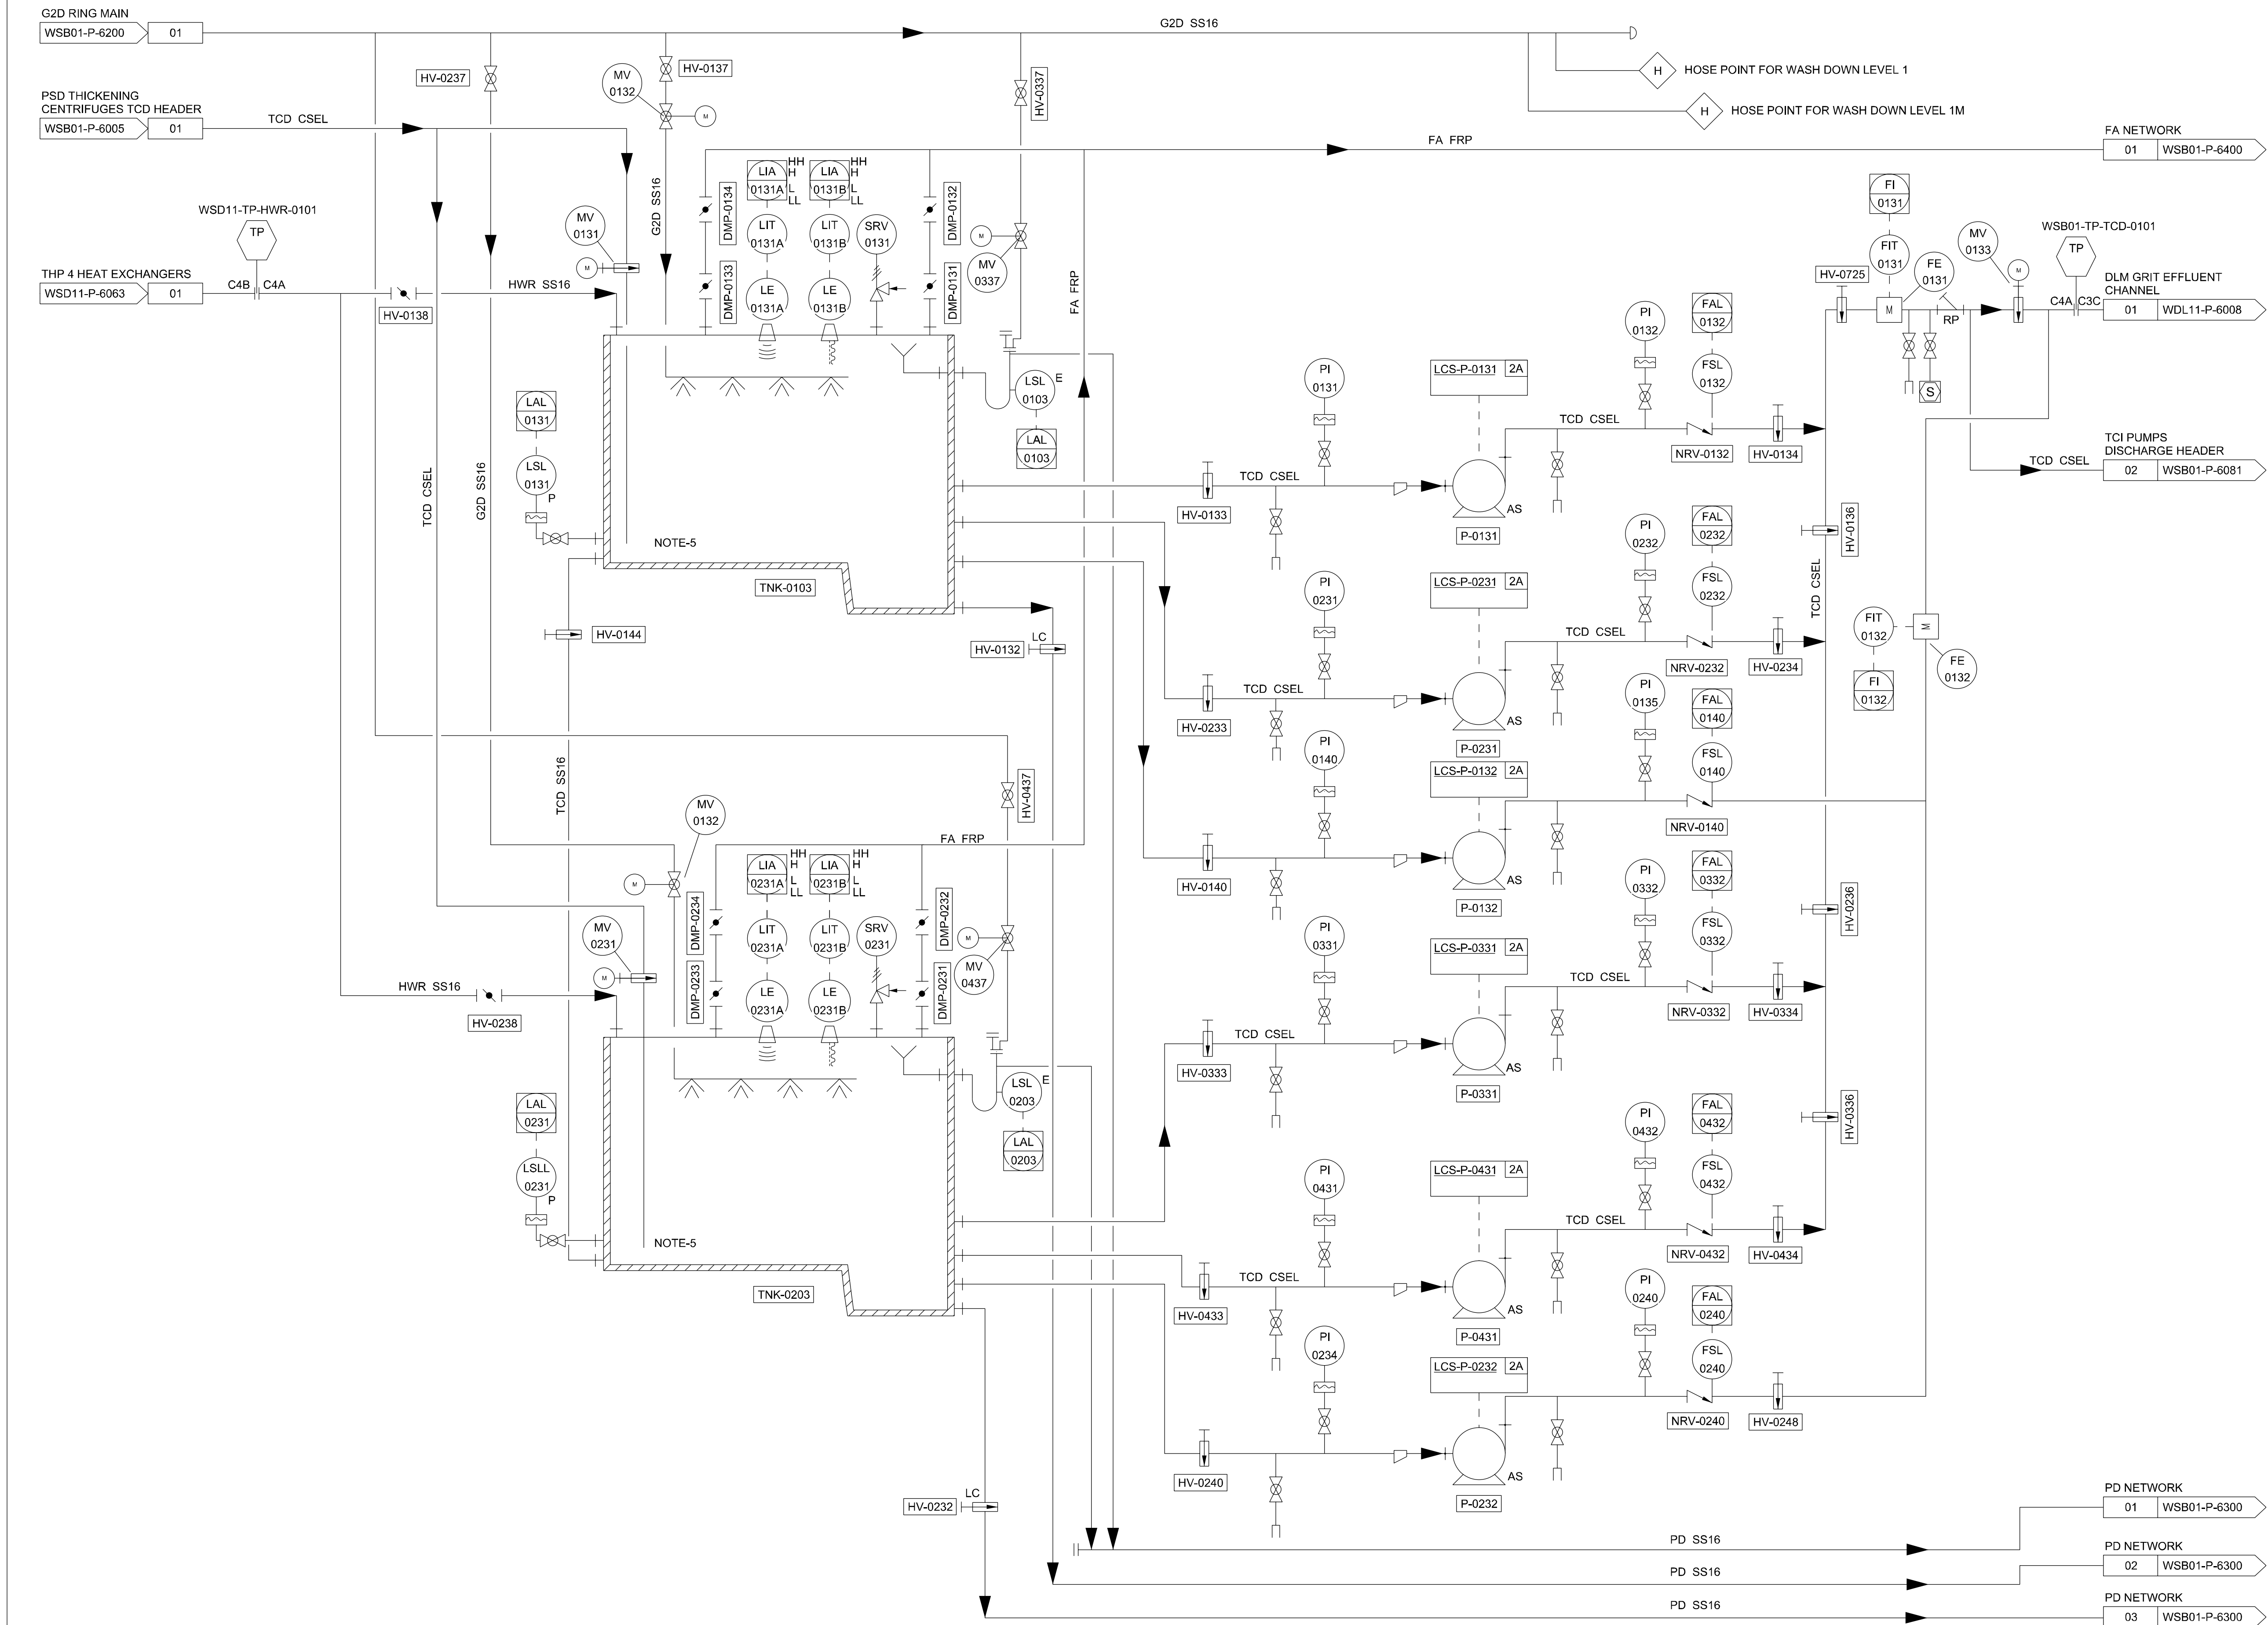

PROCESS UNIT

101

TCD WET WELL
(2 DUTY)

TCD DLM PUMPS
(1 DUTY, 1 STANDBY)

TCD PUMPS
(2 DUTY, 1 STANDBY, 1 MAINTENANCE)

NOTES:-

1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
2. THE CONTRACTOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
4. ADEQUATE RODDING POINTS AND FLUSHING POINTS SHALL TO PROVIDED BASED ON THE PIPE ROUTING.
5. WEAR PLATES SHALL BE EMBEDDED IN THE TANK FLOOR BELOW THE DROPPER PIPE

TENDER

T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
T1	23/08/19	ISSUED FOR TENDER C4A	CN	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED



PROGRAMME MANAGER:

B&V AECOM

A joint venture of Black & Veatch and AECOM

CONSULTANT:

JACOBS

CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

P&ID
TCD WETWELL AND PUMPS

DRAFTED: PS	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101

CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP
SHEET NUMBER: WSB01-P-6080	REVISION: T1

THIS DRAWING IS COPYRIGHT