


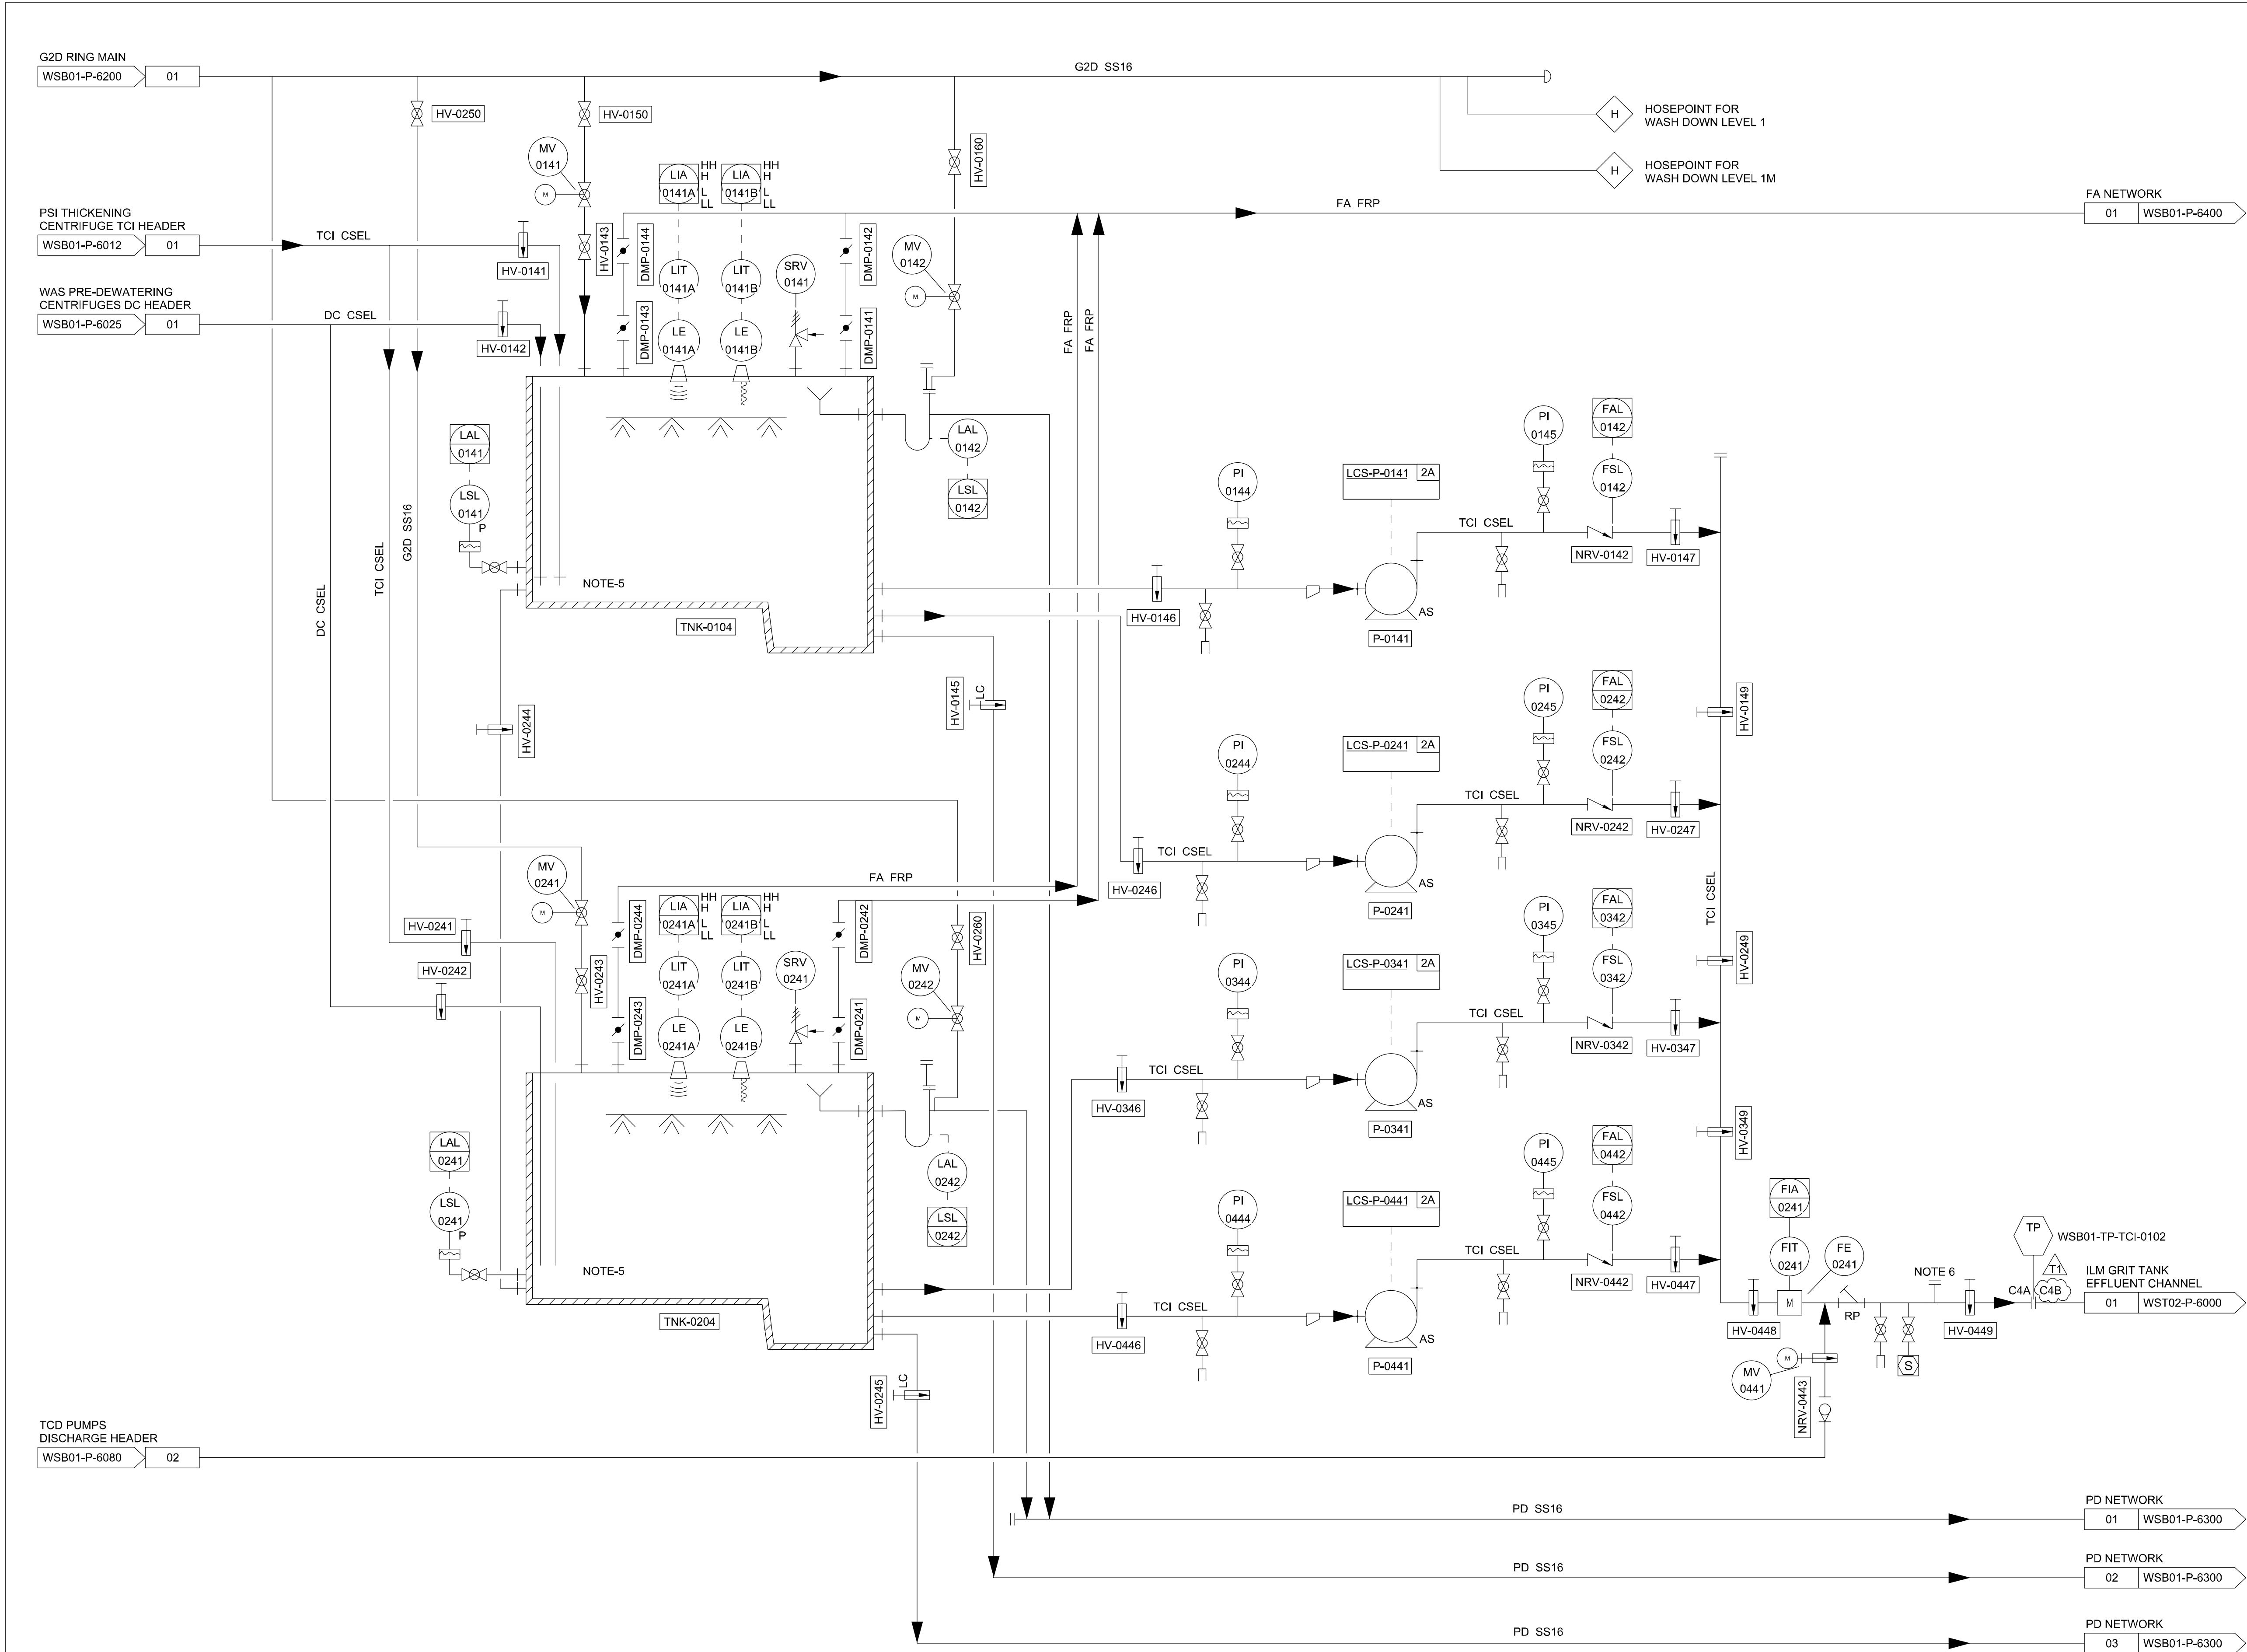

PROCESS UNIT
101

TCI WET WELL
(2 DUTY)

TCI PUMPS
(2 DUTY, 1 STANDBY, 1 MAINTENANCE)

- NOTES:-
1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 2. THE CONTRACTOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 4. ADEQUATE RODDING POINTS AND FLUSHING POINTS SHALL TO PROVIDED BASED ON THE PIPE ROUTING.
 5. WEAR PLATES SHALL BE EMBEDDED IN THE TANK FLOOR BELOW THE DROPPER PIPE.
 6. CONNECTION FOR TEMPORARY PIPELINE DURING INTERIM OPERATIONS.

TENDER

T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
T1	23/08/19	ISSUED FOR TENDER C4A	CN	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:

PROGRAMME MANAGER:

A joint venture of Black & Veatch and AECOM

CONSULTANT:

CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

P&ID
TCI WETWELL AND PUMPS

DRAFTED: PS	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101

CONTRACT:

DRAWING NUMBER:

PUB-DTSS2-TWRP

SHEET NUMBER:
WSB01-P-6081

REVISION:
T1

THIS DRAWING IS COPYRIGHT