


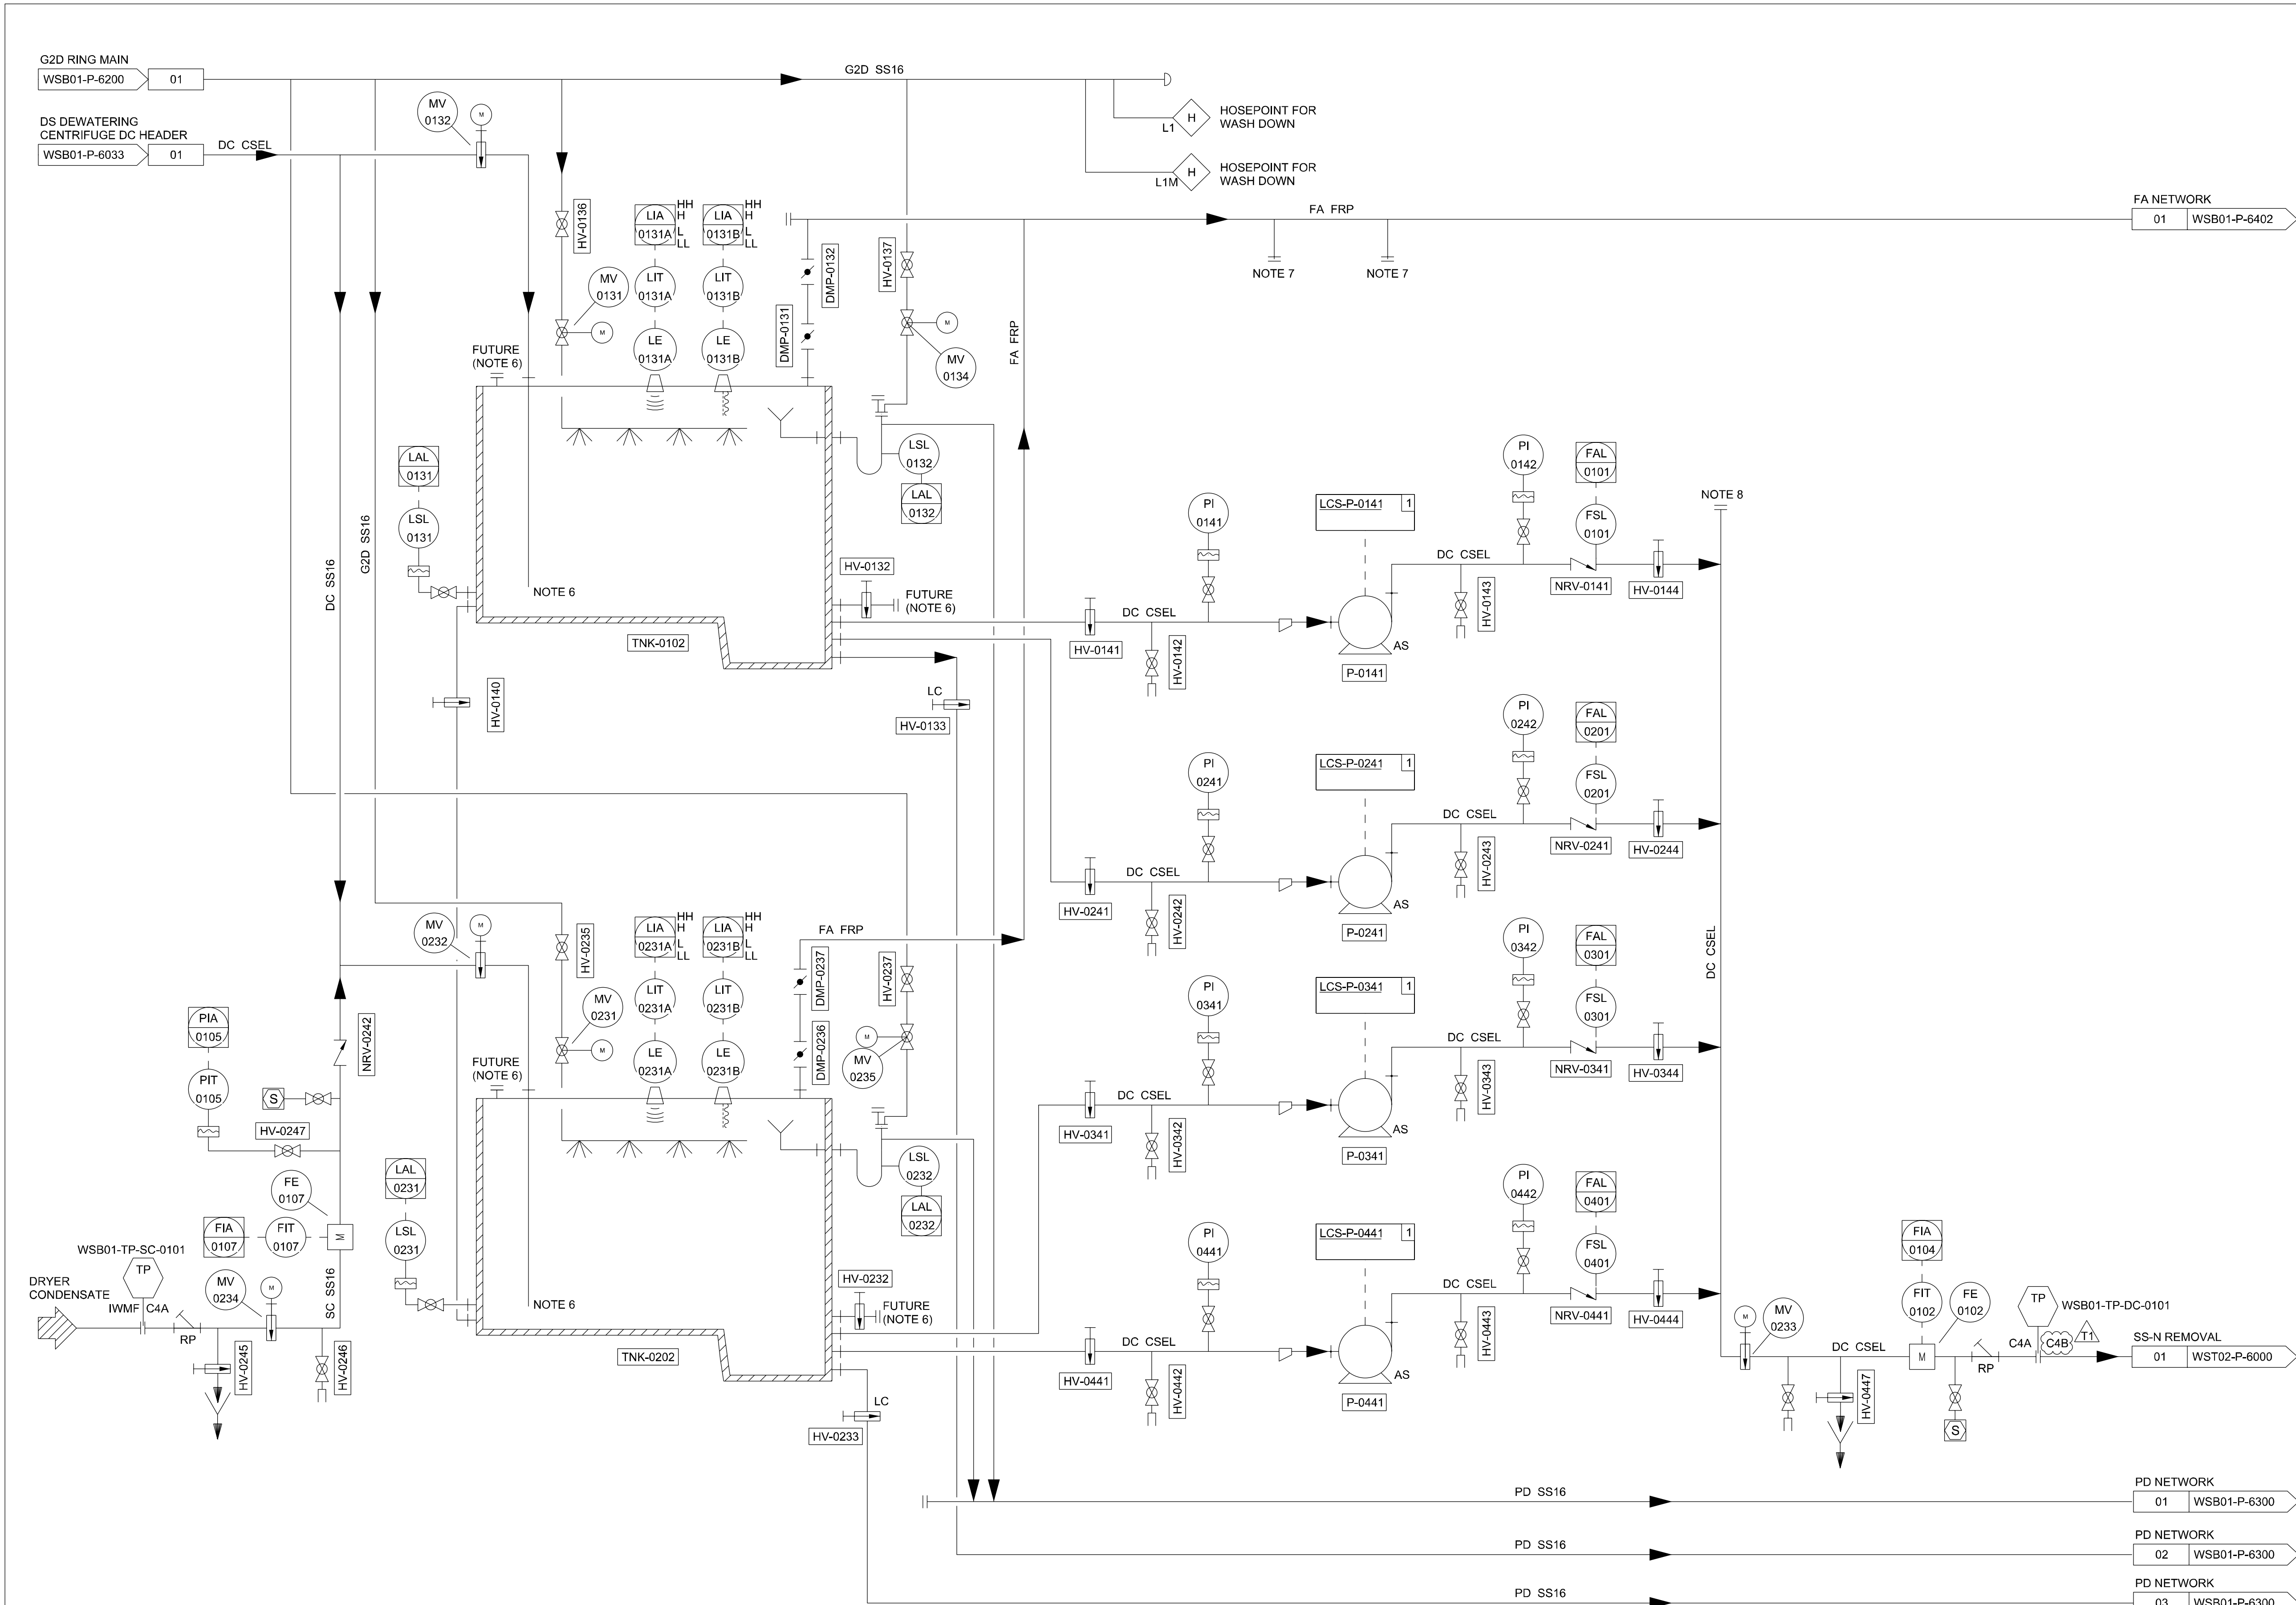

PROCESS UNIT
105

DC WET WELL
(2 DUTY)

DC WETWELL PUMPS
(2 DUTY, 1 STANDBY, 1 MAINTENANCE)

- NOTES:-
1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 2. THE CONTRACTOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 4. ADEQUATE RODDING POINT AND FLUSHING POINT SHALL BE PROVIDE BASED ON PIPE ROUTING.
 5. WEAR PLATES SHALL BE EMBEDDED IN THE TANK FLOOR BELOW THE DROPER PIPE.
 6. TIE IN POINT FOR PHASE 2.
 7. CONNECTION POINTS FOR FUTURE DC WET WELL.
 8. CONNECTION FOR TEMPORARY PIPELINE DURING INTERIM OPERATION.

TENDER

T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
T1	23/08/19	ISSUED FOR TENDER C4A	CN	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:

B&V AECOM
A joint venture of Black & Veatch and AECOM

CONSULTANT:

JACOBS
CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

P&ID
DC WETWELL AND PUMPS

DRAFTED: PS	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101

CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP	REVISION: T1
	SHEET NUMBER: WSB01-P-6082	
	THIS DRAWING IS COPYRIGHT	