


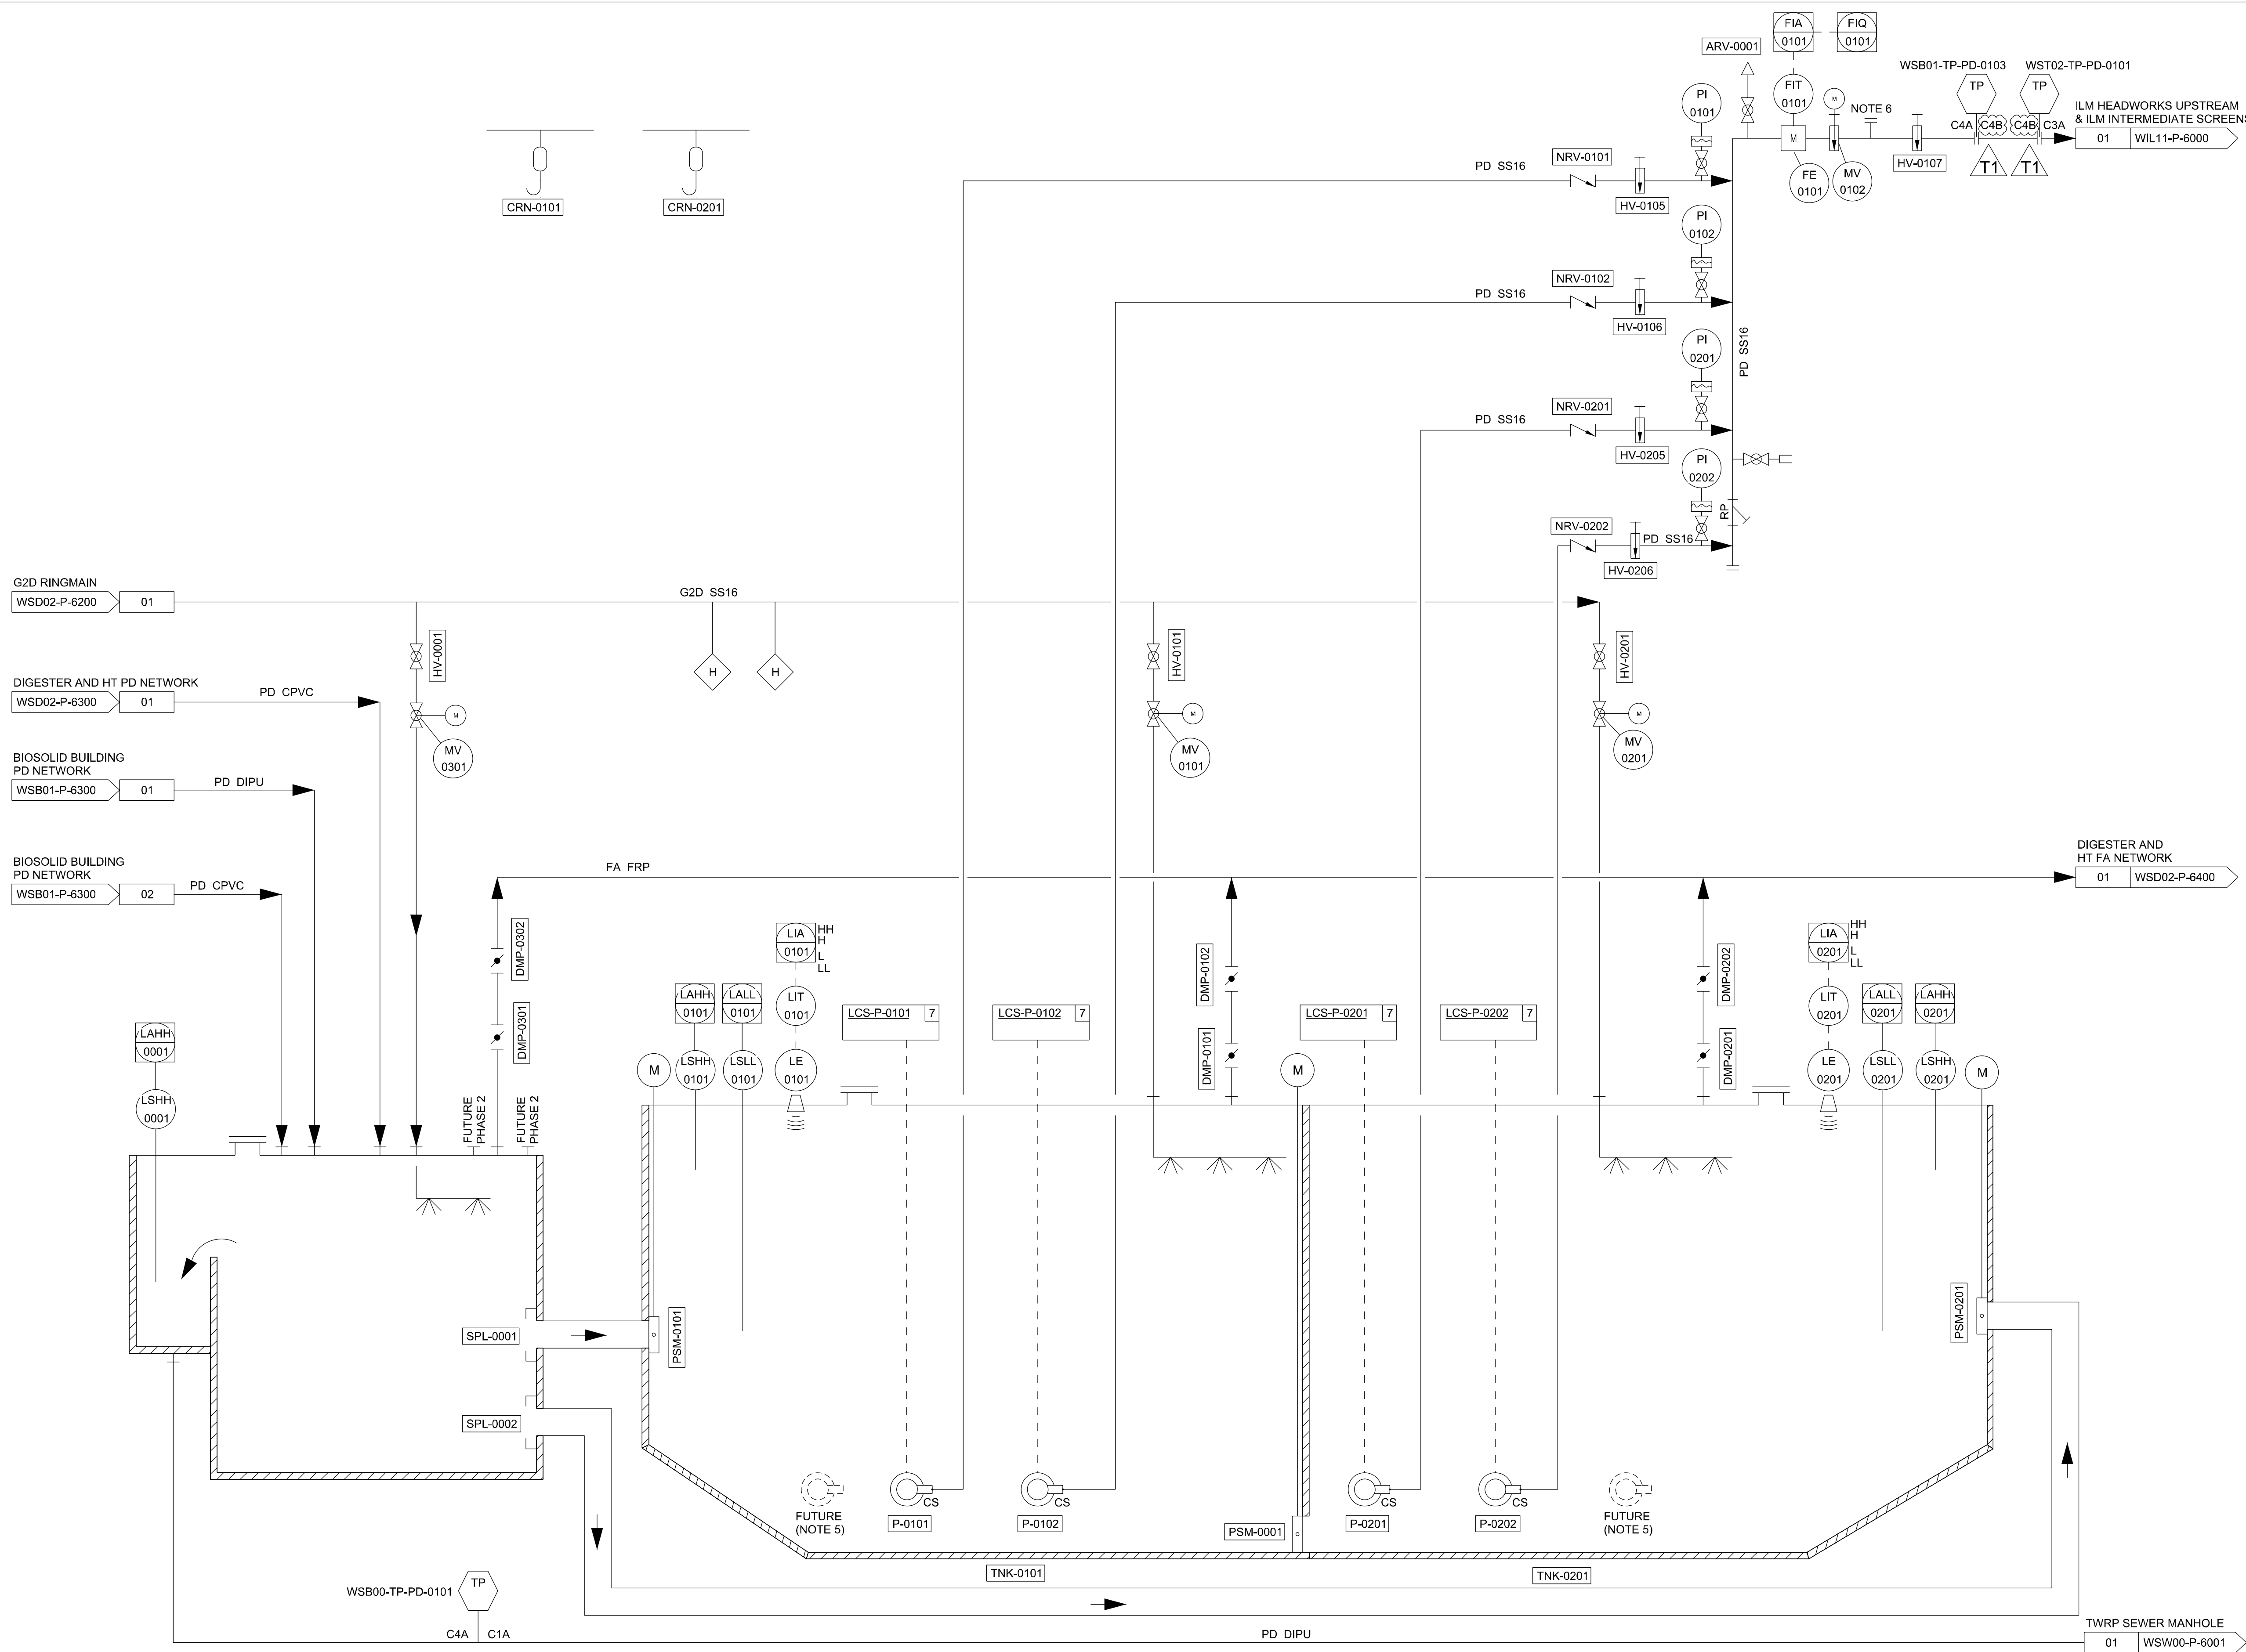

PROCESS UNIT
008

SWIRELLING JIB CRANE
FOR PLANT DRAIN PUMPING STATION
2 DUTY

PLANT DRAIN SUMP
2 DUTY

PLANT DRAIN PUMPS
2 DUTY, 2 STANDBY

- NOTES:-
1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 2. THE CONTRACOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 4. ADEQUETE RODDING POINT AND FLUSHING POINTS SHALL BE PROVIDE BASED ON PIPING ROUTING.
 5. FOR PHASE 2
 6. CONNECTION FOR TEMPORARY PIPELINE DURING INTERIM OPERATION.

TENDER

REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED
T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
T2	23/09/19	ISSUED FOR ADDENDUM 1	CN	GOT
T1	23/08/19	ISSUED FOR TENDER C4A	CN	GOT

CLIENT:



PROGRAMME MANAGER:

B&V AECOM
A joint venture of Black & Veatch and AECOM

CONSULTANT:

JACOBS
CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

P&ID
PLANT DRAIN PUMPING STATION

DRAFTED: PD	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101
CONTRACT: -	DRAWING NUMBER: PUB-DTSS2-TWRP	SHEET NUMBER: WSB01-P-6090
		REVISION: T1

THIS DRAWING IS COPYRIGHT