


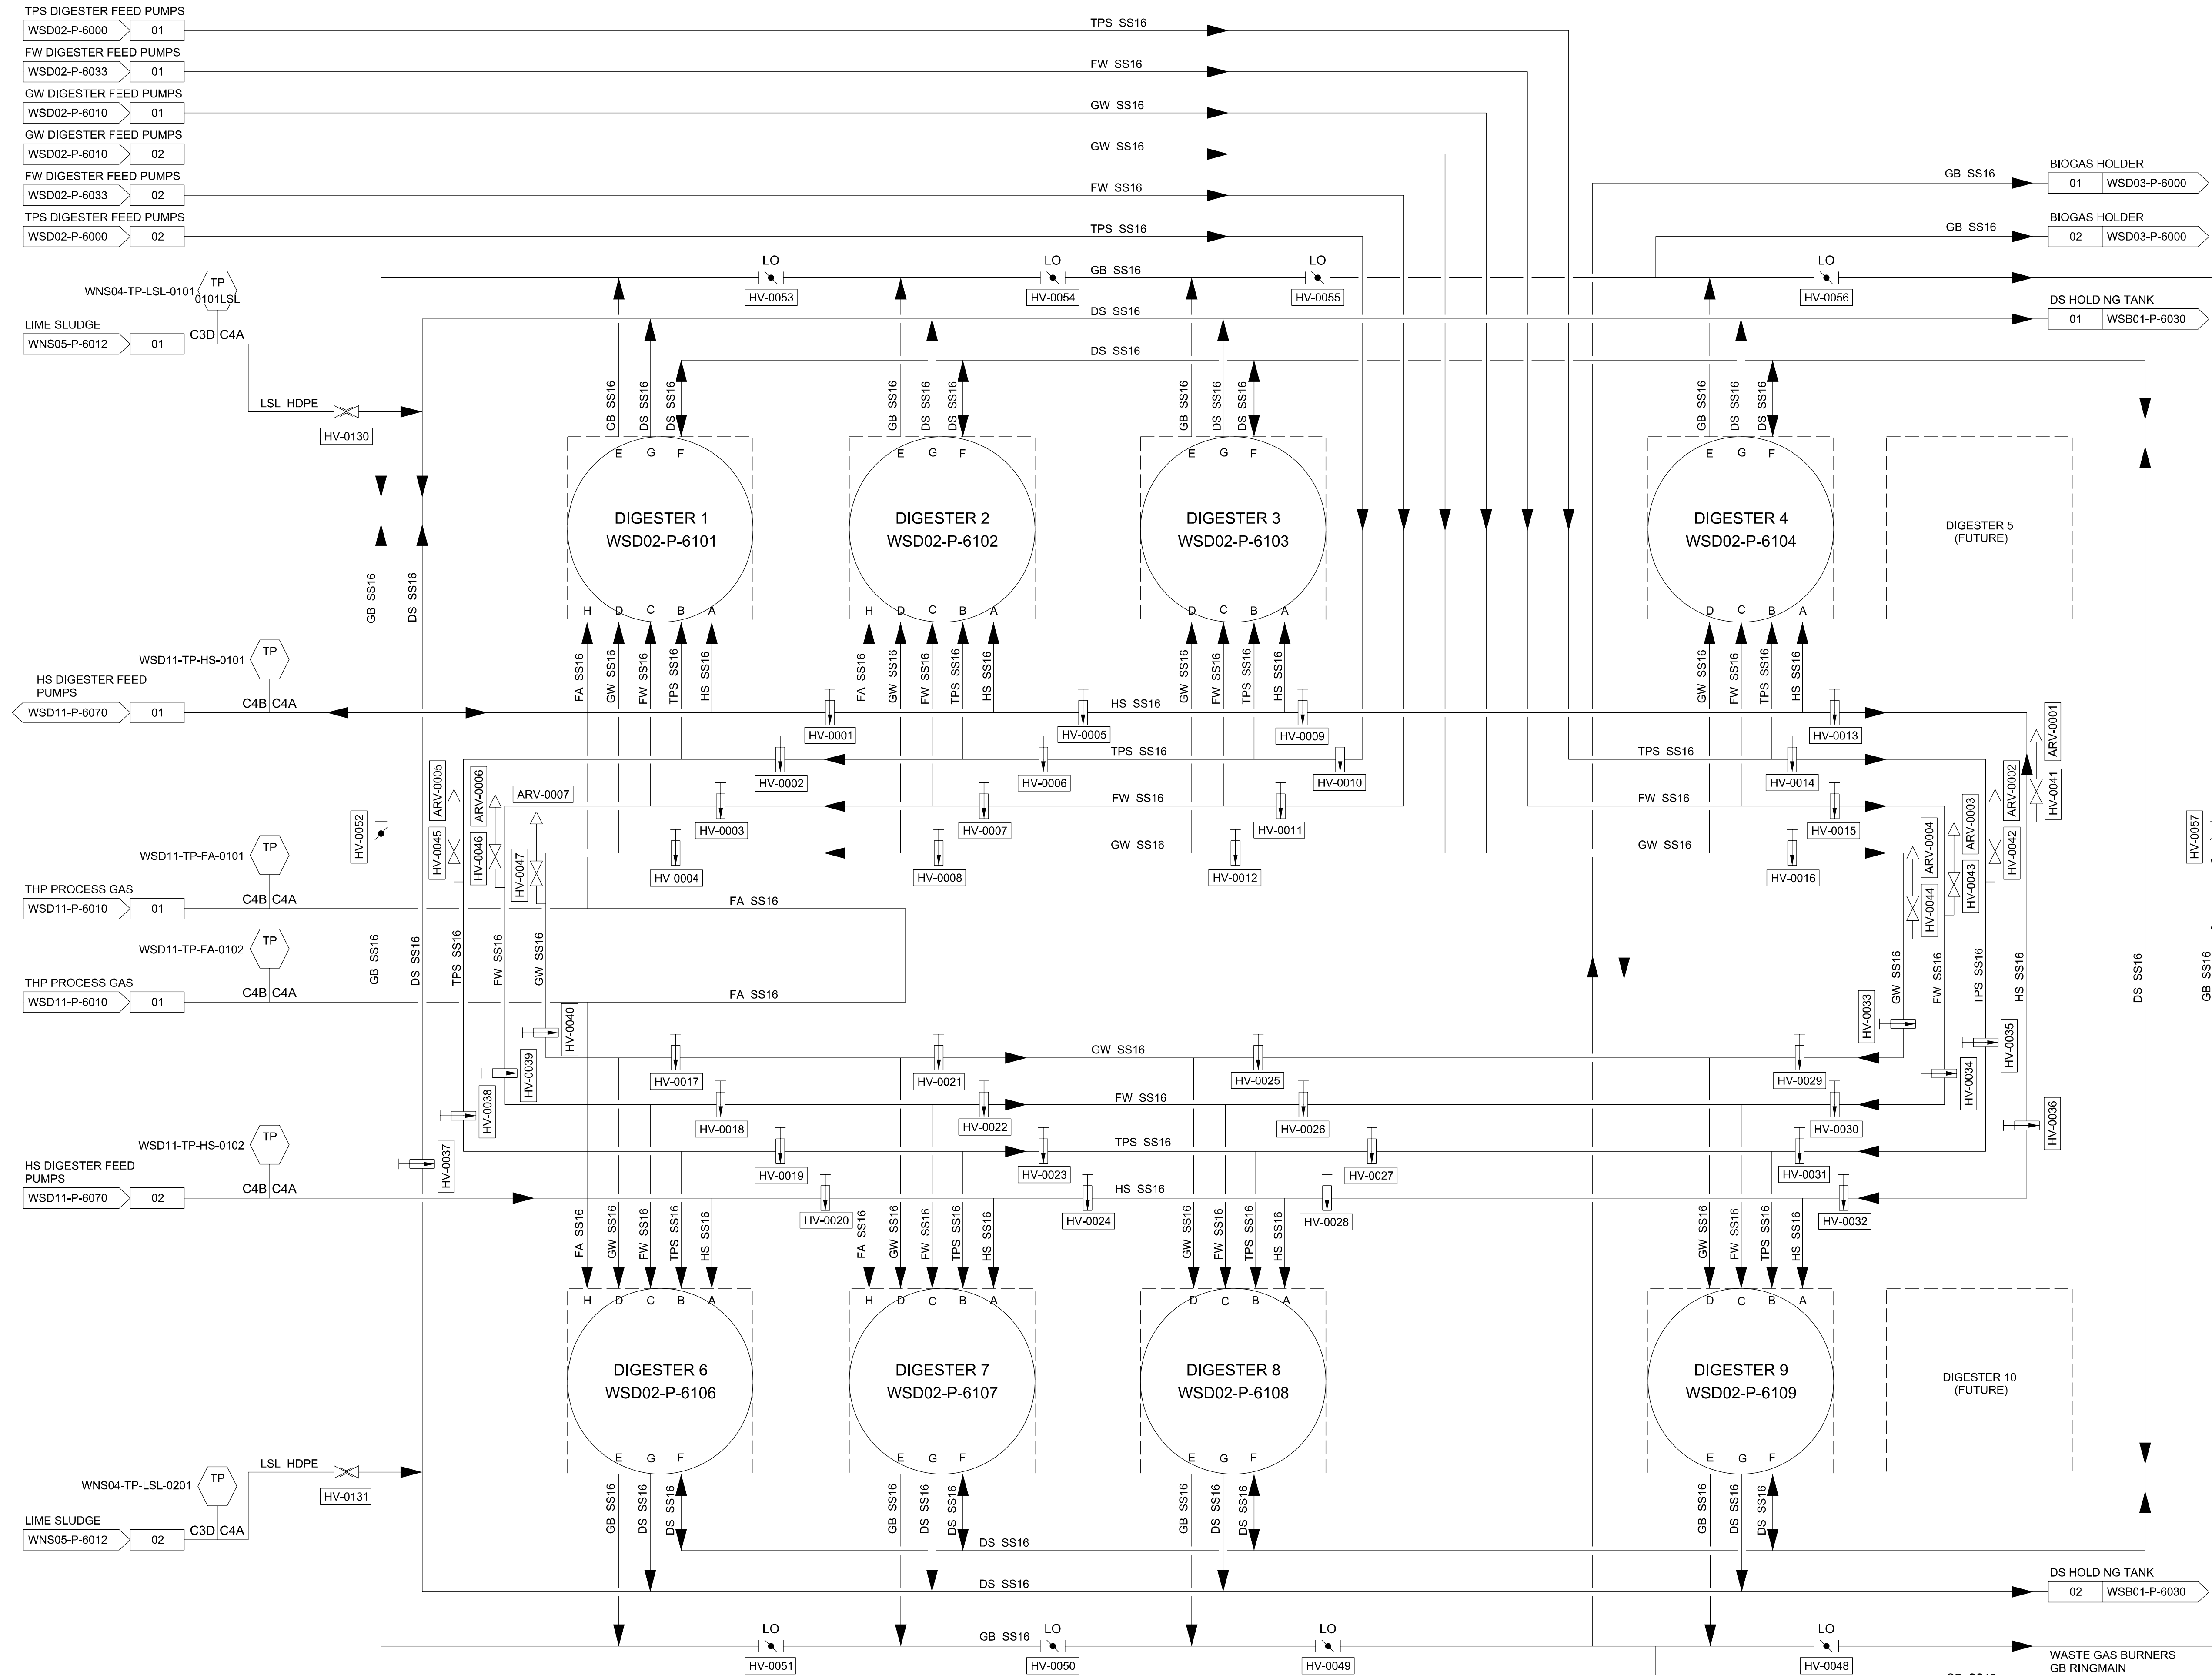

- NOTES:-
1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 2. THE CONTRACTOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 4. RODDING, FLUSHING & DRAIN PROVISIONS FOR ALL PIPELINES BASED ON PIPE ROUTING, SHALL BE PROVIDED.
 5. ADEQUATE AIR VALVES TO BE PROVIDED, BASED ON PIPE ROUTING.

PROCESS UNIT

113

TENDER

REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED
T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
T2	23/09/19	ISSUED FOR ADDENDUM 1	CN	GOT
T1	23/08/19	ISSUED FOR TENDER C4A	CN	GOT



PROJECT TITLE:
TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE
P&ID
DIGESTERS OVERALL

DRAFTED: SC	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101

CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP	REVISION: T1
	SHEET NUMBER: WSD02-P-6100	

THIS DRAWING IS COPYRIGHT