


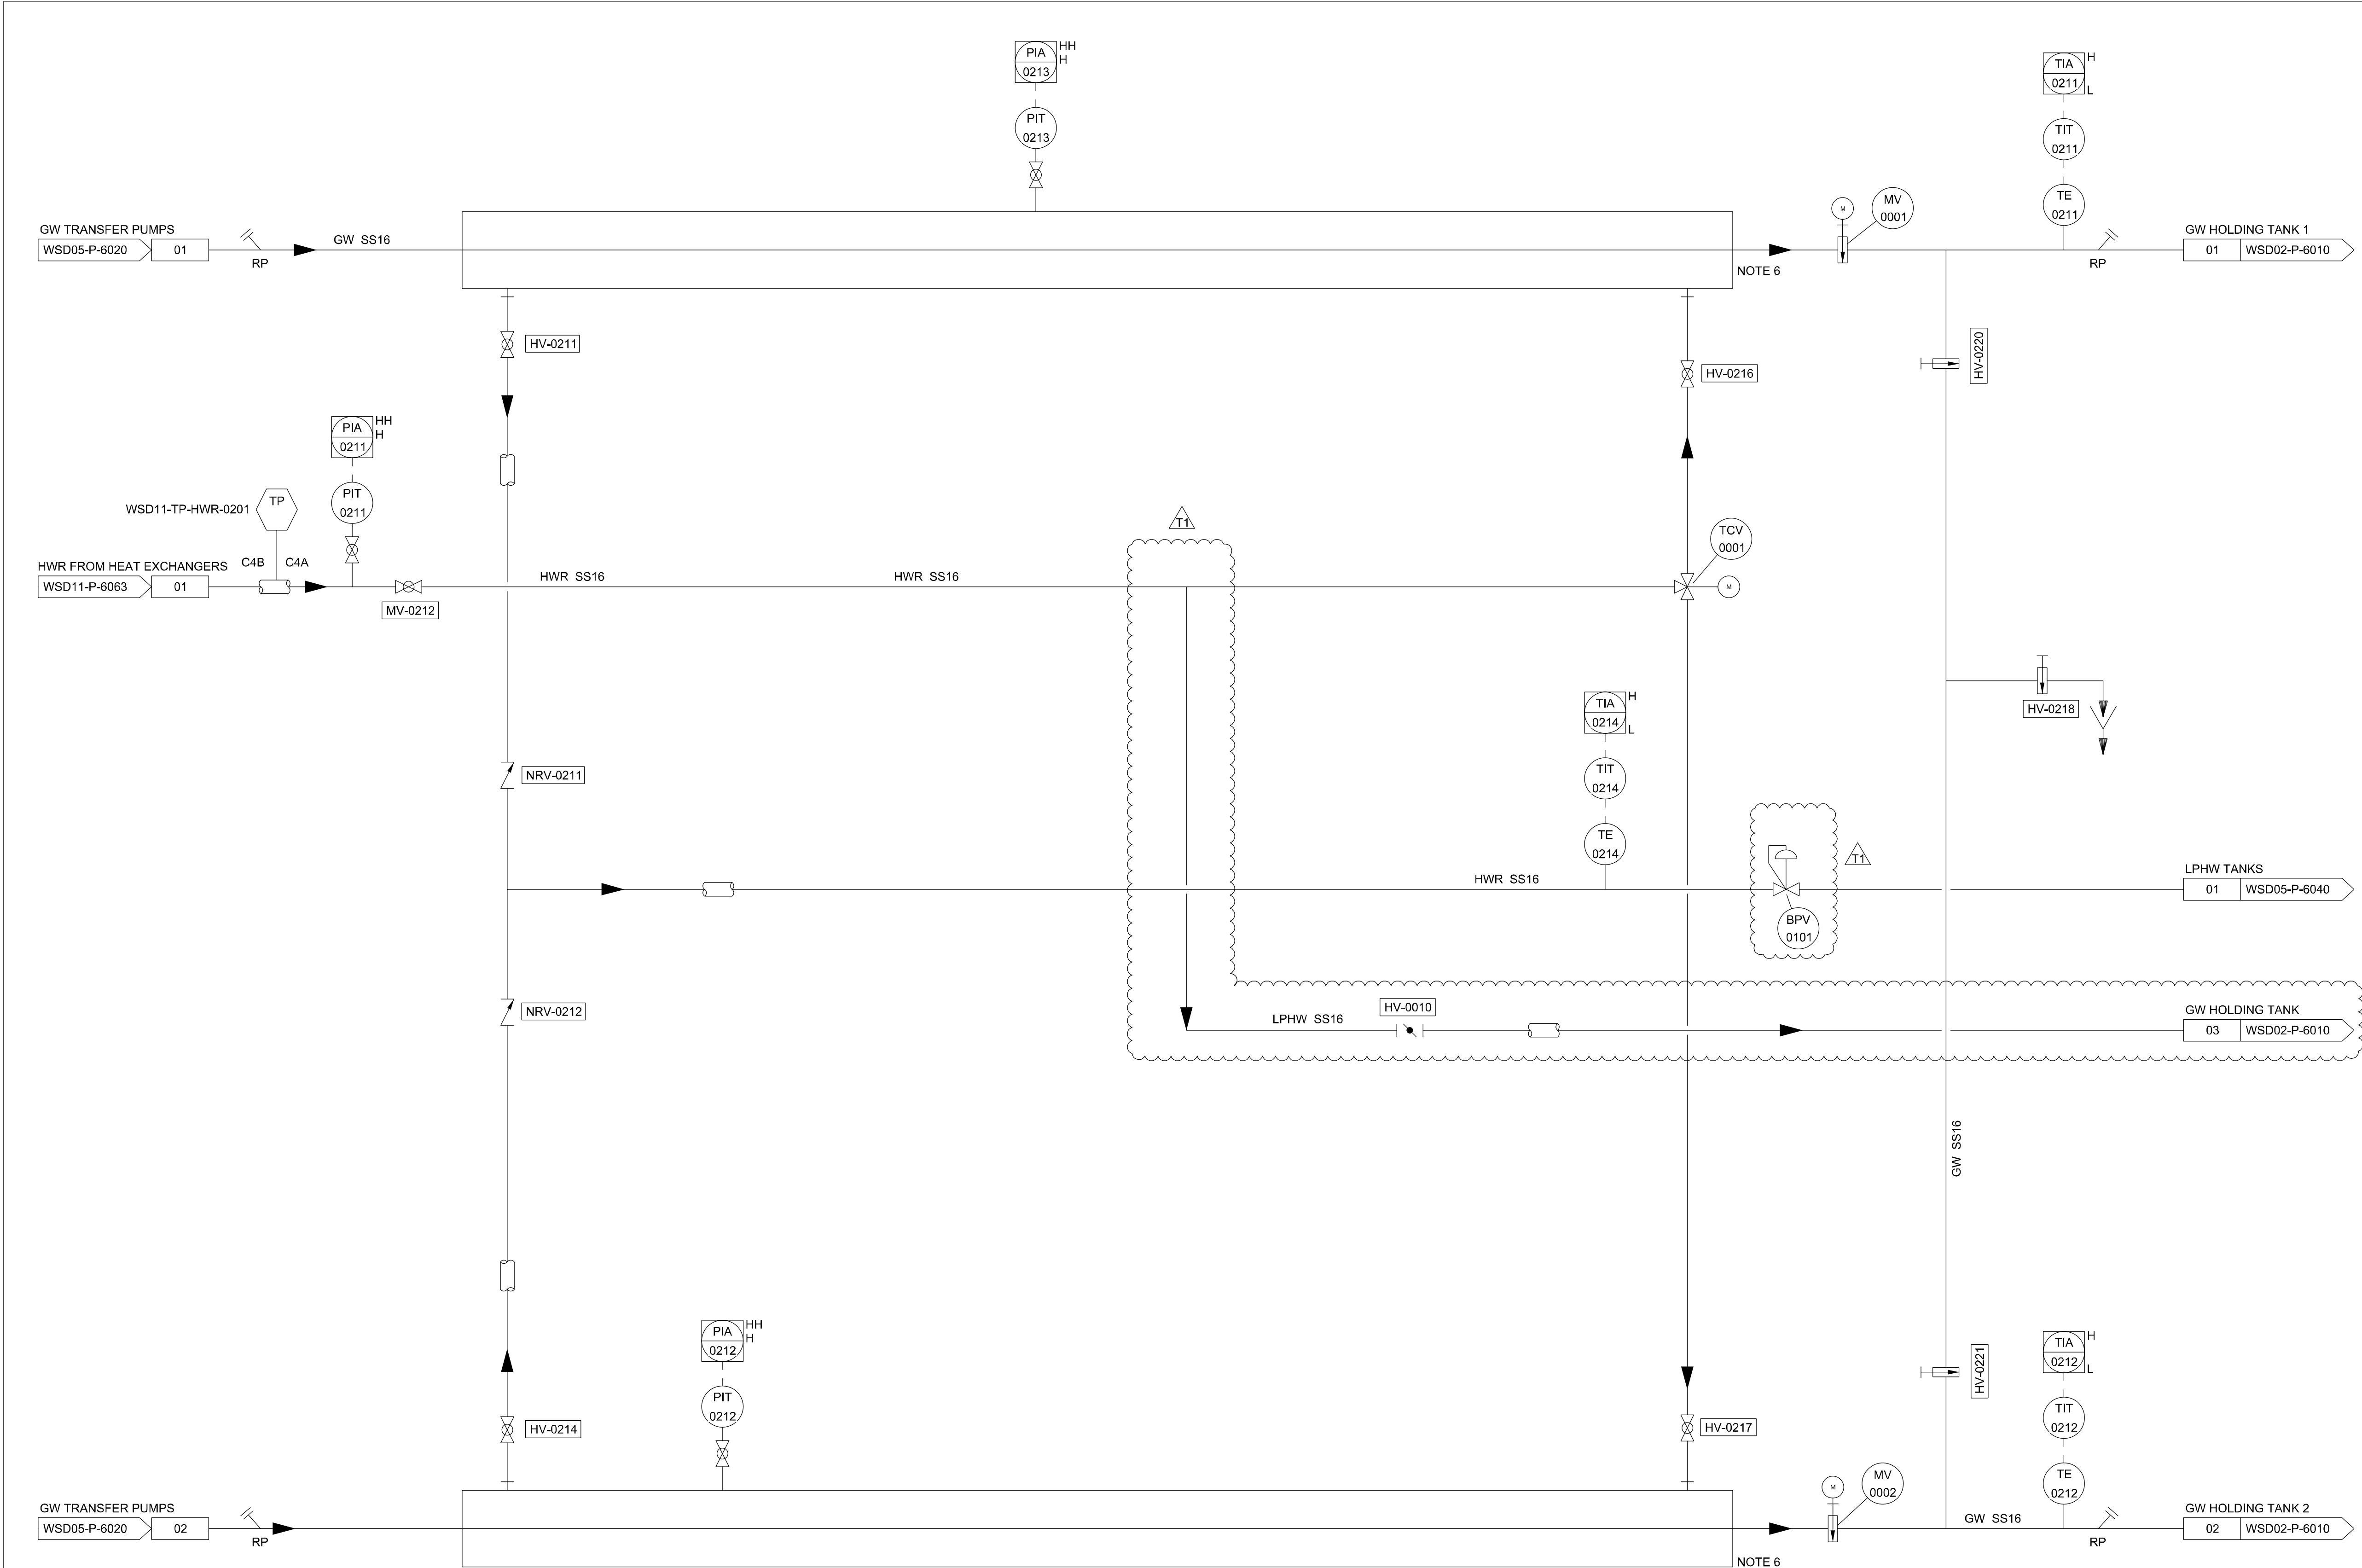

PROCESS UNIT

125

- NOTES:-
1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 2. THE CONTRACOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 4. ALL PIPELINE & VALVES WITH DESIGN TEMPERATURE >60°C SHALL BE HOT INSULATED FOR PERSONEL PROTECTION.
 5. ADEQUATE RODDING /JETTING POINTS AND FLUSHING POINTS SHALL BE PROVIDED BASED ON PIPE ROUTING.
 6. DOUBLE WALLED PIPE EXTENDED UP TO GW HOLDING TANK (NEAR INLET OF HOLDING TANK)
 7. ALL FIELD SIGNALS TO BE HARDWIRED CONNECTION TO RIO PANELS.

TENDER

T1	20/05/22	ISSUED FOR TENDER C4B	CN GOT
T1	23/08/19	ISSUED FOR TENDER C4A	CN GOT
REV	DATE	DESCRIPTION	REVIEWED /AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



DRAWING TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

P&ID
GW TRANSFER PIPE TO
GW HOLDING TANK

DRAFTED: RS	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101

CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP
-	SHEET NUMBER: WSD05-P-6021
	REVISION: T1

THIS DRAWING IS COPYRIGHT