


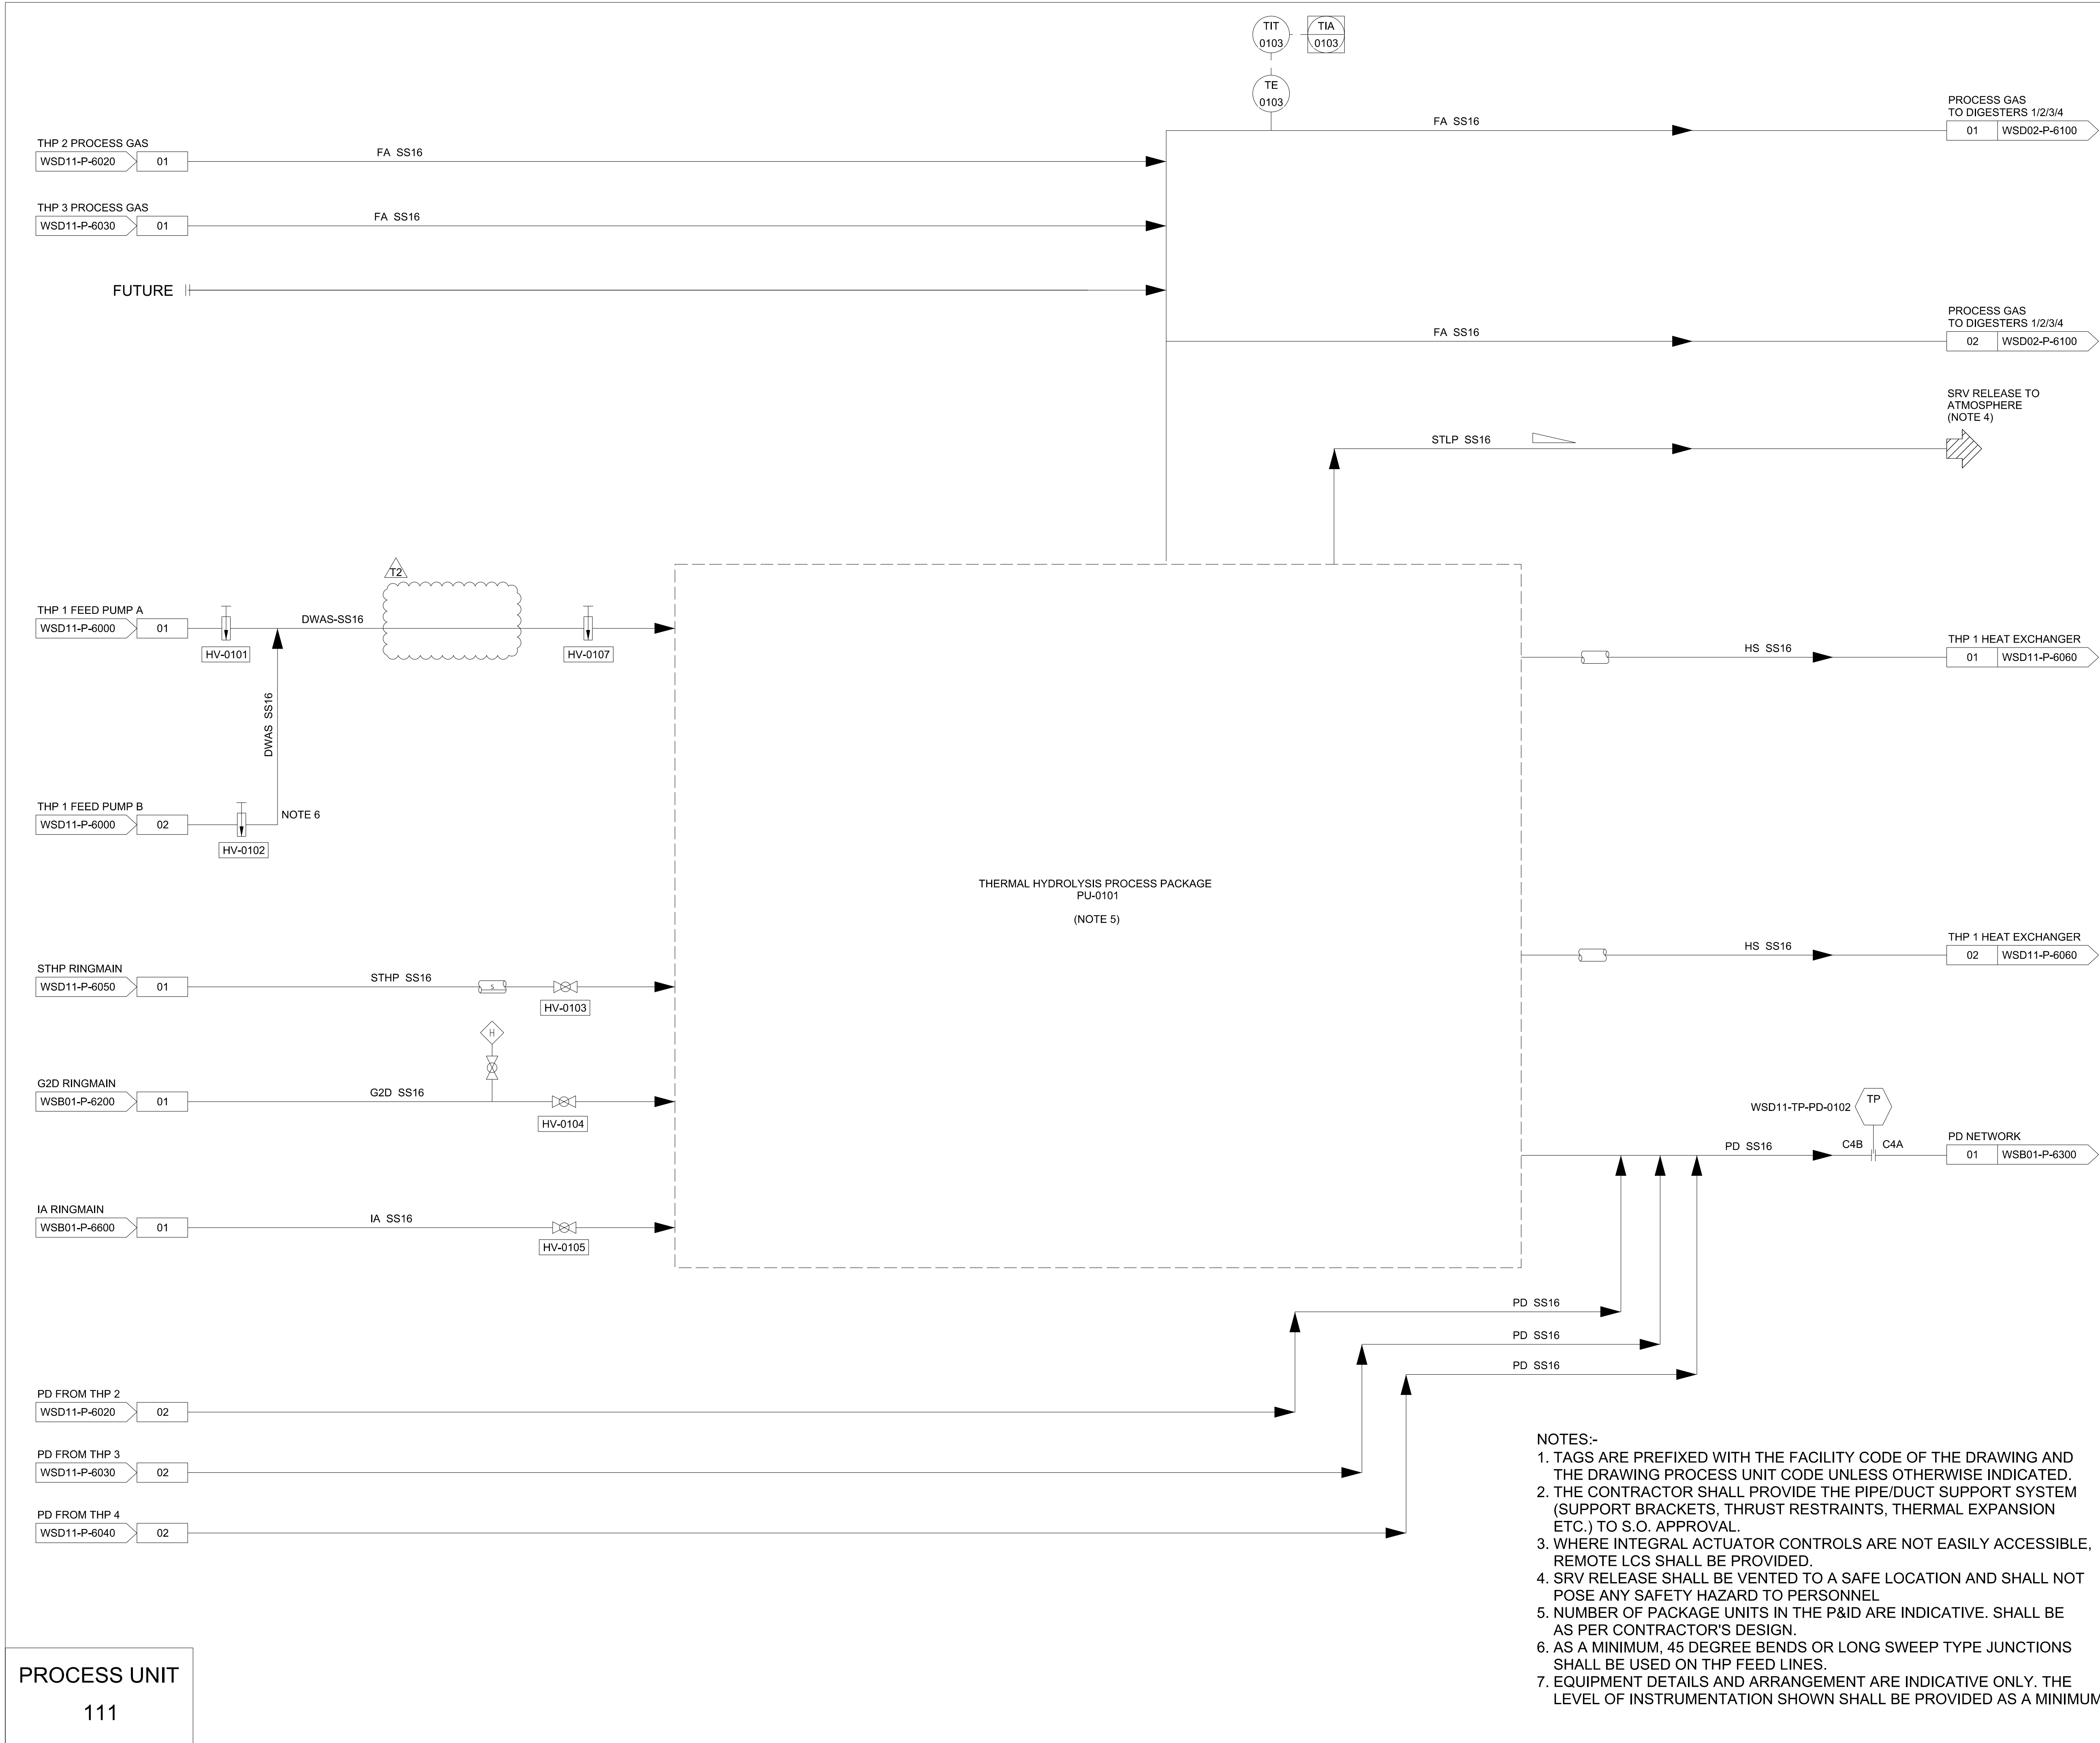

PROCESS UNIT

111

- NOTES:-
- 1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 - 2. THE CONTRACTOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 - 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 - 4. SRV RELEASE SHALL BE VENTED TO A SAFE LOCATION AND SHALL NOT POSE ANY SAFETY HAZARD TO PERSONNEL
 - 5. NUMBER OF PACKAGE UNITS IN THE P&ID ARE INDICATIVE. SHALL BE AS PER CONTRACTOR'S DESIGN.
 - 6. AS A MINIMUM, 45 DEGREE BENDS OR LONG SWEEP TYPE JUNCTIONS SHALL BE USED ON THP FEED LINES.
 - 7. EQUIPMENT DETAILS AND ARRANGEMENT ARE INDICATIVE ONLY. THE LEVEL OF INSTRUMENTATION SHOWN SHALL BE PROVIDED AS A MINIMUM.

TENDER

T2	25/11/22	ISSUED FOR TENDER C48 (2ND STAGE)	CN	GOT
T1	20/05/22	ISSUED FOR TENDER C48	CN	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:

SINGAPORE'S NATIONAL WATER AGENCY

PROGRAMME MANAGER:

A JOINT VENTURE DELIVERING THE DTSS2 PROJECT

CONSULTANT:

CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

**TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2**

DRAWING TITLE

**P&ID
THERMAL HYDROLYSIS PROCESS
PACKAGE 1**

DRAFTED: PS	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101
CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP	
-	SHEET NUMBER: WSD11-P-6010	REVISION: T2

THIS DRAWING IS COPYRIGHT