


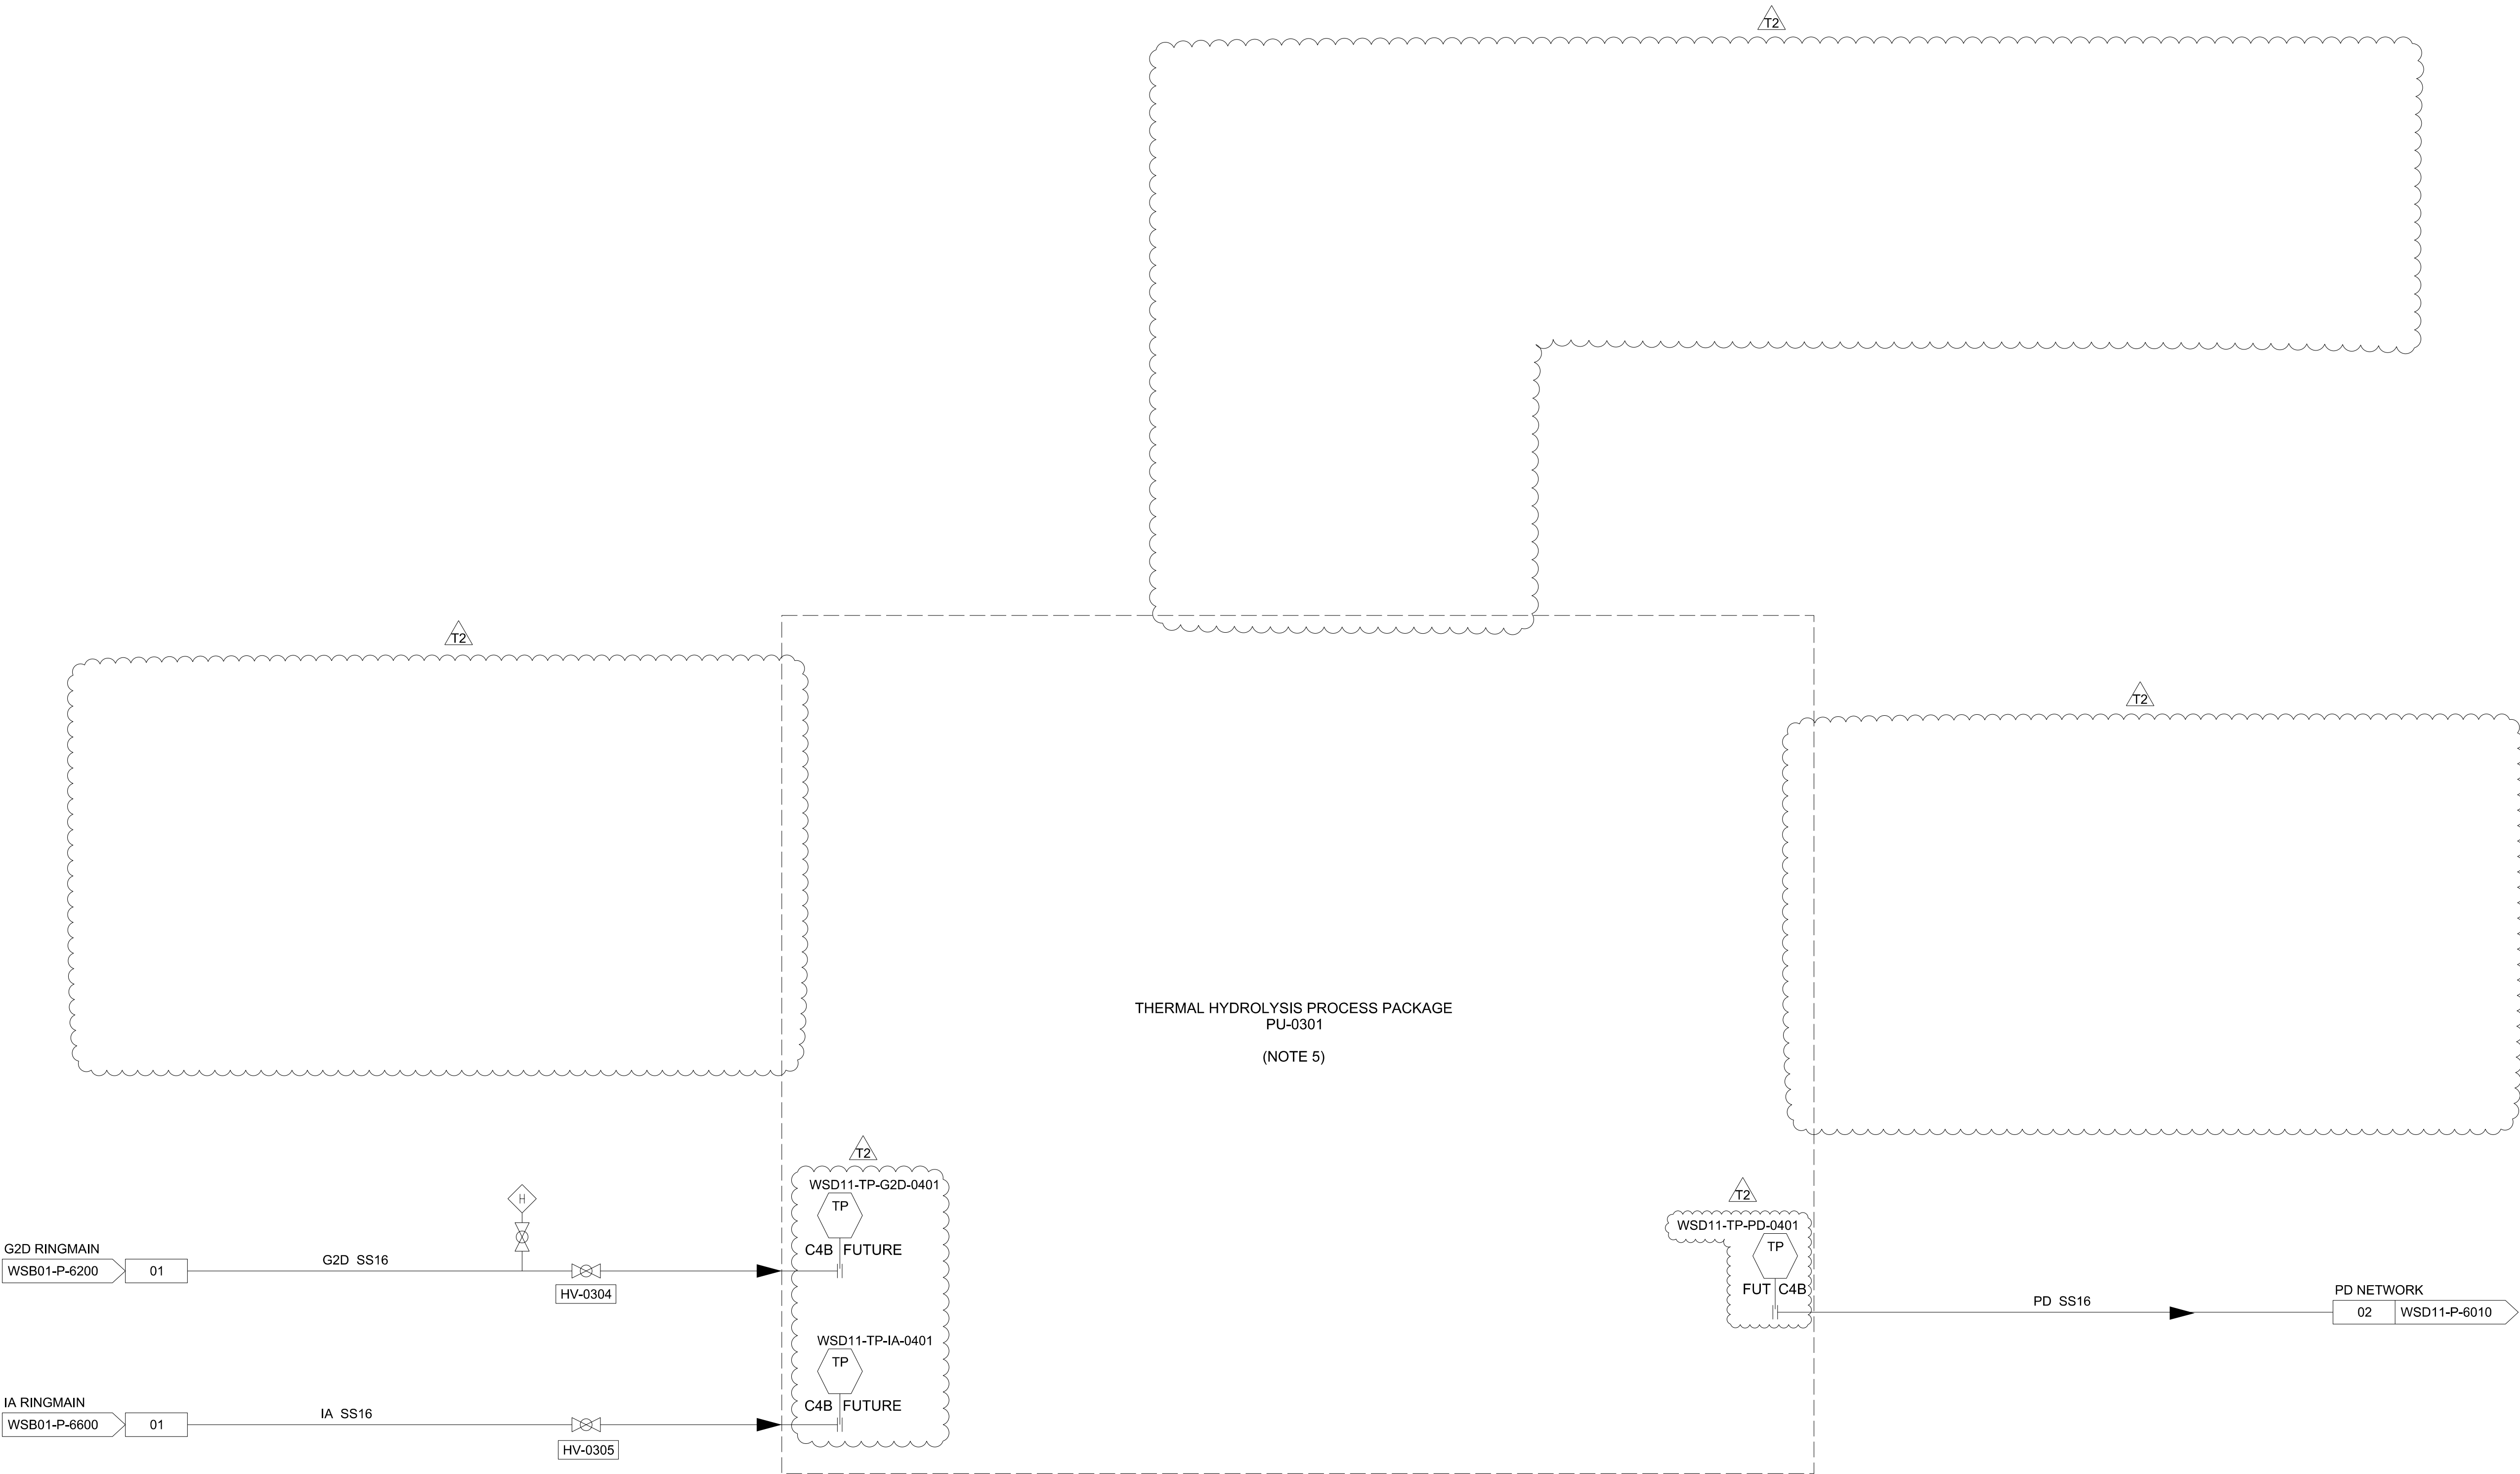

THERMAL HYDROLYSIS PROCESS PACKAGE
PU-0301
(NOTE 5)

- NOTES:-
1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 2. THE CONTRACTOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 4. SRV RELEASE SHALL BE VENTED TO A SAFE LOCATION AND SHALL NOT POSE ANY SAFETY HAZARD TO PERSONNEL.
 5. NUMBER OF PACKAGE UNITS IN THE P&ID ARE INDICATIVE. SHALL BE AS PER CONTRACTOR'S DESIGN.
 6. AS A MINIMUM, 45 DEGREE BENDS OR LONG SWEEP TYPE JUNCTIONS SHALL BE USED ON THP FEED LINES.
 7. EQUIPMENT DETAILS AND ARRANGEMENT ARE INDICATIVE ONLY. THE LEVEL OF INSTRUMENTATION SHOWN SHALL BE PROVIDED AS A MINIMUM.

TENDER

T2	25/11/22	ISSUED FOR TENDER C4B (2ND STAGE)	CN	GOT
T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:

binnies AECOM

A JOINT VENTURE DELIVERING THE DTSS2 PROJECT

CONSULTANT:

Jacobs

CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

P&ID
THERMAL HYDROLYSIS PROCESS
PACKAGE 3

DRAFTED: PS	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101
CONTRACT: -	DRAWING NUMBER: PUB-DTSS2-TWRP SHEET NUMBER: WSD11-P-6030	REVISION: T2

THIS DRAWING IS COPYRIGHT