


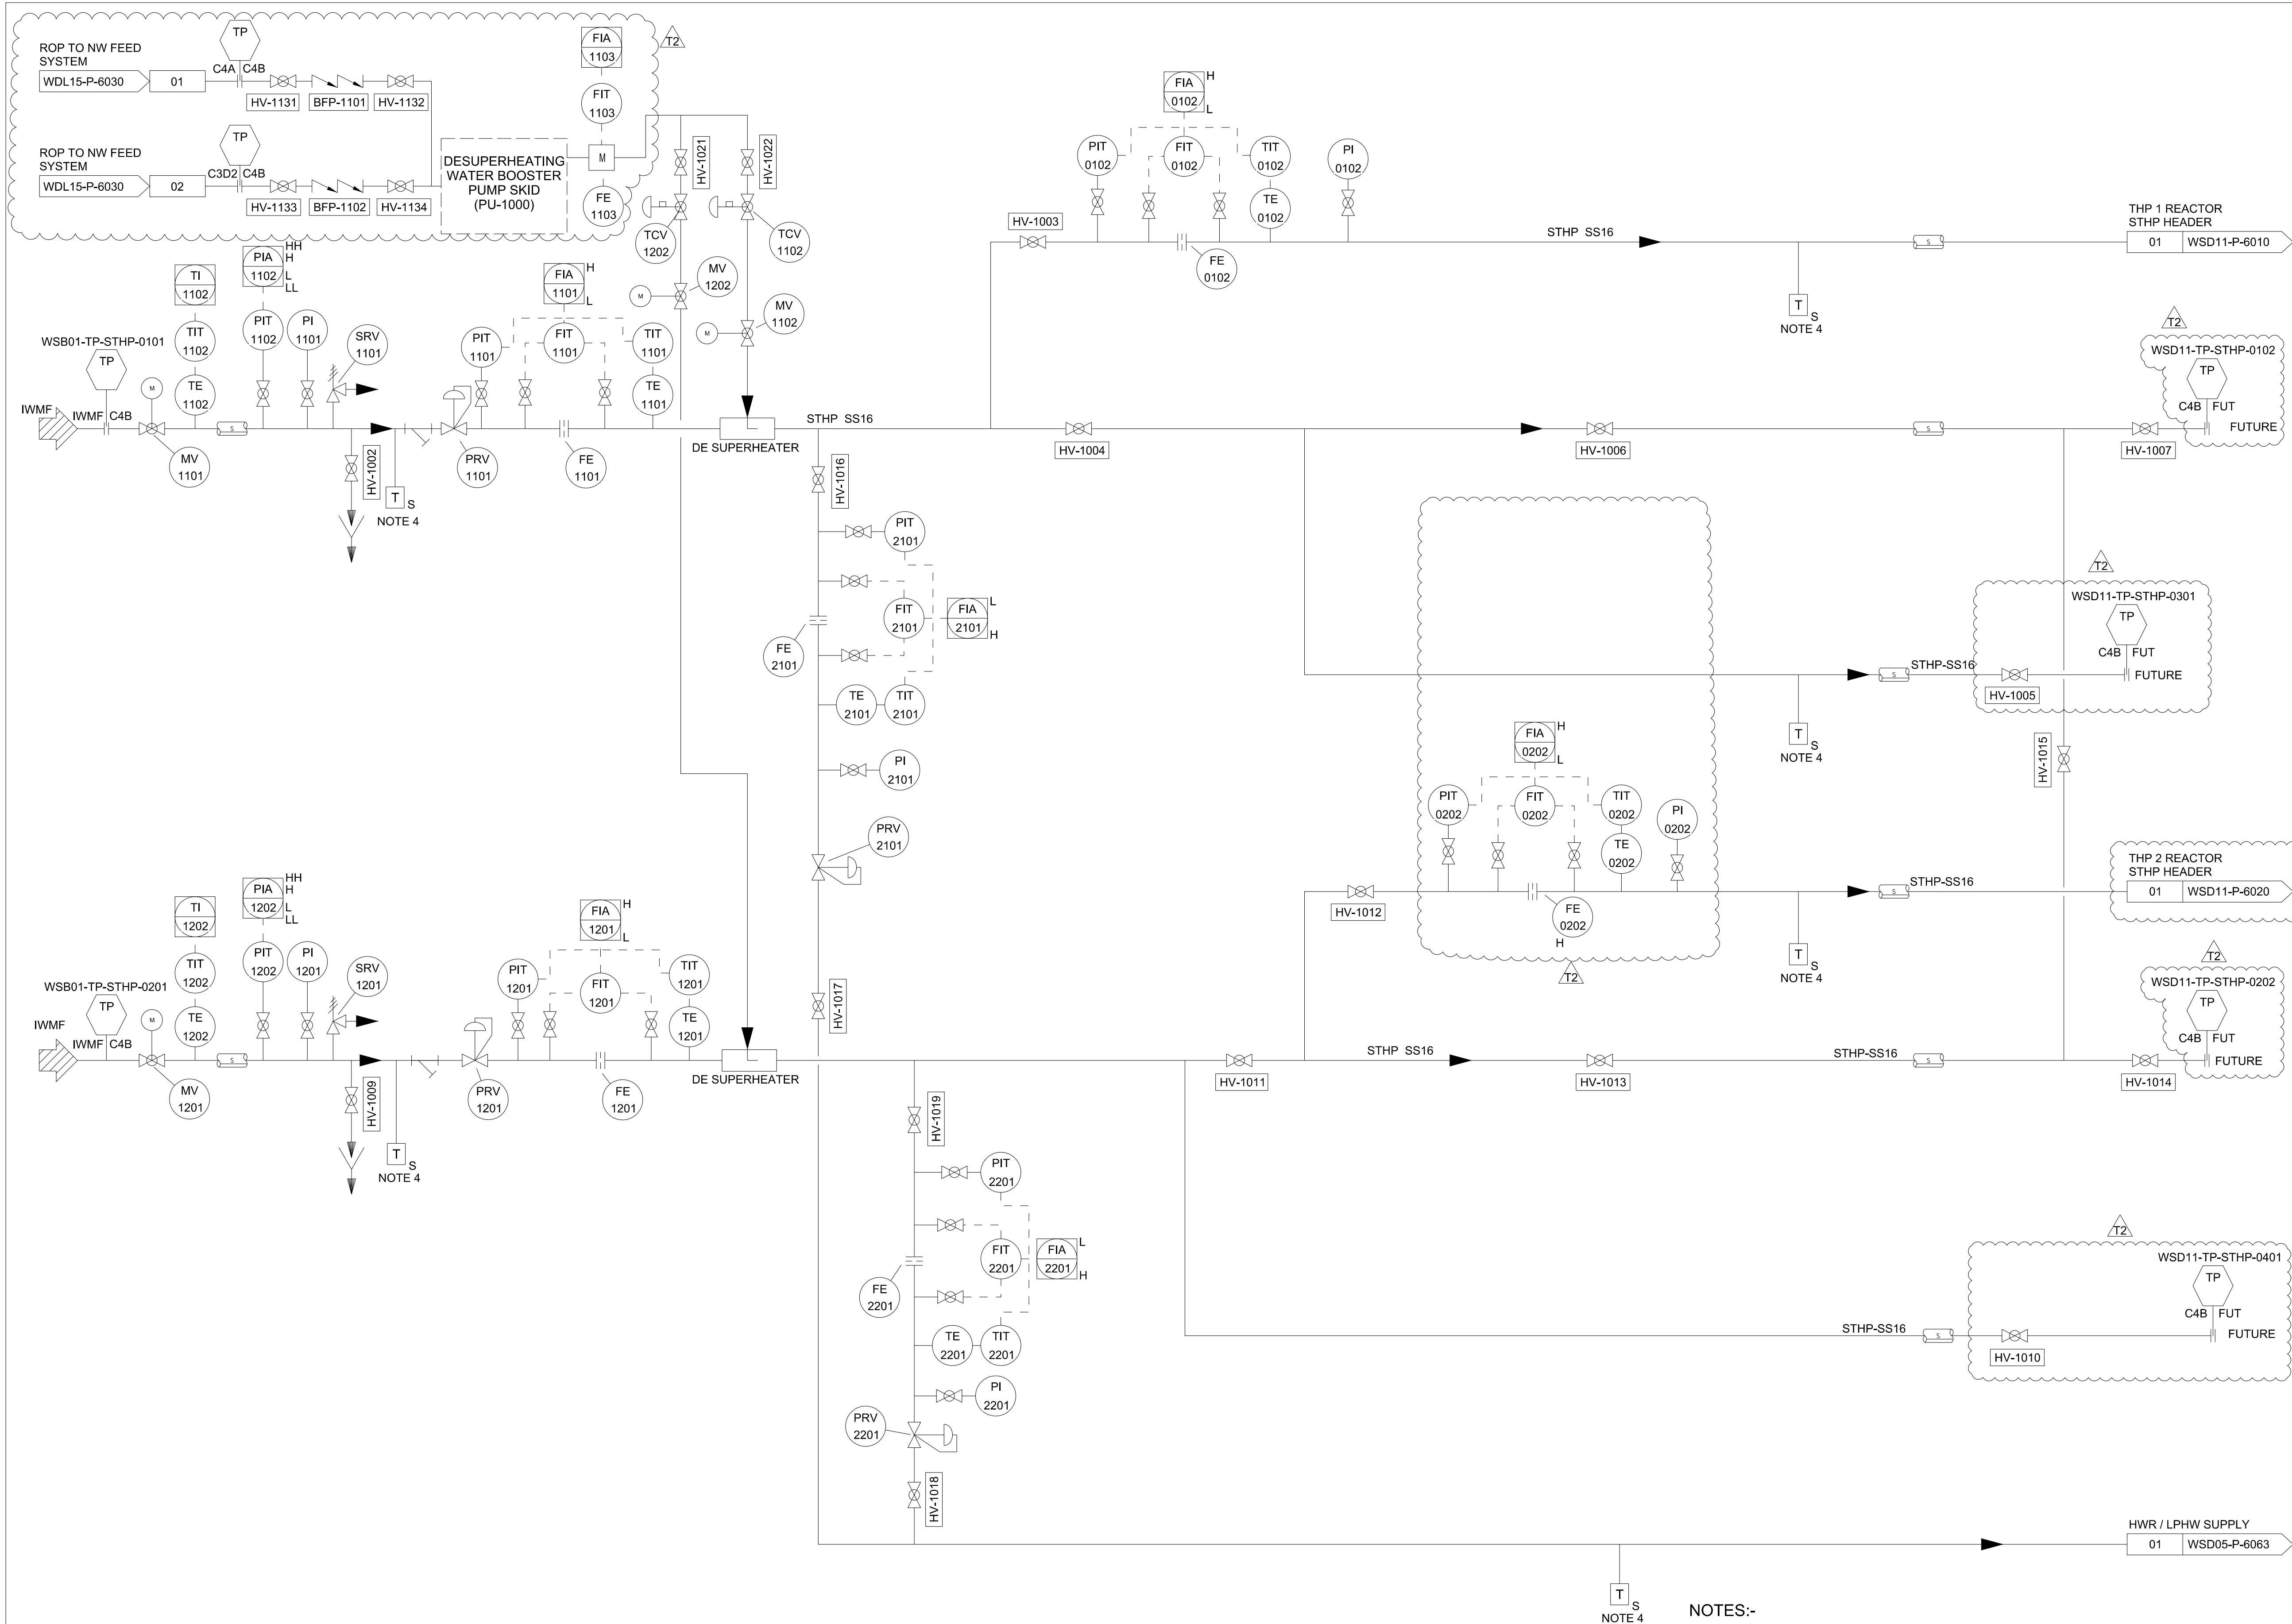

- NOTES:-
1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 2. THE CONTRACTOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 4. CONDENSATE TRAPS TO BE PROVIDED AT LOW POINTS IN STHP NETWORK AND BEFORE CONTROL/REGULATING VALVES.
 5. EQUIPMENT DETAILS AND ARRANGEMENT ARE INDICATIVE ONLY. THE LEVEL OF INSTRUMENTATION SHOWN SHALL BE PROVIDED AS A MINIMUM.
 6. ONLY SIMPLE ISOLATION CONFIGURATIONS ARE SHOWN IN THE TENDER DRAWINGS. ISOLATION REQUIREMENTS SHALL BE PROVIDED IN ACCORDANCE WITH THE SPECIFICATIONS AND STANDARDS. E.G DOUBLE BLOCK AND BLEED SHALL BE PROVIDED FOR STEAM SERVICES.

TENDER

T2	25/11/22	ISSUED FOR TENDER C4B (2ND STAGE)	CN	GOT
T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:
TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE
P&ID
THP STHP DISTRIBUTION

DRAFTED: PS	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101
CONTRACT: -	DRAWING NUMBER: PUB-DTSS2-TWRP	SHEET NUMBER: WSD11-P-6050
		REVISION: T2

THIS DRAWING IS COPYRIGHT