


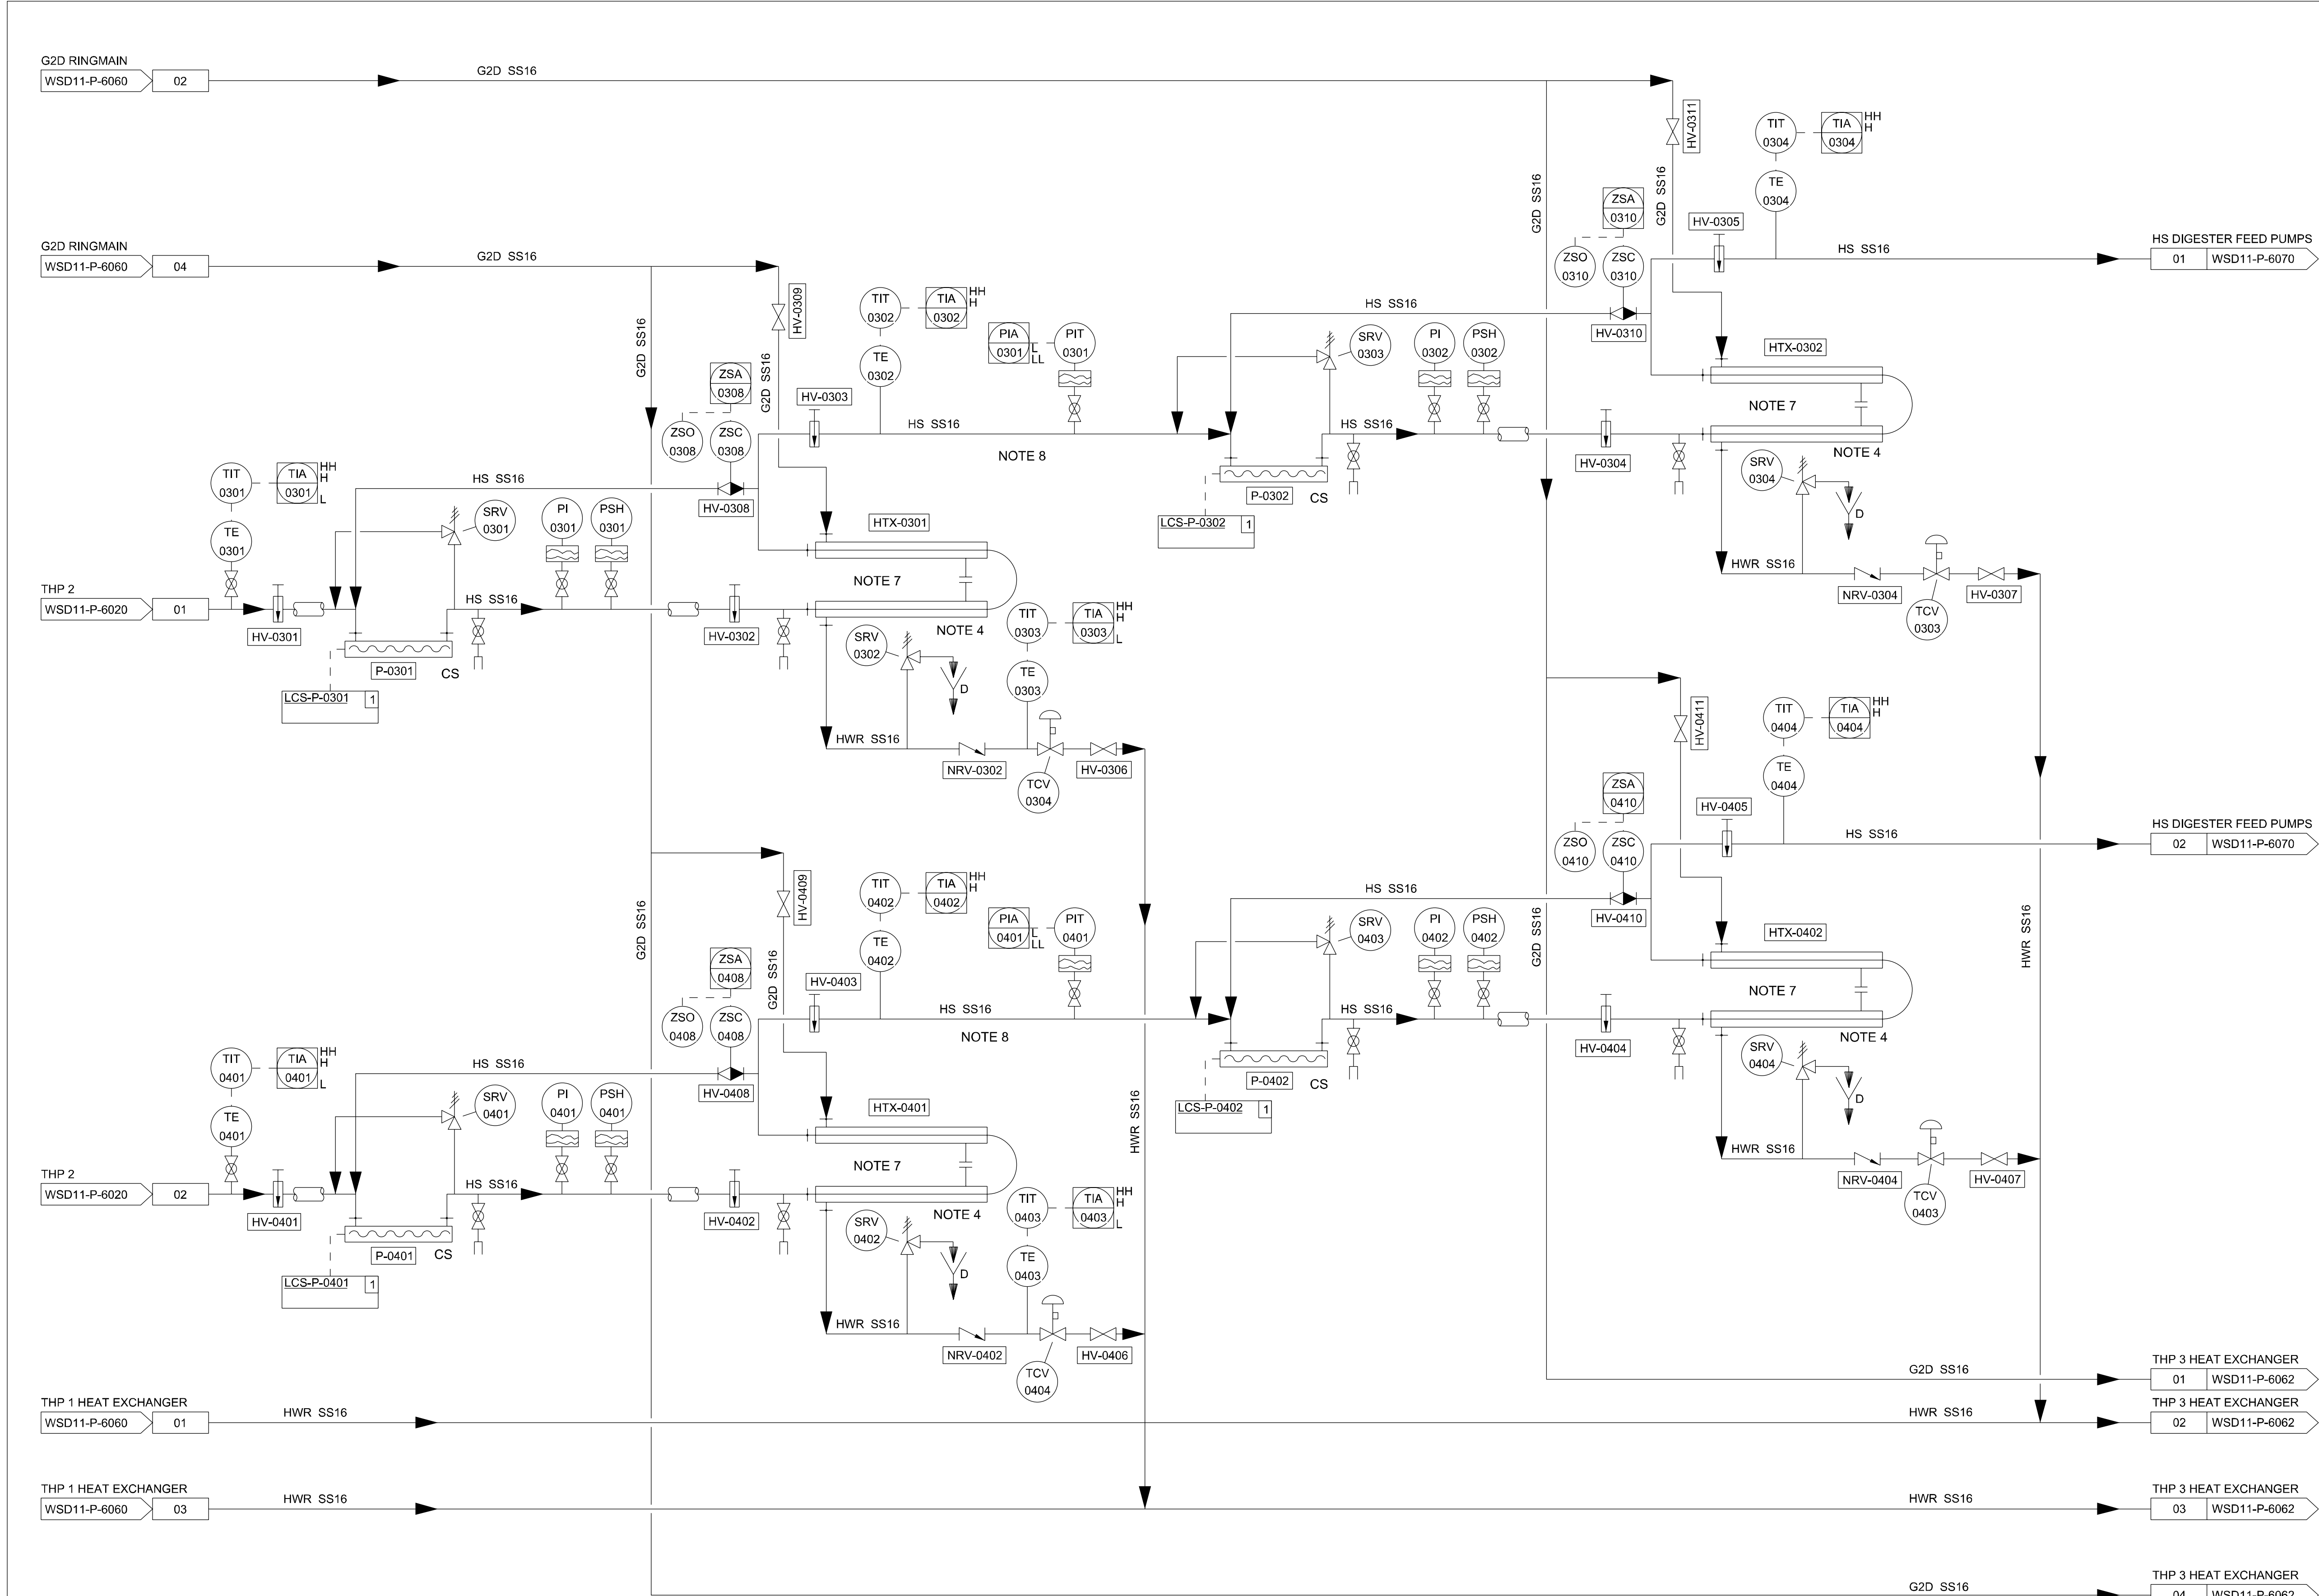

PROCESS UNIT
112

STAGE 1
THP 2 HEAT EXCHANGER FEED/
RECIRCULATION PUMP
(2 DUTY)

STAGE 1
THP 2 HEAT EXCHANGER
(2 DUTY)

STAGE 2
THP 2 HEAT EXCHANGER FEED/
RECIRCULATION PUMP
(2 DUTY)

STAGE 2
THP 2 HEAT EXCHANGER
(2 DUTY)

- NOTES:-
1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 2. THE CONTRACTOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 4. PRV DISCHARGE SHALL BE SAFELY ROUTE TO THE NEAREST SUPPORT DRAIN /BUND
 5. WHRE INSULATION IS SHOWN THE DEFAULT REQUIREMENT IS FOR PERSONAL PROTECTON NOT FOR THERMAL HEAT LOSS.
 6. EQUIPMENT DETAILS AND ARRANGEMENT ARE INDICATIVE ONLY. THE LEVEL OF INSTRUMENTATION SHOWN SHALL BE PROVIDED AS A MINIMUM.
 7. CONNECTIONS FROM HEAT EXCHANGER TO PLANT DRAIN SHALL BE PROVIDED.
 8. HEAT EXCHANGERS INTERCONNECTIONS MAY BE PROVIDED TO ALLOW ANY ONE UNIT TO BE TAKEN OFFLINE FOR MAINTENANCE WITHOUT AFFECTING THE OVERALL HEAT EXCHANGE CAPACITY AS SPECIFIED IN PARTICULAR SPECIFICATION.

TENDER

T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
REV/	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:
binnies AECOM
A JOINT VENTURE DELIVERING THE DTSS2 PROJECT

CONSULTANT:
Jacobs
CH2M HILL Singapore Pte Ltd

PROJECT TITLE:
**TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2**

DRAWING TITLE
**P&ID
THP 2 HEAT EXCHANGERS**

DRAFTED: RSR	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101
CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP	REVISION: T1
-	SHEET NUMBER: WSD11-P-6061	
THIS DRAWING IS COPYRIGHT		