


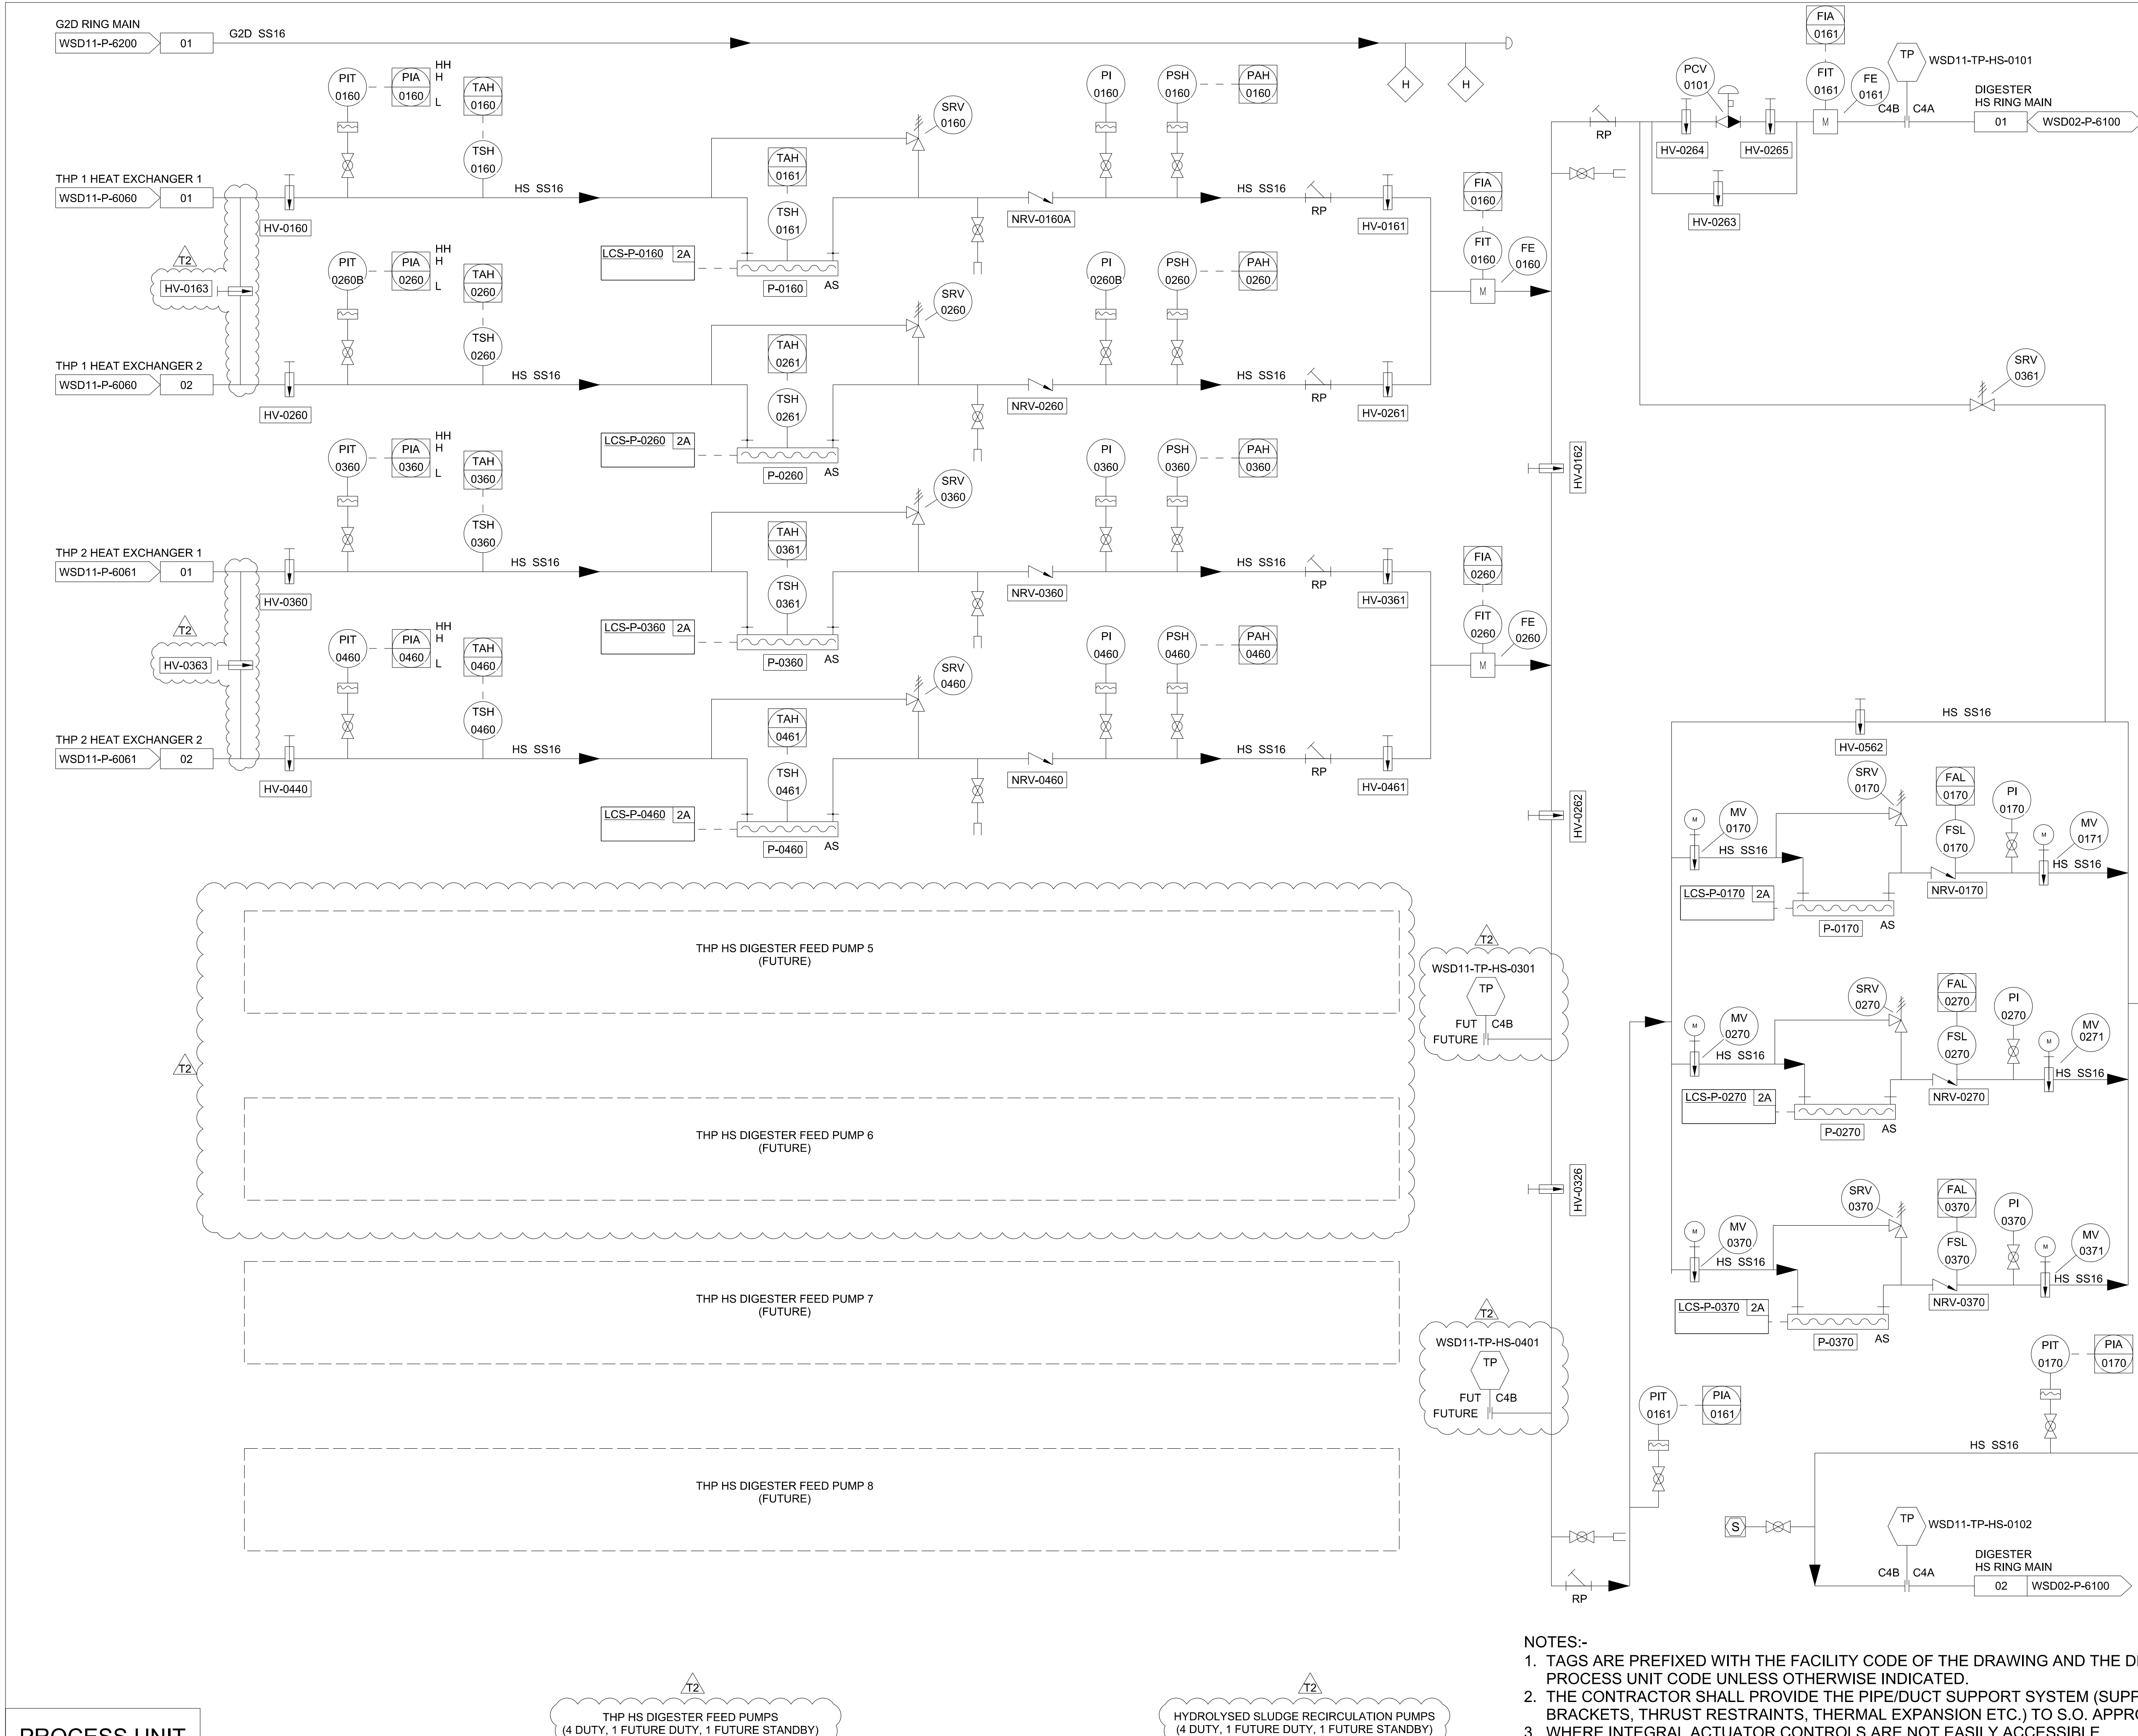

PROCESS UNIT
112

- NOTES:-
1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
 2. THE CONTRACTOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
 3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
 4. WHRE INSULATION IS SHOWN THE DEFAULT REQUIREMENT IS FOR PERSONAL PROTECTON NOT FOR THERMAL HEAT LOSS.

TENDER

T2	25/11/22	ISSUED FOR TENDER C4B (2ND STAGE)	CN	GOT
T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:

SINGAPORE'S NATIONAL WATER AGENCY

PROGRAMME MANAGER:

A JOINT VENTURE DELIVERING THE DTSS2 PROJECT

CONSULTANT:

CH2M HILL Singapore Pte Ltd

PROJECT TITLE:

**TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2**

DRAWING TITLE

**P&ID
HS DIGESTER
FEED PUMPS**

DRAFTED: RS	DESIGNED: KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101
CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP	REVISION: T2

THIS DRAWING IS COPYRIGHT