


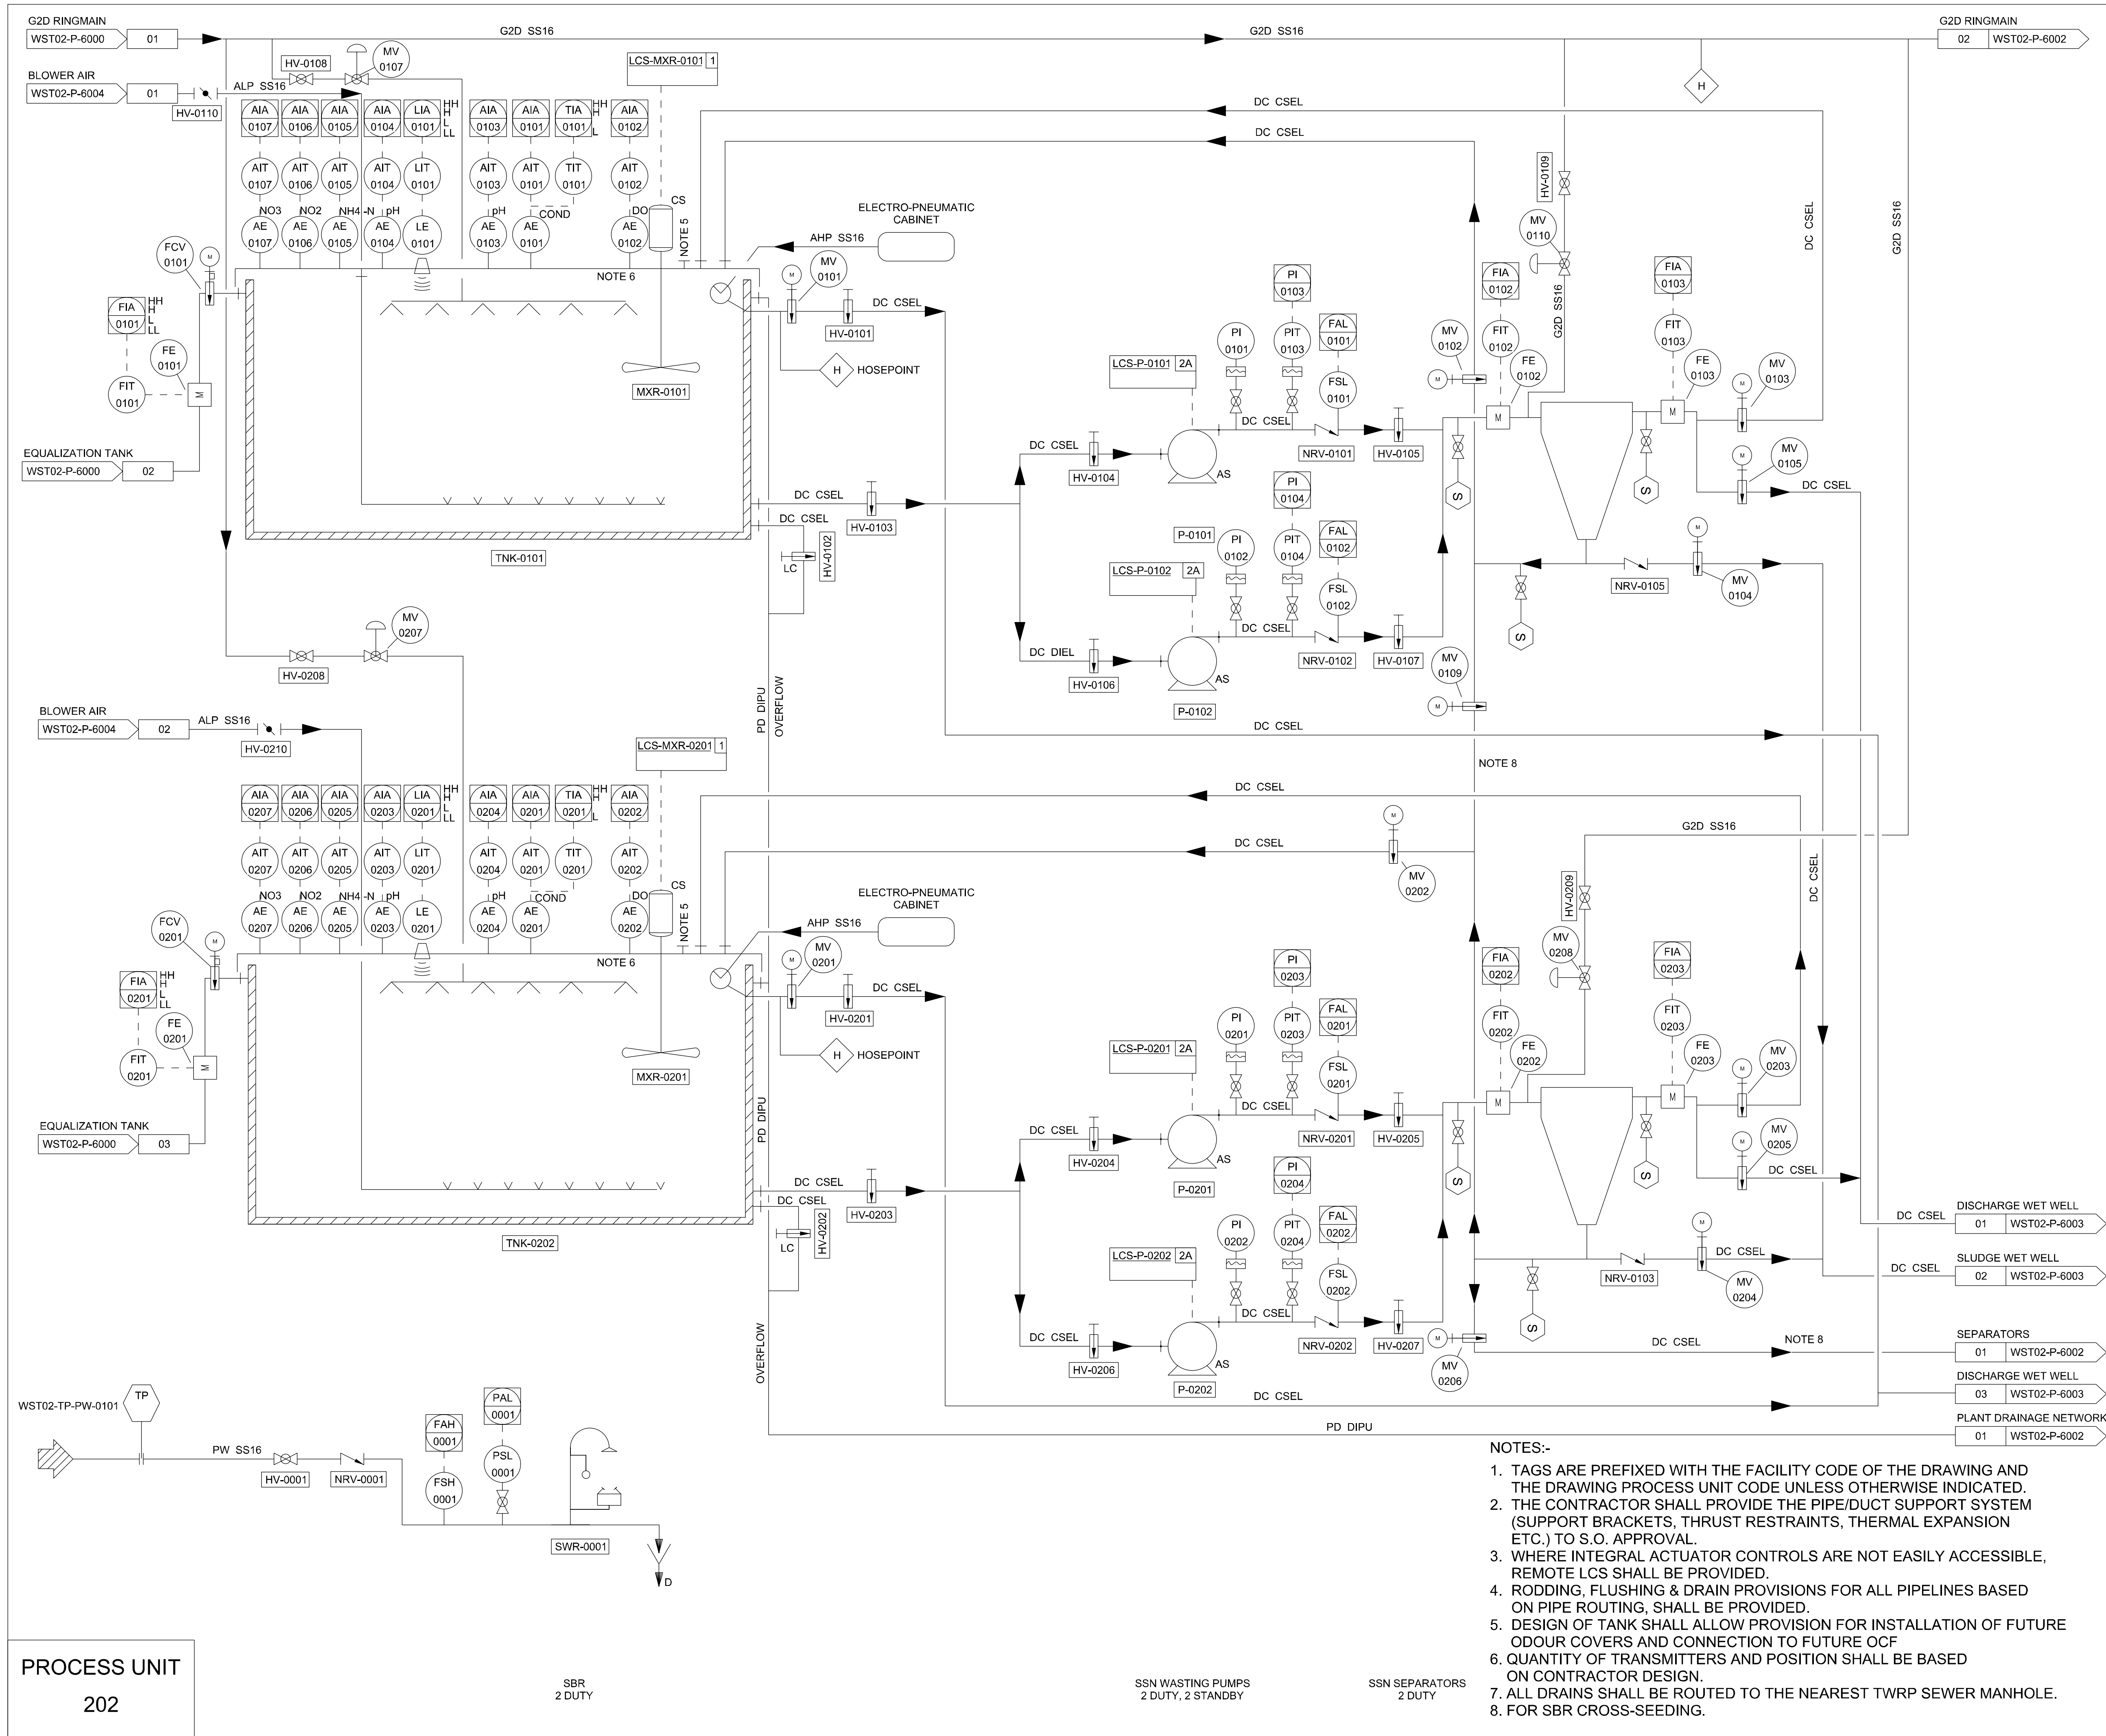

PROCESS UNIT
202

SBR
2 DUTY

SSN WASTING PUMPS
2 DUTY, 2 STANDBY

SSN SEPARATORS
2 DUTY

NOTES:-

1. TAGS ARE PREFIXED WITH THE FACILITY CODE OF THE DRAWING AND THE DRAWING PROCESS UNIT CODE UNLESS OTHERWISE INDICATED.
2. THE CONTRACTOR SHALL PROVIDE THE PIPE/DUCT SUPPORT SYSTEM (SUPPORT BRACKETS, THRUST RESTRAINTS, THERMAL EXPANSION ETC.) TO S.O. APPROVAL.
3. WHERE INTEGRAL ACTUATOR CONTROLS ARE NOT EASILY ACCESSIBLE, REMOTE LCS SHALL BE PROVIDED.
4. RODDING, FLUSHING & DRAIN PROVISIONS FOR ALL PIPELINES BASED ON PIPE ROUTING, SHALL BE PROVIDED.
5. DESIGN OF TANK SHALL ALLOW PROVISION FOR INSTALLATION OF FUTURE ODOUR COVERS AND CONNECTION TO FUTURE OCF
6. QUANTITY OF TRANSMITTERS AND POSITION SHALL BE BASED ON CONTRACTOR DESIGN.
7. ALL DRAINS SHALL BE ROUTED TO THE NEAREST TWRP SEWER MANHOLE.
8. FOR SBR CROSS-SEEDING.

TENDER

T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

P&ID
SIDESTREAM - N REMOVAL
DEAMMONIFICATION REACTORS 1&2

DRAFTED: RSR	DESIGNED: 11/12/2021KV	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 04/07/19	REVIEWED: CN	PBS: 131101

CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP	REVISION:
-	SHEET NUMBER: WST02-P-6001	T1
THIS DRAWING IS COPYRIGHT		