


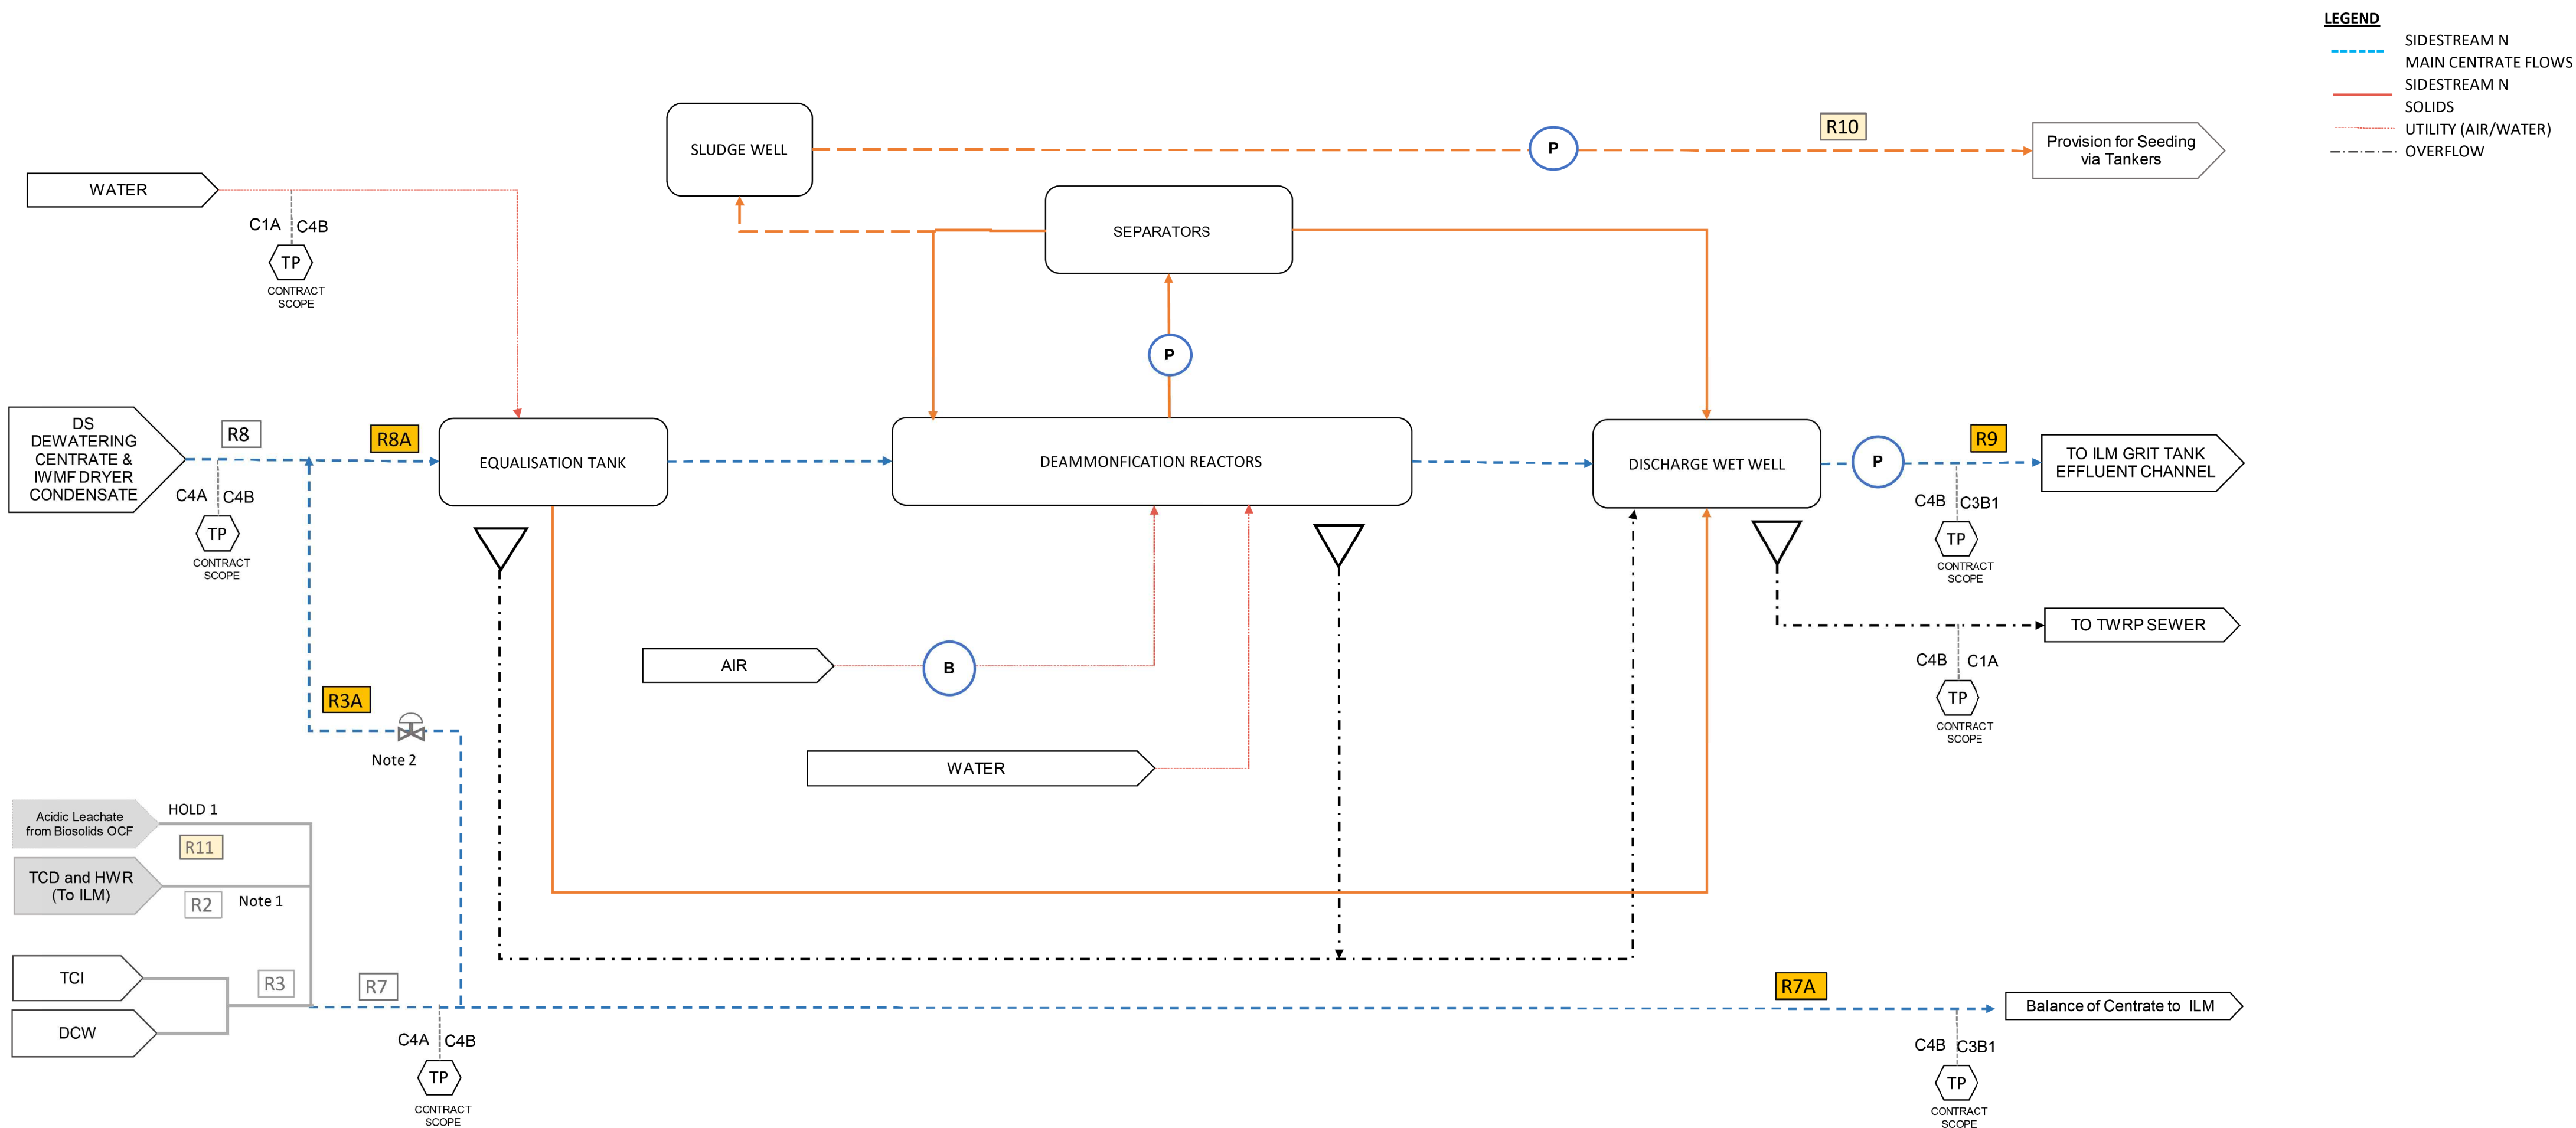

STREAM		R3A	R8A (Note 4)	R9	R7A	R11	R10
		TCI & DCW (To SS For blending) ¹	Feed to Sidestream N	SideStream Effluent	TC/DCW to ILM	Acidic Leachate	Provision for Seeding
Component Description (for D/S)				Pump			Pump
Number of Duty Units	#	--	--	2	--	--	1
Number of Standby Units	#	--	--	2	--	--	1
Annual Average TS Mass Load	tDS/d	4.4	17.0	17.0	28.1	--	--
Maximum Monthly TS Mass Load	tDS/d	5.5	21.1	21.1	37.0	--	--
Average TS concentration	%DS	0.09	0.17	0.17	0.08	--	--
Maximum TS concentration	%DS	0.09	0.17	0.17	0.08	--	--
Annual Average Flow @ Avg. conc.	m³/d	4895	10219	10219	34714	HOLD 1	--
Maximum Monthly Flow @ Avg. conc.	m³/d	6052	12642	12642	45609	--	--

NOTES

- Depending on the operational requirements, the TCD and HWR from TCD Wet Well may be partially sent to ILM as well.
- For Sidestream N feed blending requirements. Balance of the thickening centrate stream will be routed back to ILM headworks.
- Refer to Biosolids main PFD (131101-WSD00-CL-P-0001) for Streams R3, R2, R8 and R7
- Based on 1:1 Dilution /blending of DC (Stream R8) with R7 thickening centrates stream. Blending ratio and flows shall be confirmed by Contractor based on requirement.

HOLD

- Acidic leachate from Biosolids OCF may be routed to TCD and TCI Wet Well depending on final arrangement. Maximum expected flowrate is 10L/S

TENDER

T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

PFD
SIDESTREAM N REMOVAL

DRAFTED: AM	DESIGNED: JZ	SHEET SIZE: A1
DRAFTING CHECK: ASR	DESIGN CHECK: CN	SCALE: NTS
DATE: 12/11/21	REVIEWED: CN	PBS: 131101
CONTRACT: -	DRAWING NUMBER: PUB-DTSS2-TWRP	REVISION: T1

THIS DRAWING IS COPYRIGHT