

INSTRUMENT IDENTIFICATION


INSTRUMENT IDENTIFICATION LETTERS TABLE

LETTER	FIRST-LETTER		SUCCEEDING-LETTERS		
	PROCESS OR INITIATING VARIABLE	MODIFIER	READOUT OR PASSIVE FUNCTION	READOUT OR PASSIVE FUNCTION	READOUT OR PASSIVE FUNCTION
A	ANALYSIS (+)		ALARM		
B	BURNER, COMBUSTION		USER'S CHOICE (*)	USER'S CHOICE (*)	USER'S CHOICE (*)
C	USER'S CHOICE (*)			CONTROL	
D	DENSITY (S.G.)	DIFFERENTIAL			
E	VOLTAGE		PRIMARY ELEMENT, SENSOR		
F	FLOW RATE	RATIO (FRACTION)			
G	USER'S CHOICE (*)		GLASS, GAUGE VIEWING DEVICE	GATE	
H	HAND (MANUAL)				HIGH
I	CURRENT (ELECTRICAL)		INDICATE		
J	POWER	SCAN			
K	TIME, TIME SCHEDULE	TIME RATE OF CHANGE		CONTROL STATION	
L	LEVEL		LIGHT (PILOT)		LOW
M	MOTION	MOMENTARY			MIDDLE, INTERMEDIATE
N	TORQUE		USER'S CHOICE (*)	USER'S CHOICE (*)	USER'S CHOICE (*)
O	USER'S CHOICE (*)		ORIFICE, RESTRICTION		
P	PRESSURE, VACUUM		POINT (TEST) CONNECTION		
Q	QUANTITY	INTEGRATE, TOTALIZE			
R	RADIATION		RECORD OR PRINT		
S	SPEED, FREQUENCY	SAFETY		SWITCH	
T	TEMPERATURE			TRANSMIT	
U	MULTI VARIABLE		MULTI FUNCTION	MULTI FUNCTION	MULTI FUNCTION
V	VIBRATION, MECHANICAL ANALYSIS			VALVE, DAMPER, LOUVER	
W	WEIGHT, FORCE		WELL		
X	UNCLASSIFIED (*)	X AXIS	UNCLASSIFIED (*)	UNCLASSIFIED (*)	UNCLASSIFIED (*)
Y	EVENT, STATE OR PRESENCE	Y AXIS		RELAY, COMPUTE, CONVERT	
Z	POSITION	Z AXIS		DRIVE, ACTUATOR, UNCLASSIFIED FINAL CONTROL ELEMENT	


TABLE BASED ON THE INSTRUMENTATION, SYSTEMS, AND AUTOMATION SOCIETY (ISA) STANDARD.

(+) WHEN USED, EXPLANATION IS SHOWN ADJACENT TO INSTRUMENT SYMBOL. SEE ABBREVIATIONS AND LETTER SYMBOLS.
(*) WHEN USED, DEFINE THE MEANING HERE FOR THE PROJECT.

EXAMPLE P&ID SYMBOL

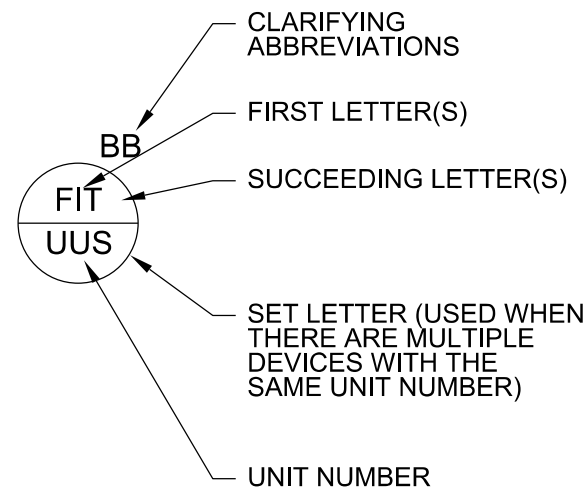

GENERAL INSTRUMENT OR FUNCTIONAL SYMBOLS

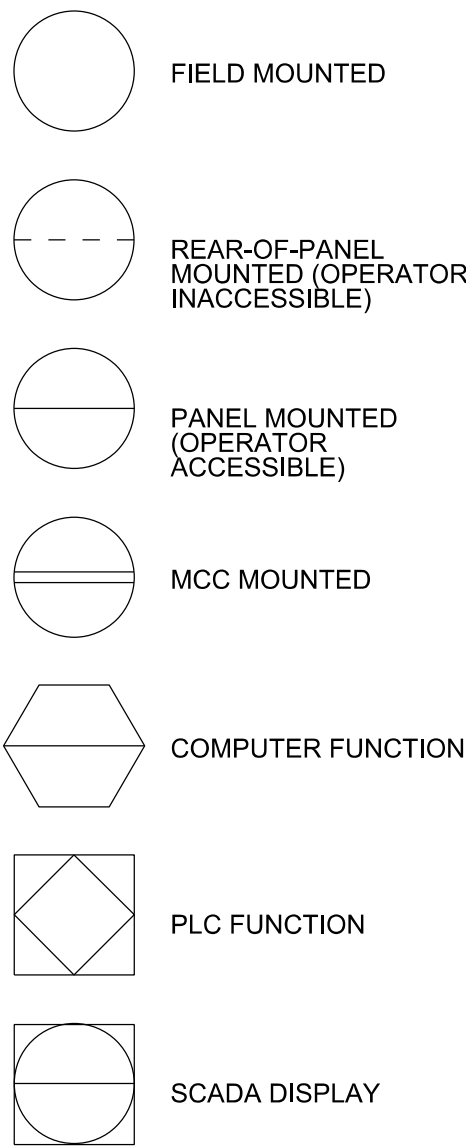

TRANSDUCERS


A	ANALOG	I	CURRENT
D	DIGITAL	P	PNEUMATIC
E	VOLTAGE	PF	PULSE FREQUENCY
F	FREQUENCY	PD	PULSE DURATION
H	HYDRAULIC	R	RESISTANCE

EXAMPLE




ACCESSORY DEVICES

EXAMPLE

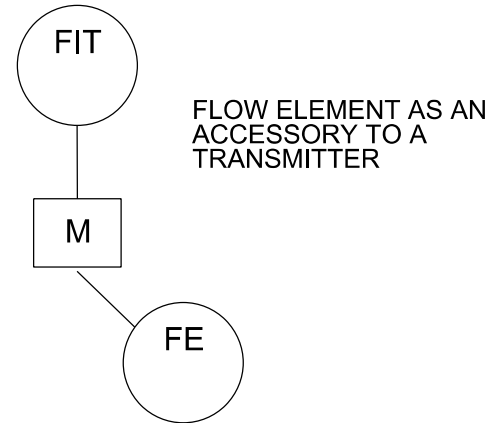

SPECIAL CASES

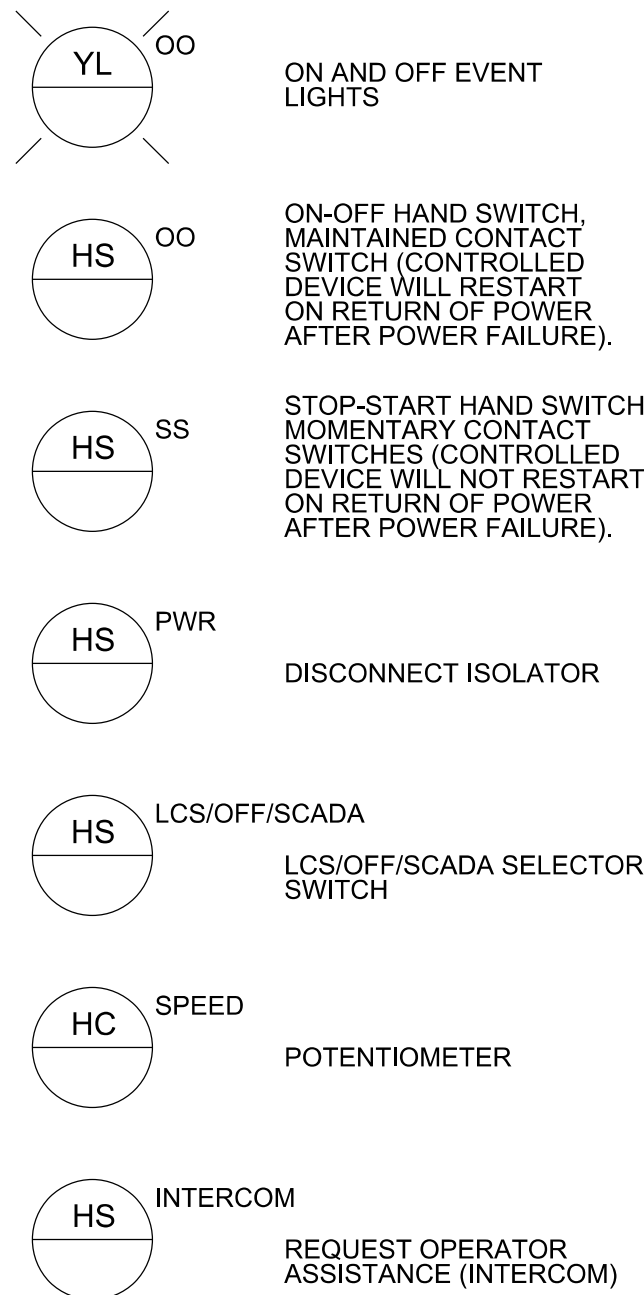

STANDARD NOTES:

1. ALL FIT ARE DEPICTED AS LOCAL TRANSMITTERS (MOUNTED ON WITH FLOW ELEMENT). FIT SHALL USE REMOTE TRANSMITTERS WHENEVER REQUIRED TO ENSURE OPERATOR ACCESS TO TRANSMITTER.

TENDER

T1	20/05/22	ISSUED FOR TENDER C4B	CN	GOT
T1	02/07/21	ISSUED FOR TENDER C3D2	CN	GOT
T1	18/12/20	ISSUED FOR TENDER C3B1	CN	GOT
T1	23/07/20	ISSUED FOR TENDER C2B	CN	GOT
T1	24/04/20	ISSUED FOR TENDER C3A	CN	GOT
T1	08/04/20	ISSUED FOR TENDER C3D1	CN	GOT
REV	DATE	DESCRIPTION	REVIEWED	AUTHORISED

CLIENT:



PROGRAMME MANAGER:



CONSULTANT:



PROJECT TITLE:

TUAS WATER RECLAMATION PLANT (TWRP)
DTSS PHASE 2

DRAWING TITLE

P&ID LEGEND
INSTRUMENT IDENTIFICATION

DRAFTED: MW	DESIGNED: CSY	SHEET SIZE: A1
DRAFTING CHECK: DW	DESIGN CHECK: JL	SCALE: NTS
DATE: 29/11/17	REVIEWED: CN	PBS: 131101

CONTRACT:	DRAWING NUMBER: PUB-DTSS2-TWRP	
-	SHEET NUMBER: WSW00-P-0004	REVISION: T1

THIS DRAWING IS COPYRIGHT