

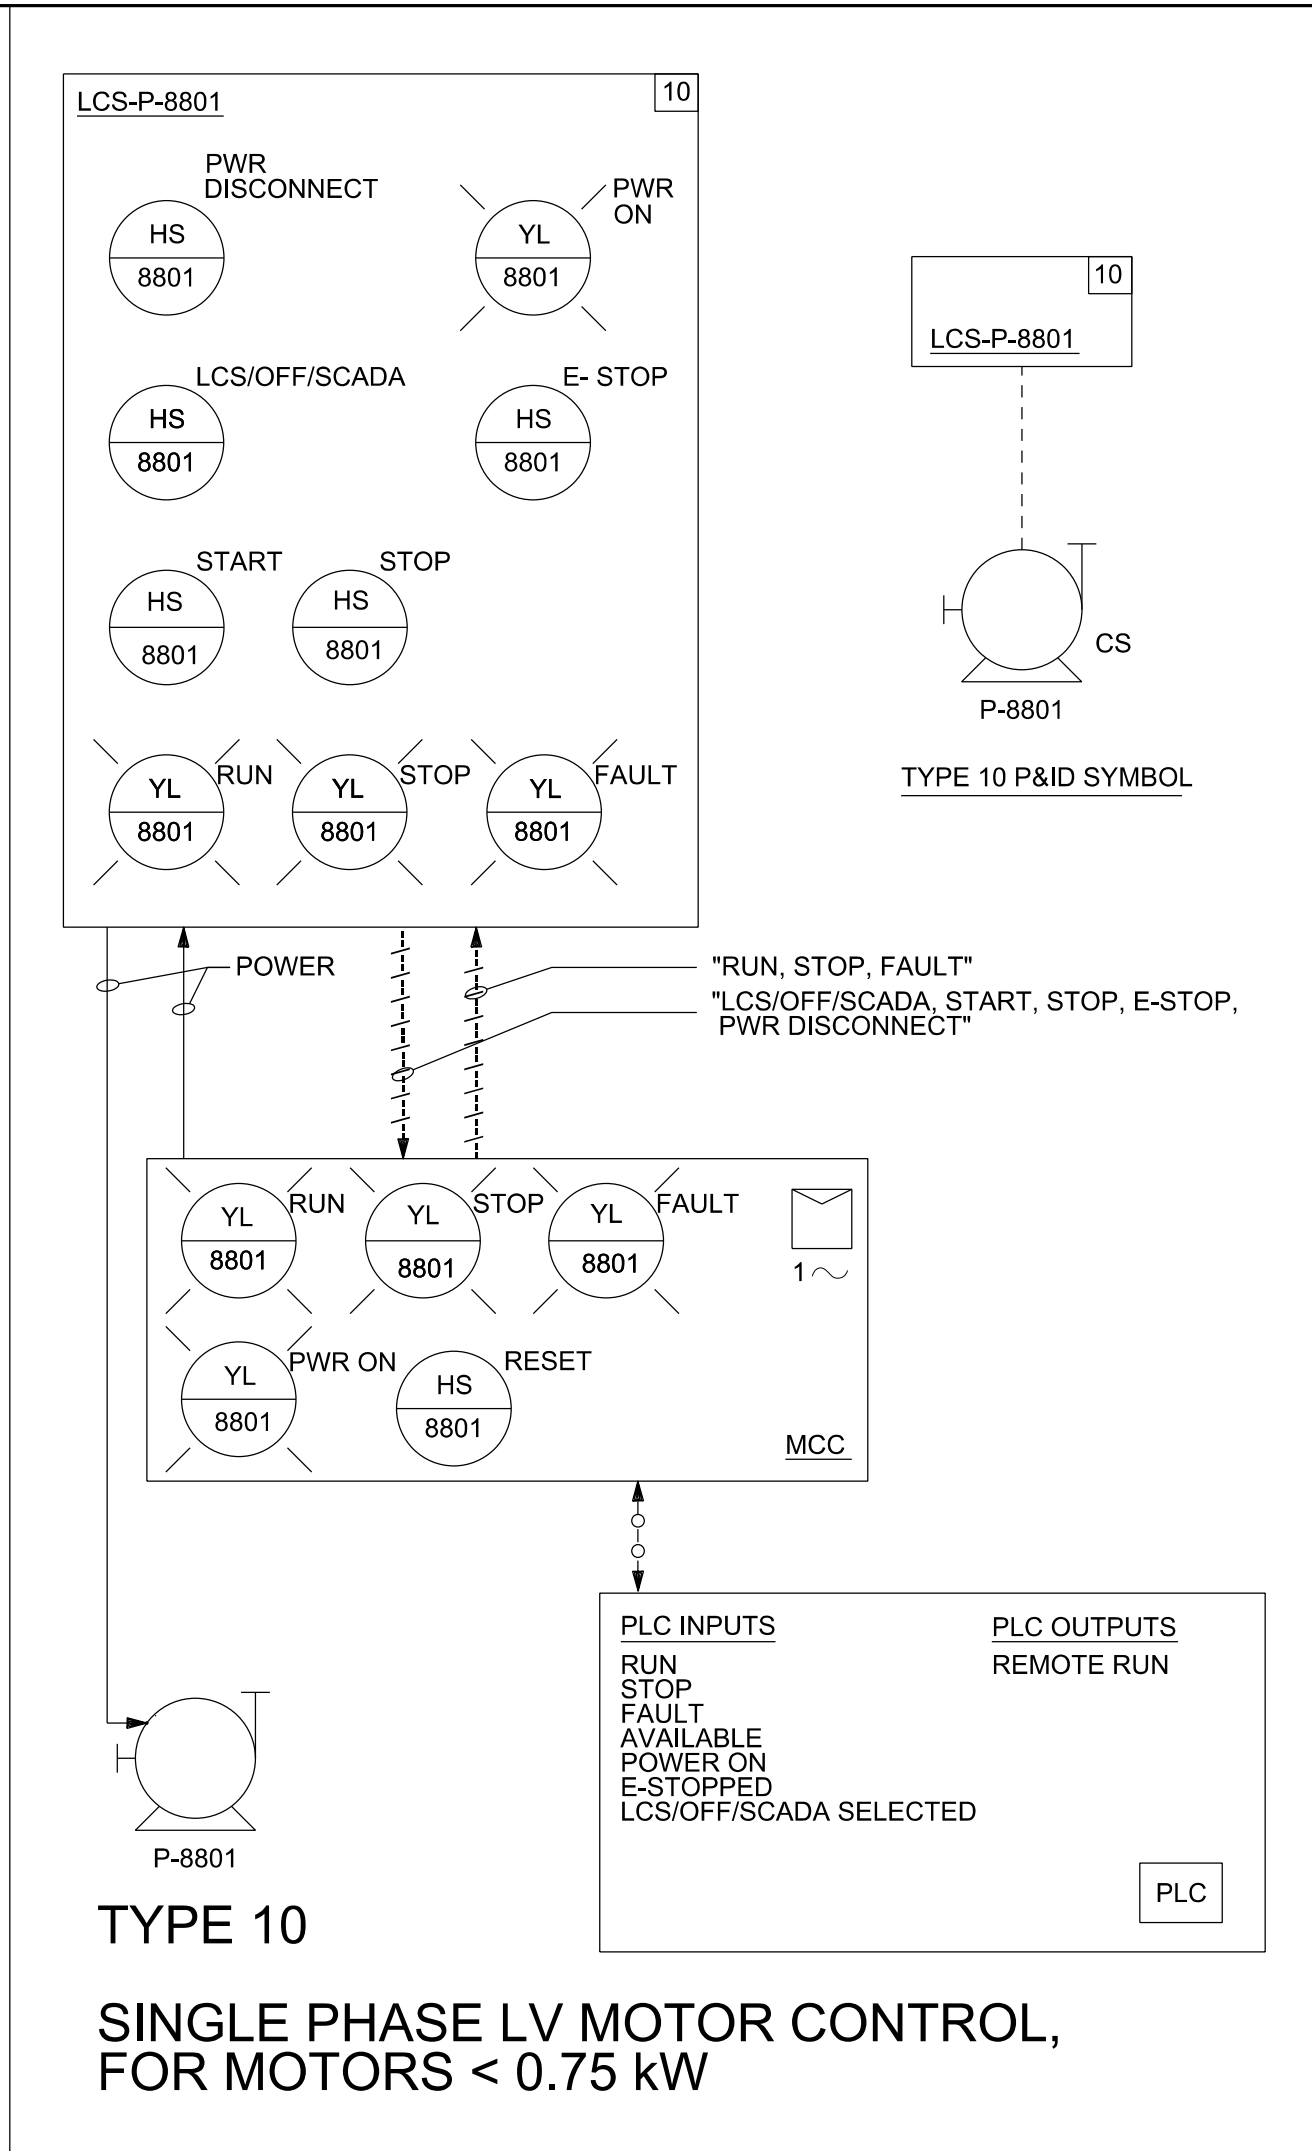
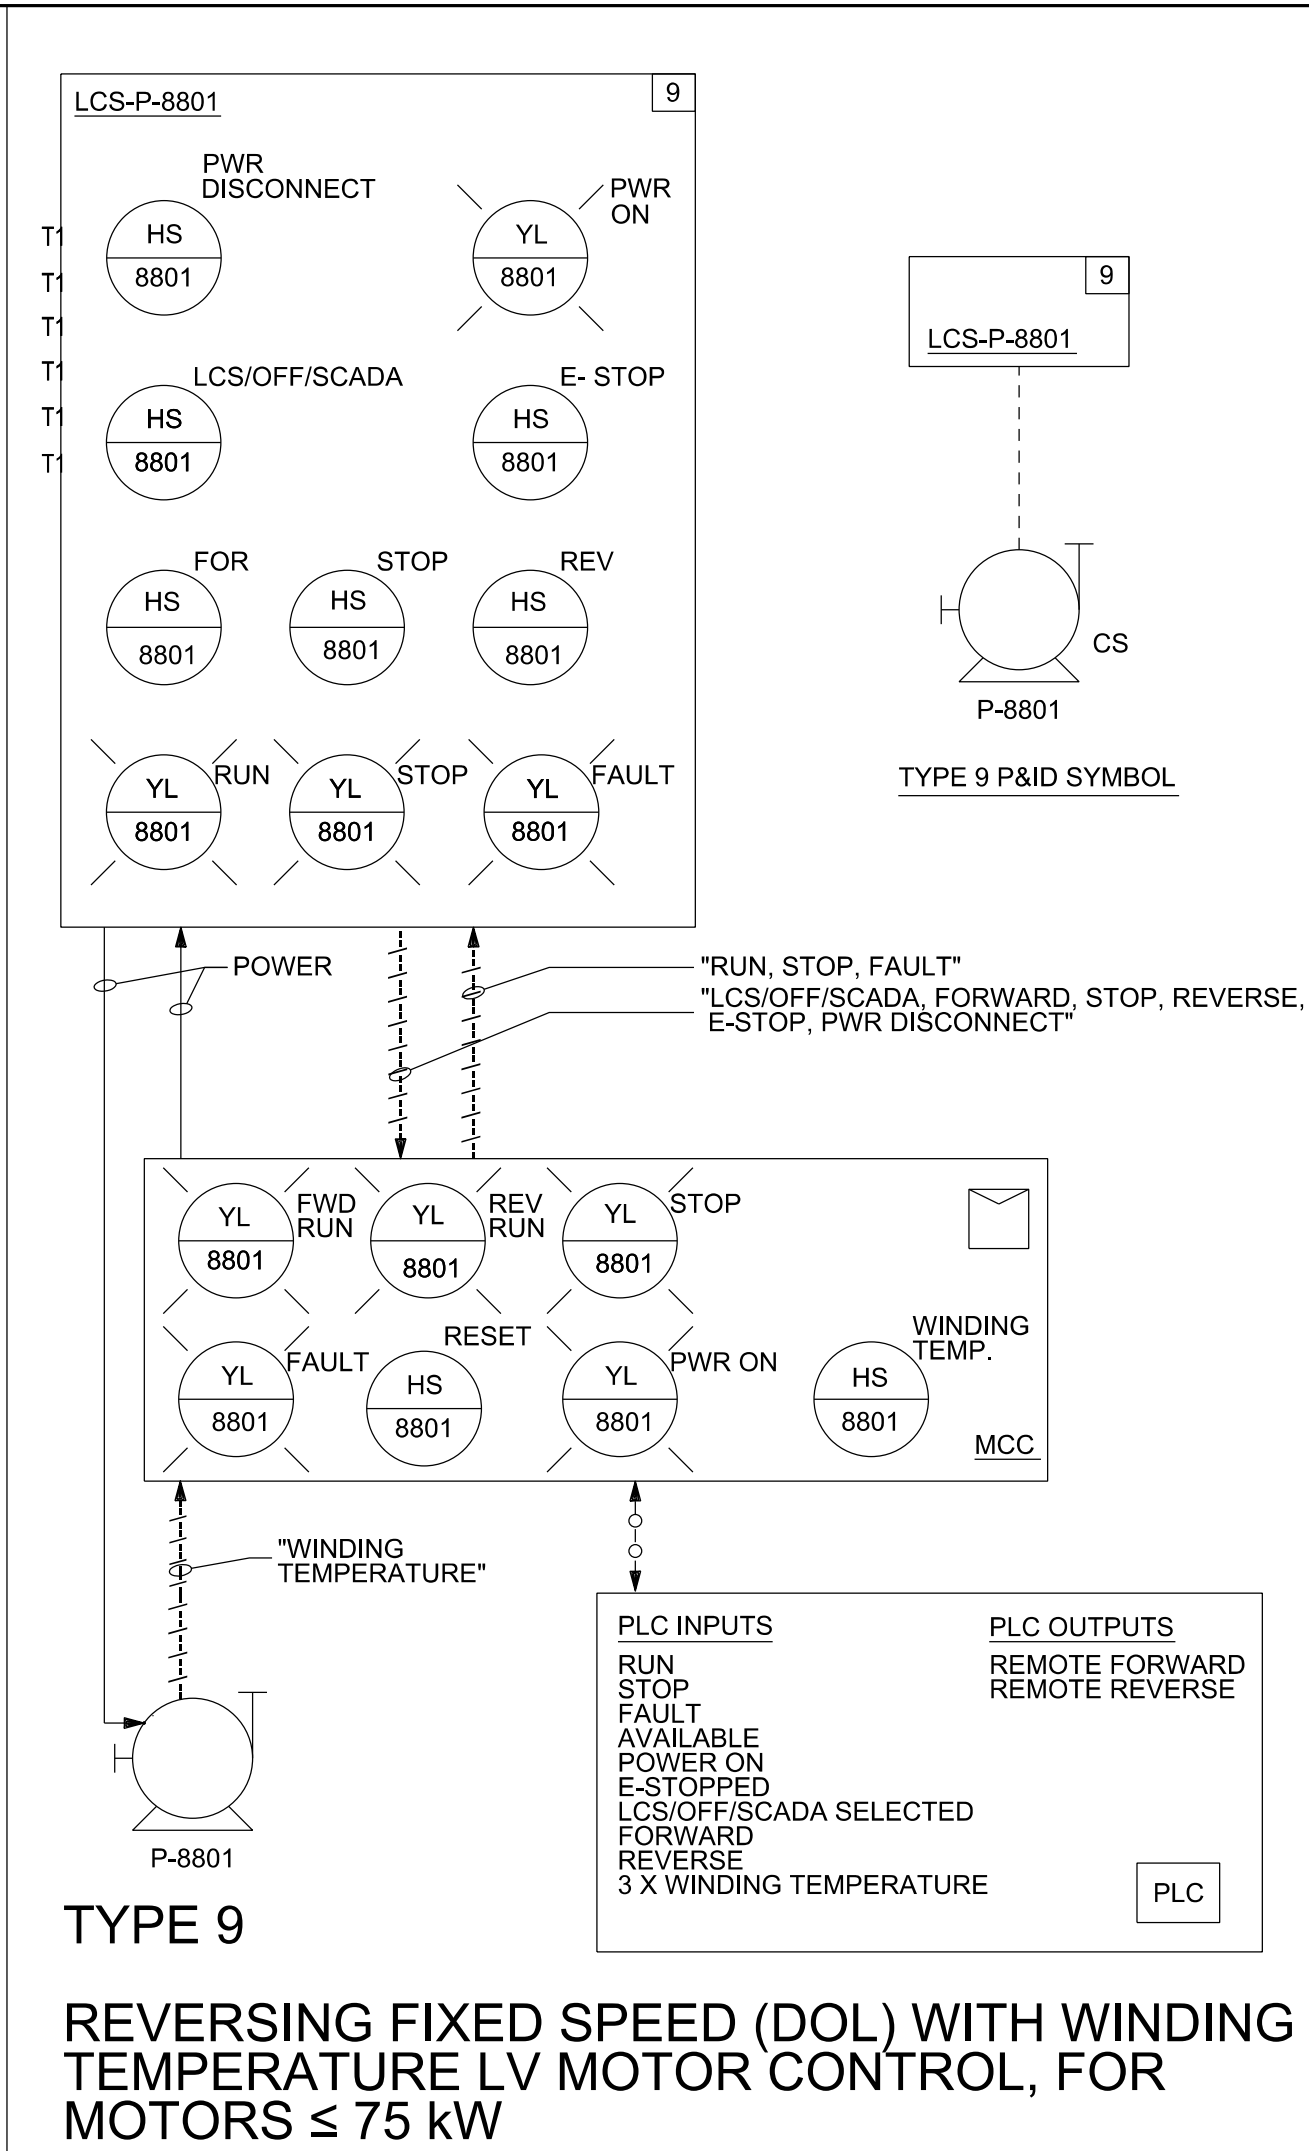
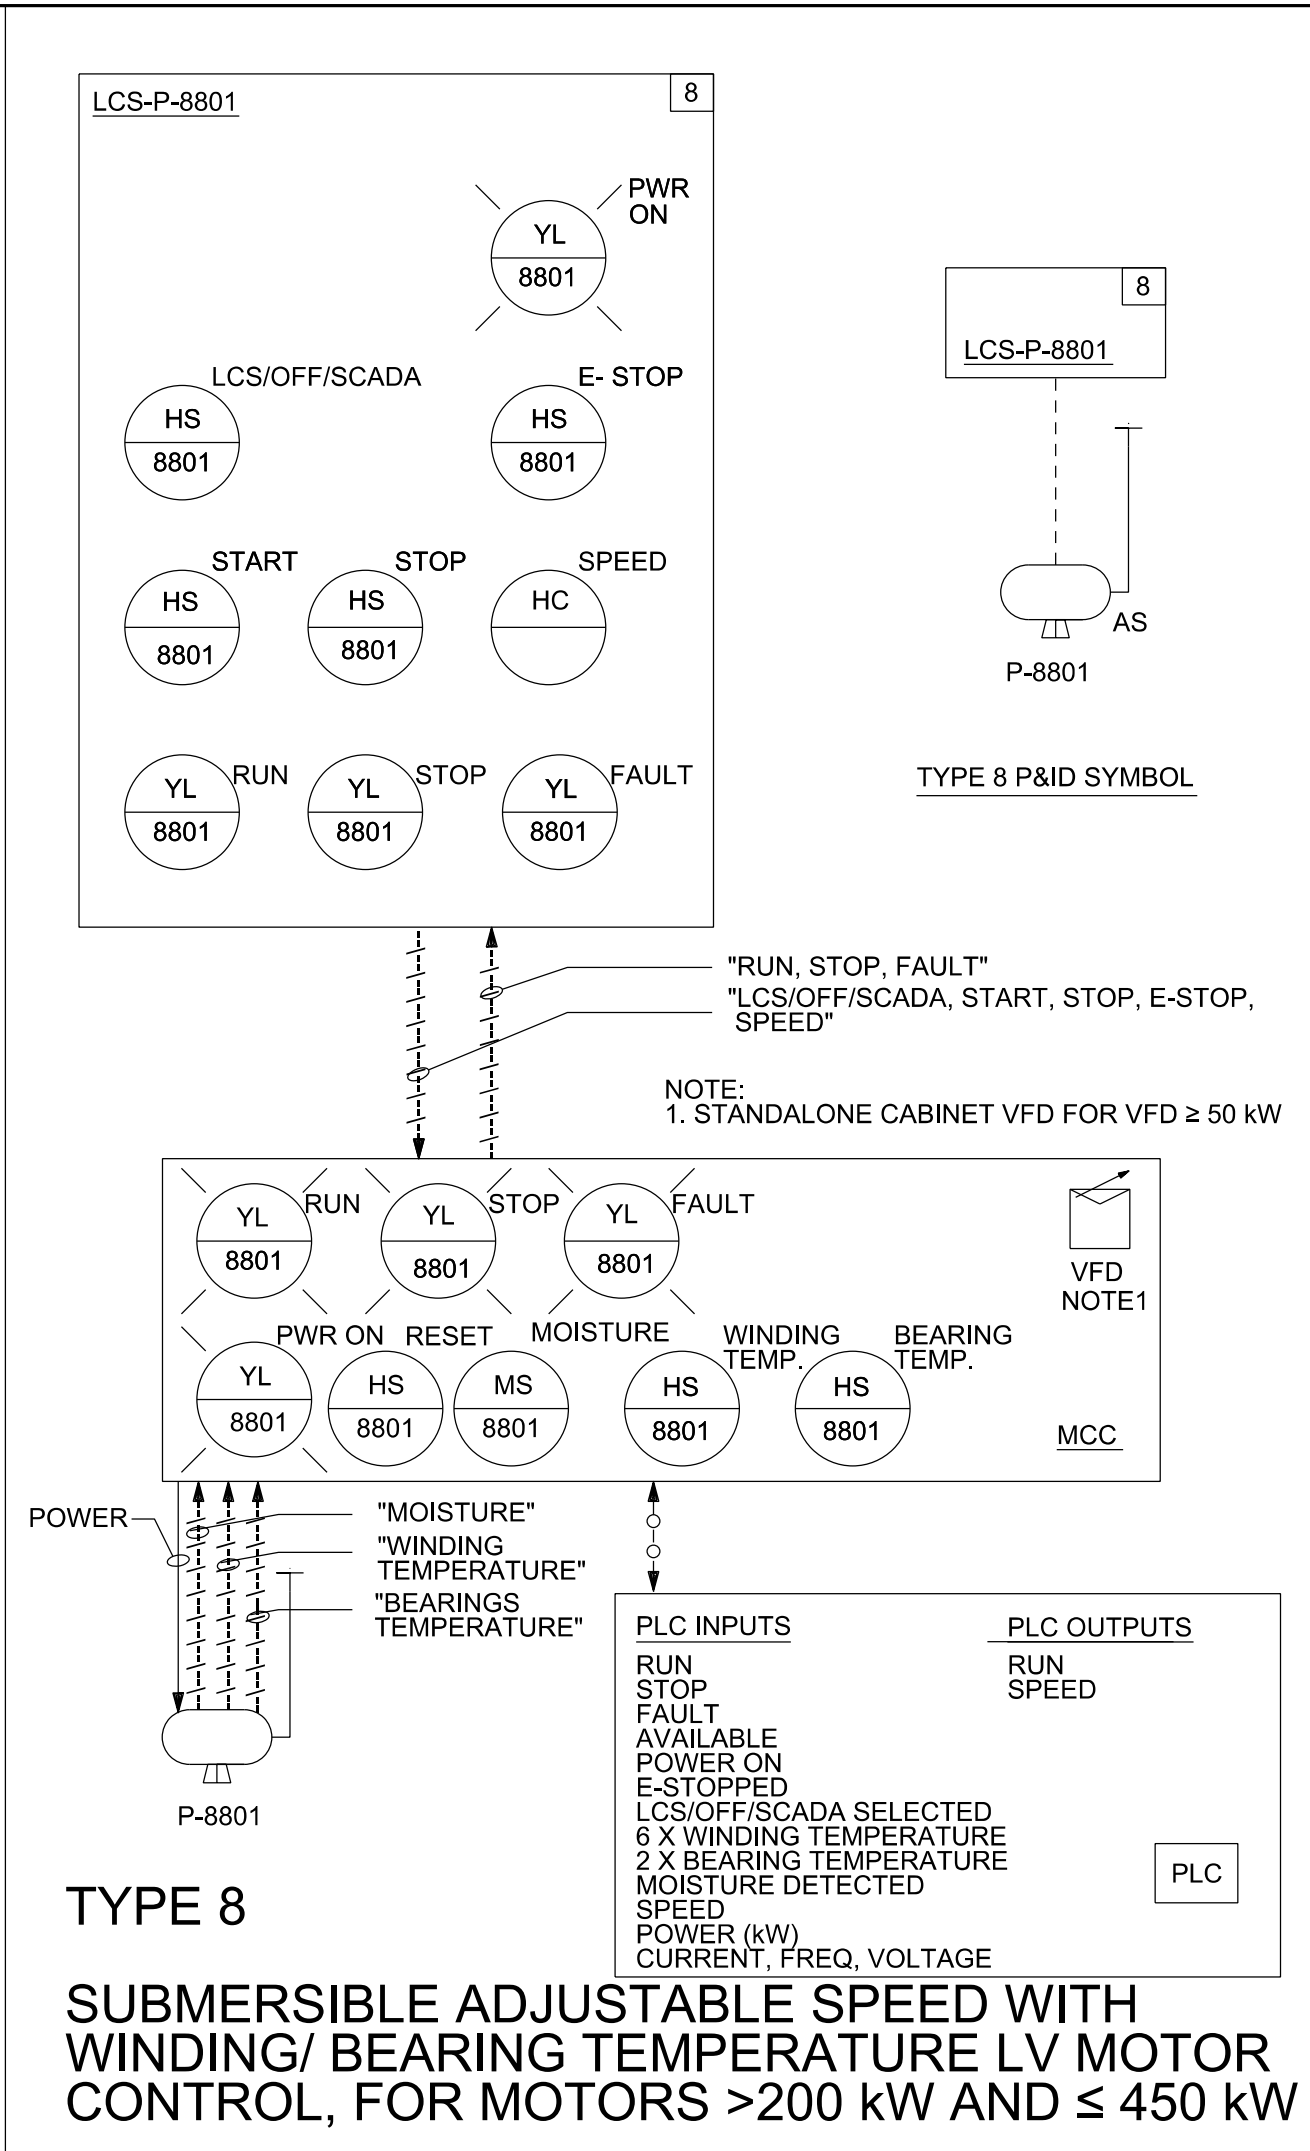
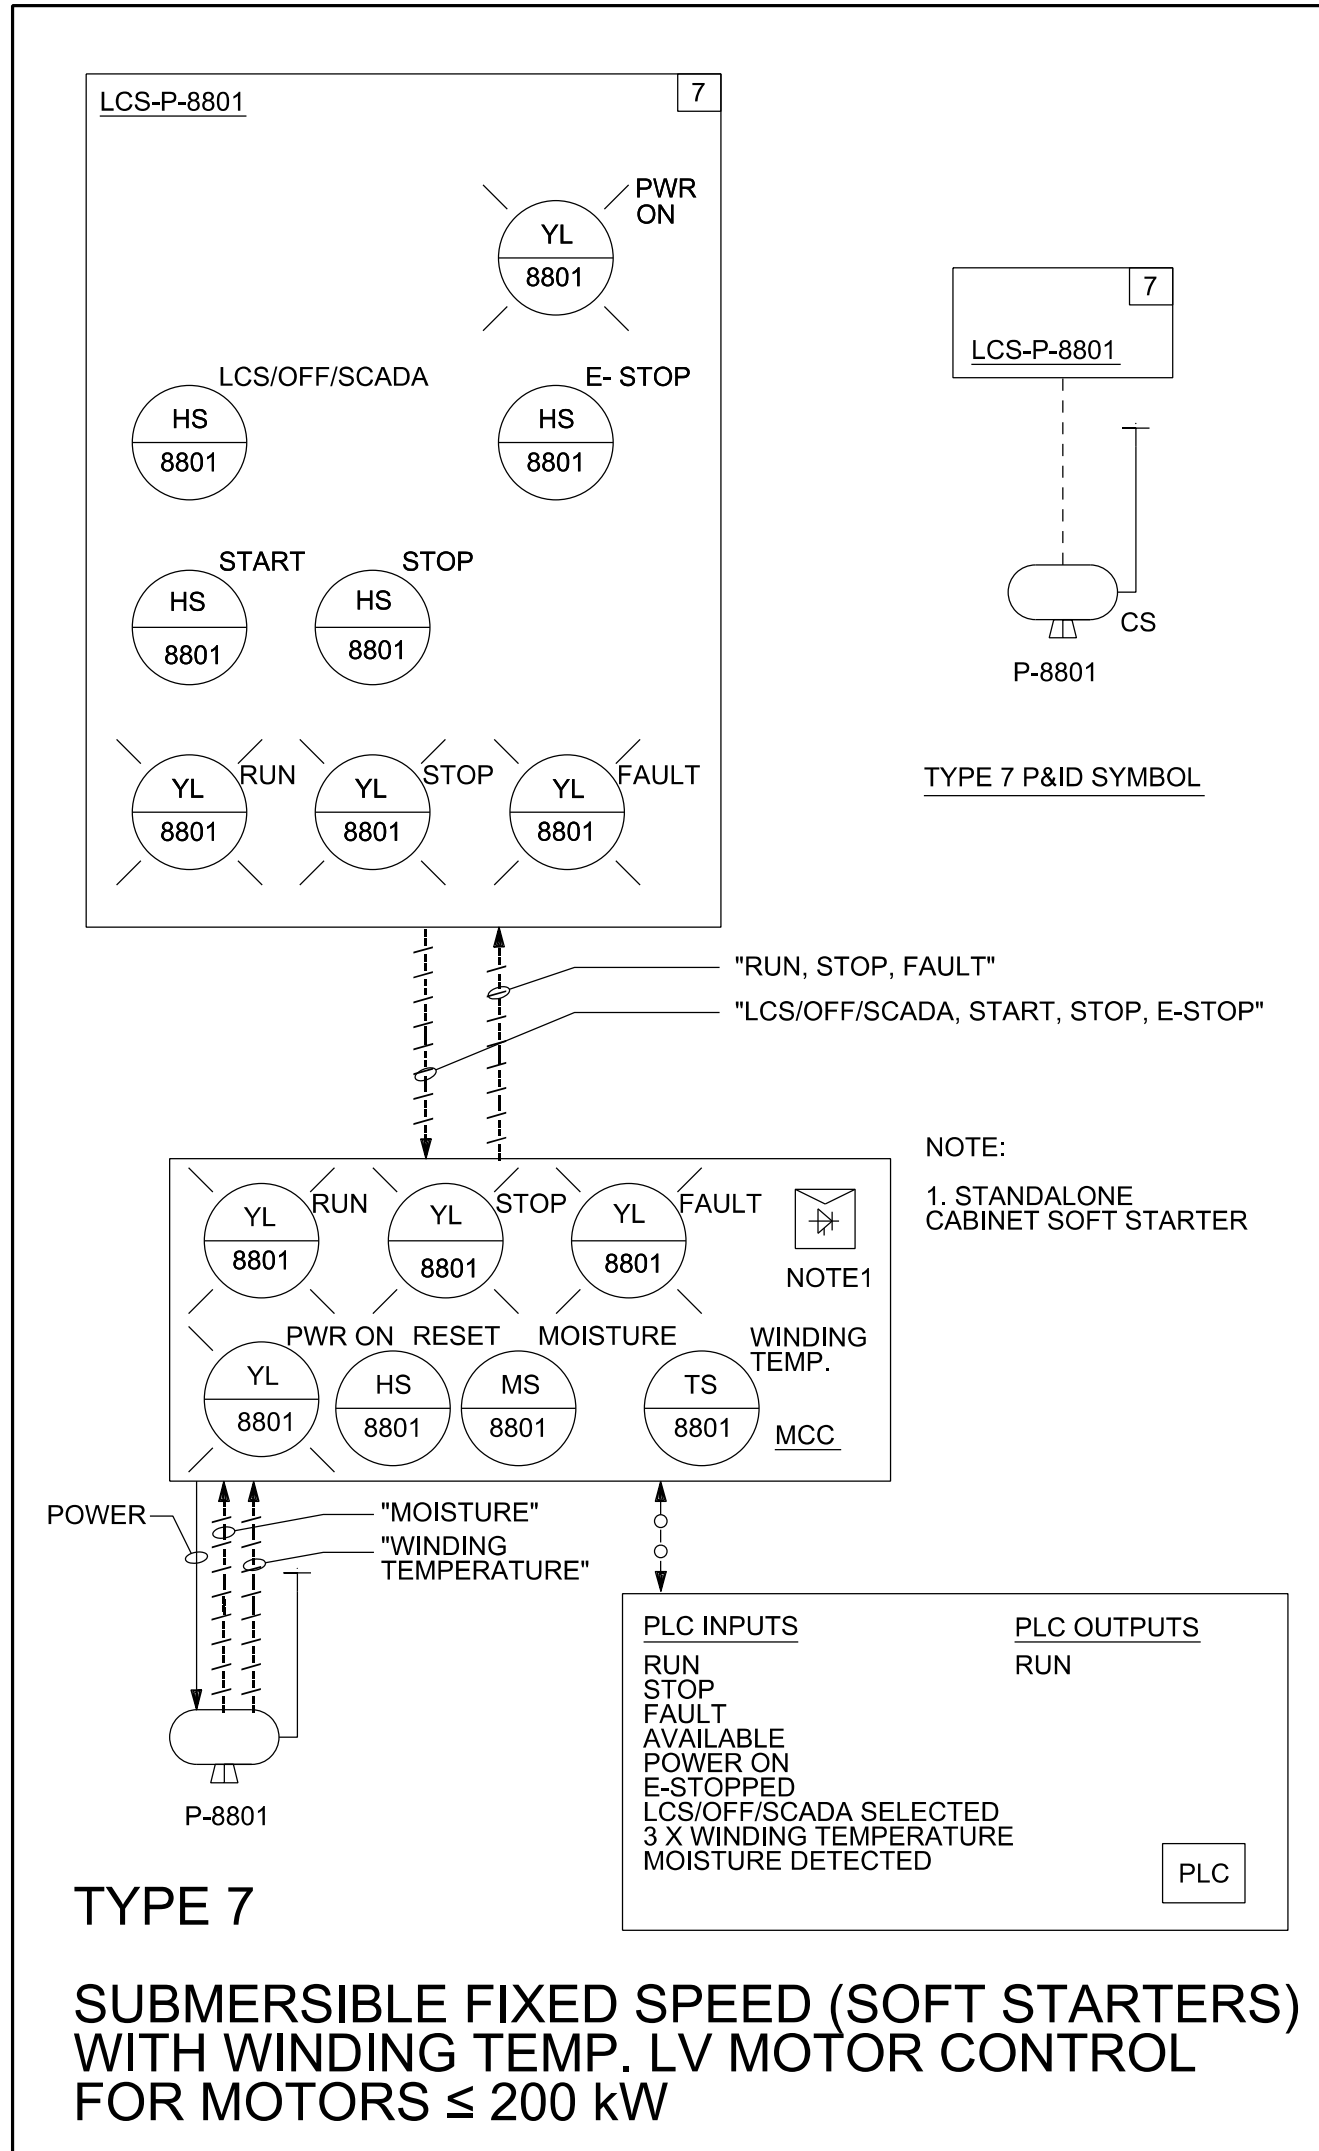
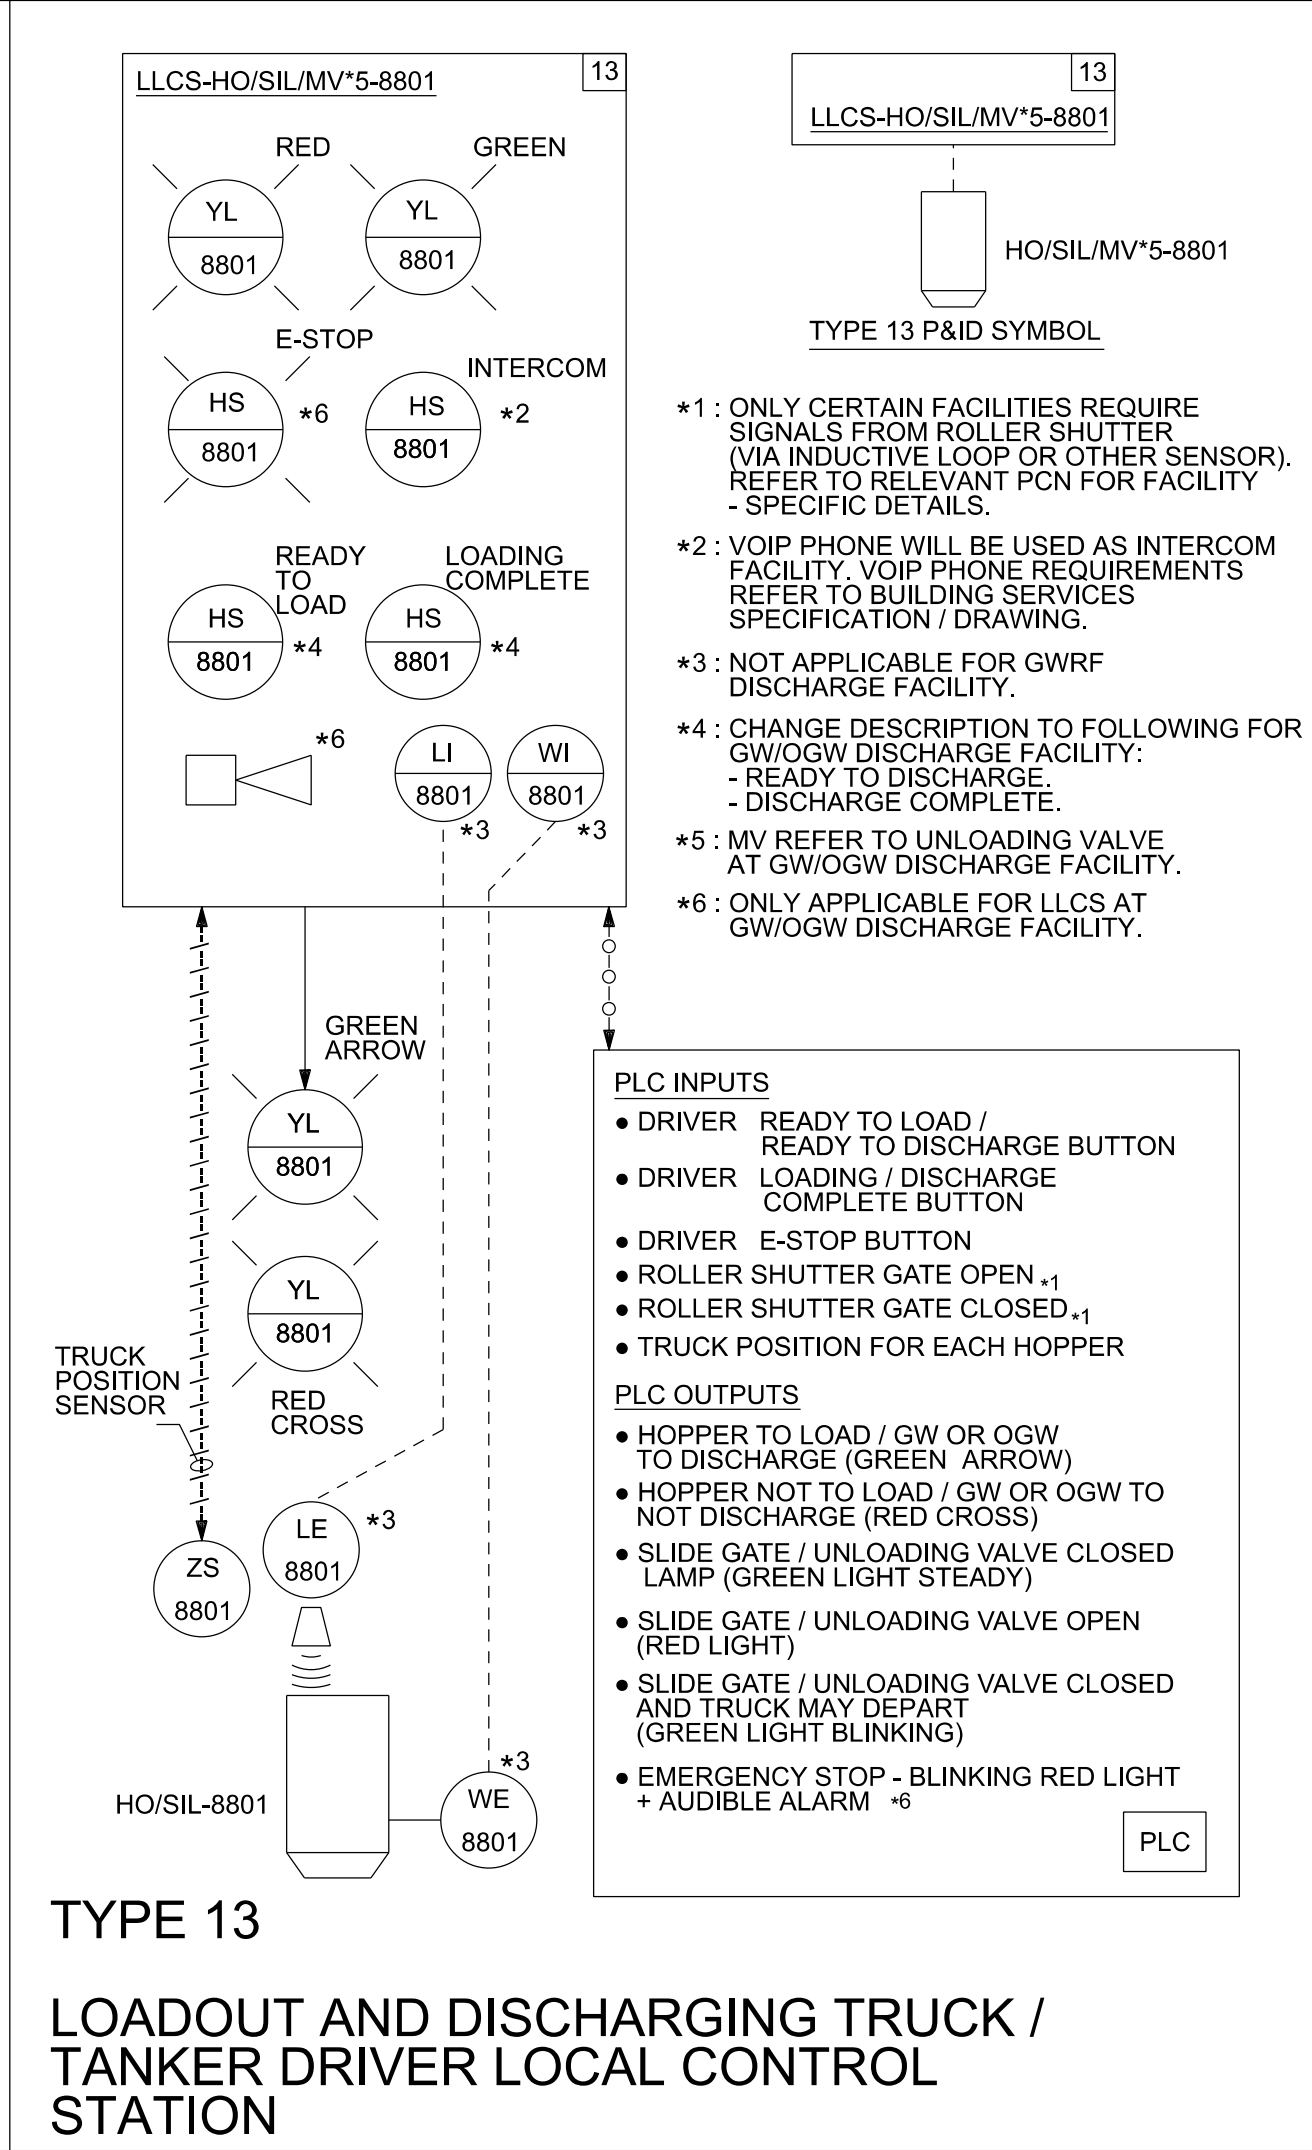
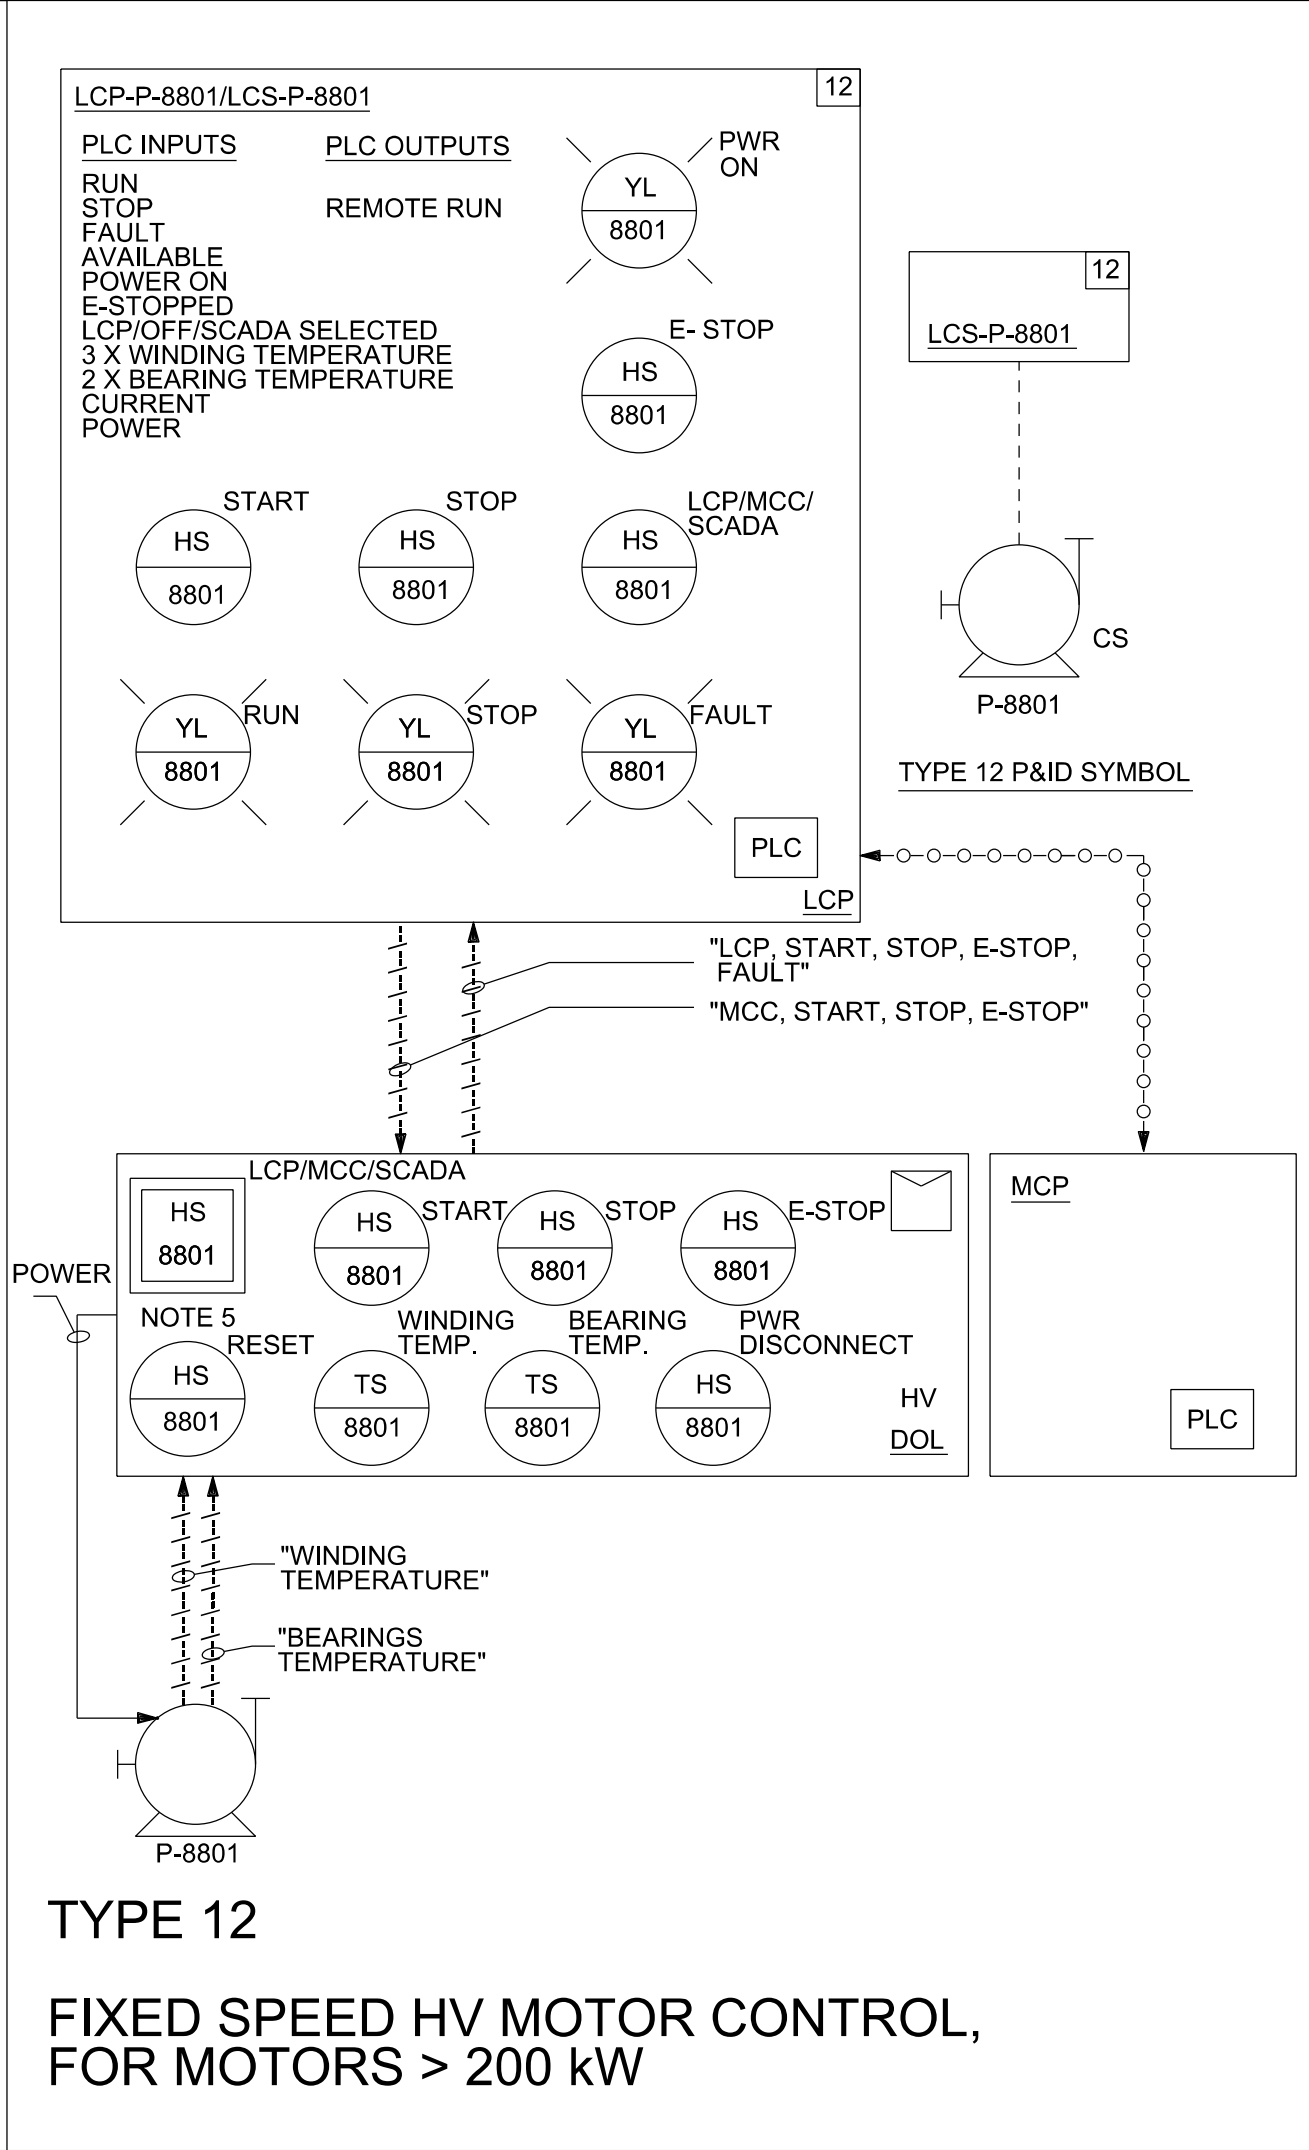


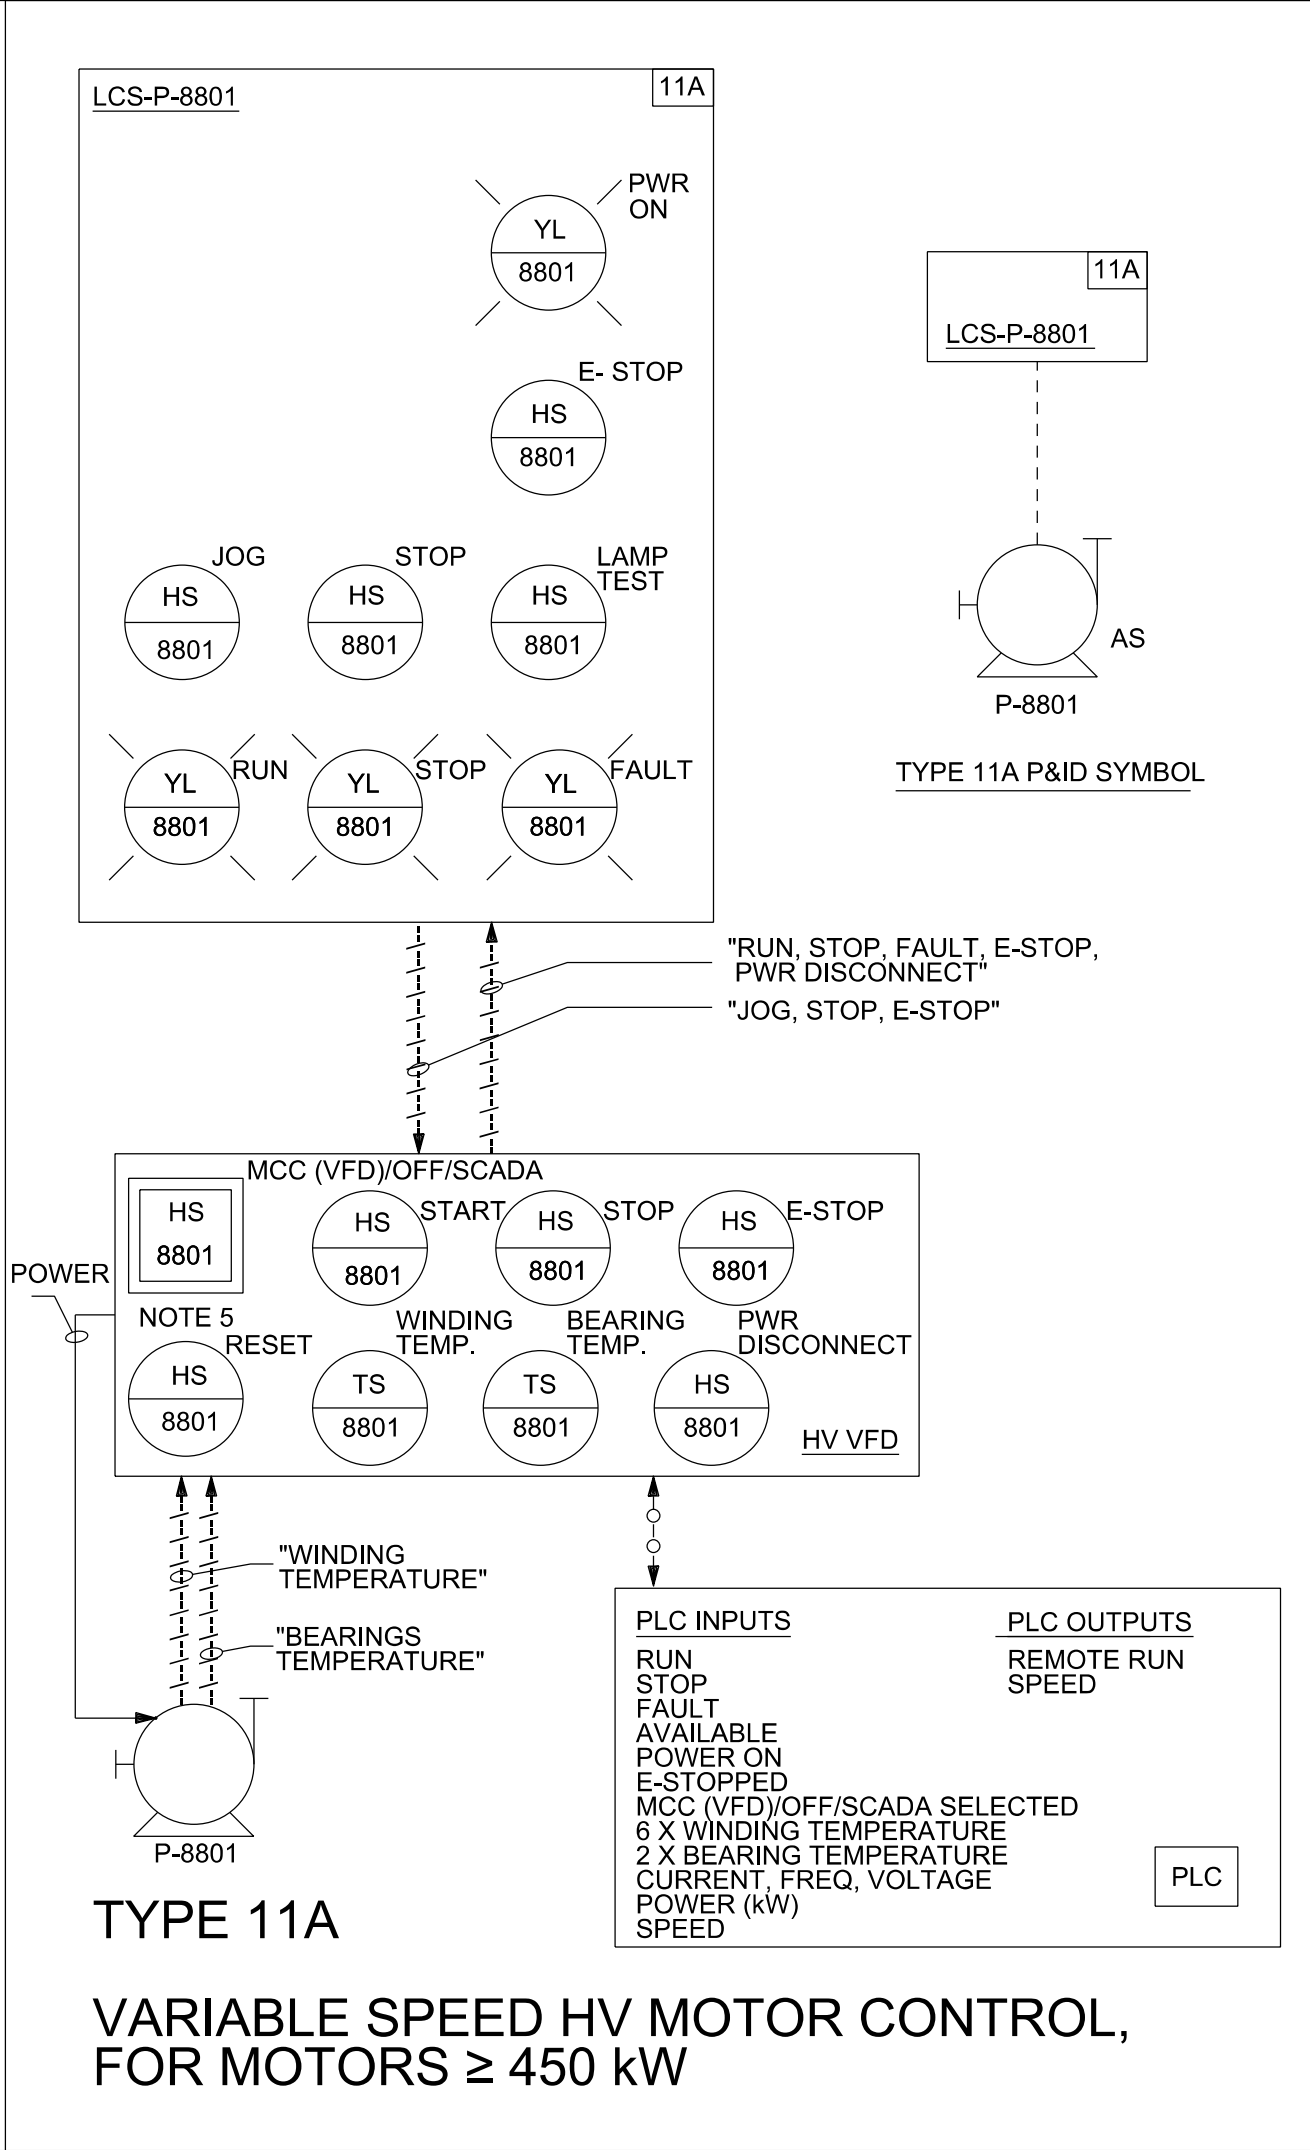

NOTES:

- STANDARD LCS TYPICAL, MAY BE USED FOR ANY EQUIPMENT. PUMP SYMBOL INDICATIVE ONLY.
- LOCAL CONTROLS FOR ACTUATOR SHALL BE INTEGRAL TO ACTUATOR UNLESS INACCESSIBLE.
- PROVIDE STAND ALONE LCS FOR EACH INACCESSIBLE ACTUATOR.
- FMP SELECTOR SWITCH REFERS TO: FIELD (LCP) / MCC (HV DOL) / PLC (MCP).
- ELECTRONIC INTERFACE UNIT INCLUDING MANUAL SPEED ADJUSTMENT.
- APPLICABLE ONLY FOR INFLUENT PUMPS.

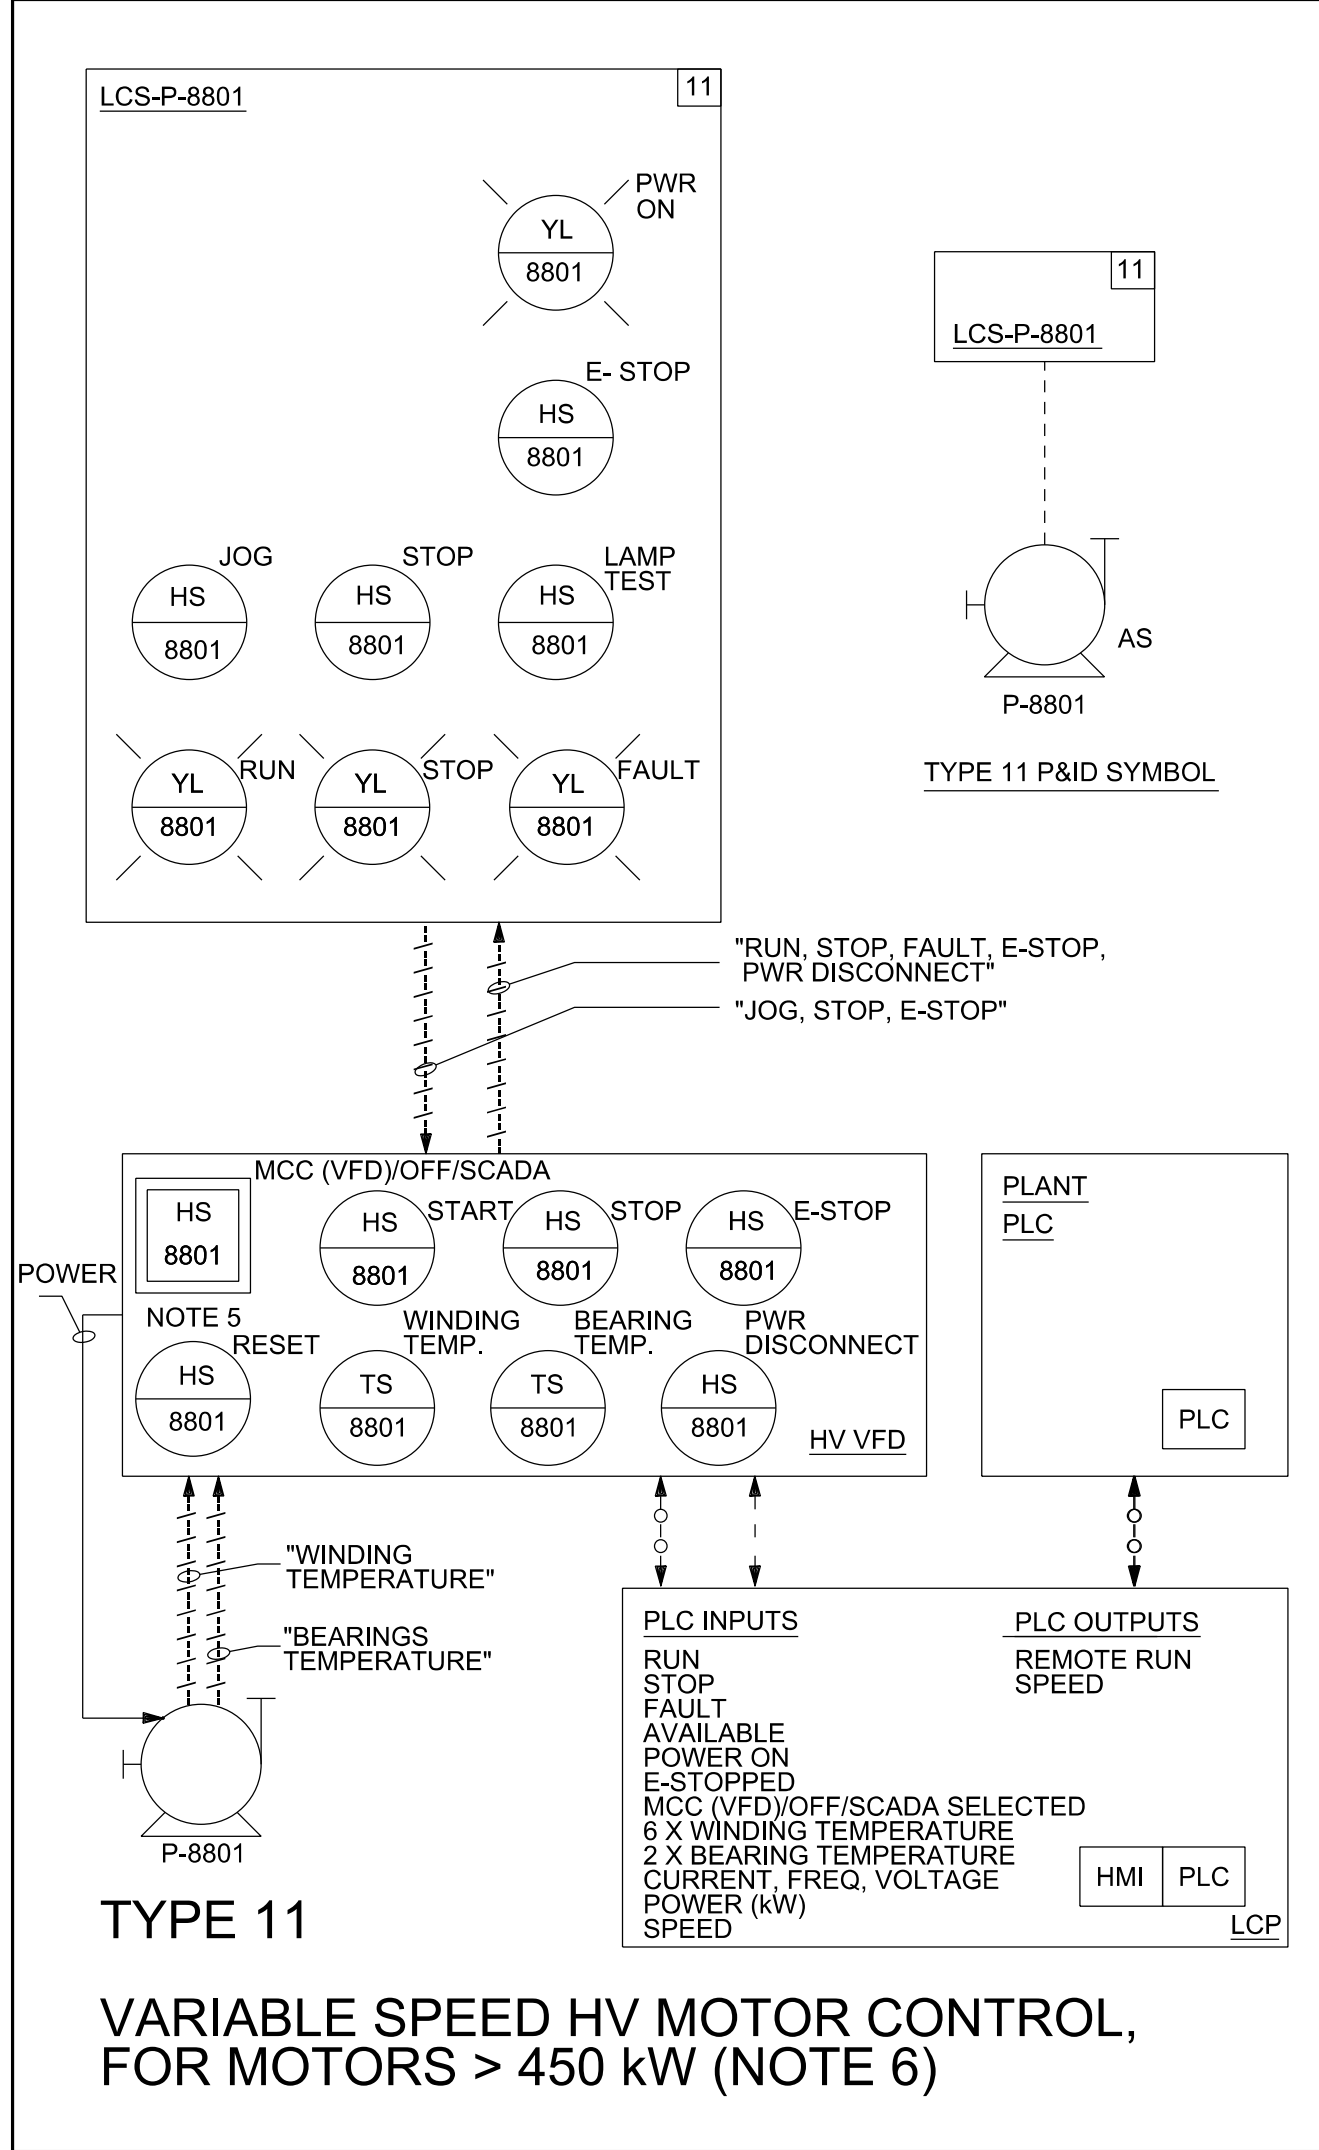

TENDER			
T1 20/05/22	ISSUED FOR TENDER C4B	CN	GOT
T1 02/07/21	ISSUED FOR TENDER C3D2	CN	GOT
T1 18/12/20	ISSUED FOR TENDER C3B1	CN	GOT
T1 23/07/20	ISSUED FOR TENDER C2B	CN	GOT
T1 24/04/20	ISSUED FOR TENDER C3A	CN	GOT
T1 08/04/20	ISSUED FOR TENDER C3D1	CN	GOT
REV	DATE	DESCRIPTION	REVIEWED / AUTHORISED
CLIENT:			
 SINGAPORE'S NATIONAL WATER AGENCY			
PROGRAMME MANAGER:			
 A JOINT VENTURE DELIVERING THE DTSS2 PROJECT			
CONSULTANT:			
 CH2M HILL Singapore Pte Ltd			
PROJECT TITLE:			
TUAS WATER RECLAMATION PLANT (TWRP) DTSS PHASE 2			
DRAWING TITLE			
P&ID LEGEND LOCAL CONTROL STATION SHEET 2 OF 4			
DRAFTED: LL	DESIGNED: JL	SHEET SIZE: A1	
DRAFTING CHECK: DW	DESIGN CHECK: JL	SCALE: NTS	
DATE: 29/11/17	REVIEWED: CN	PBS: 131101	
CONTRACT:	DRAWING NUMBER:		
-	PUB-DTSS2-TWRP		
	SHEET NUMBER:		REVISION:
	WSW00-P-0015		T1
THIS DRAWING IS COPYRIGHT			