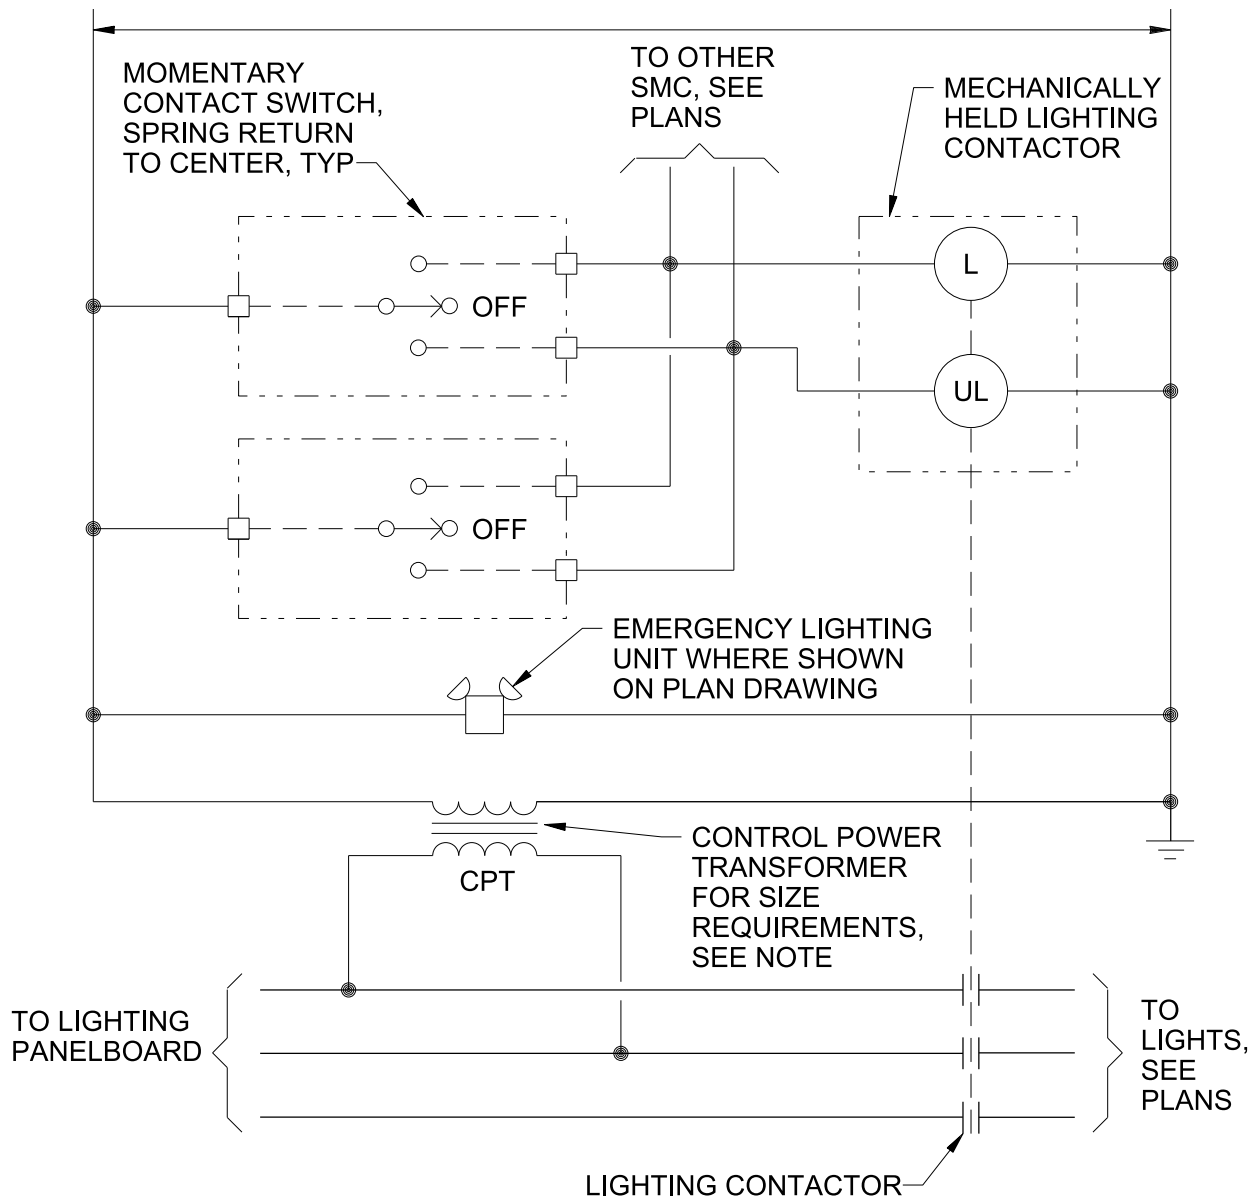


**NOTE:**

CONTROL POWER TRANSFORMER (CPT) SHALL BE 50 VA MINIMUM. WHERE EMERGENCY LIGHTING UNITS ARE SERVED, CPT SIZE SHALL BE INCREASED BY THE SUM OF THE AC INPUT VOLT-AMP OF THE UNITS.

HID AND EMERGENCY LIGHTING CONTROL

NTS

16028

STANDARD DETAIL

JACOBS