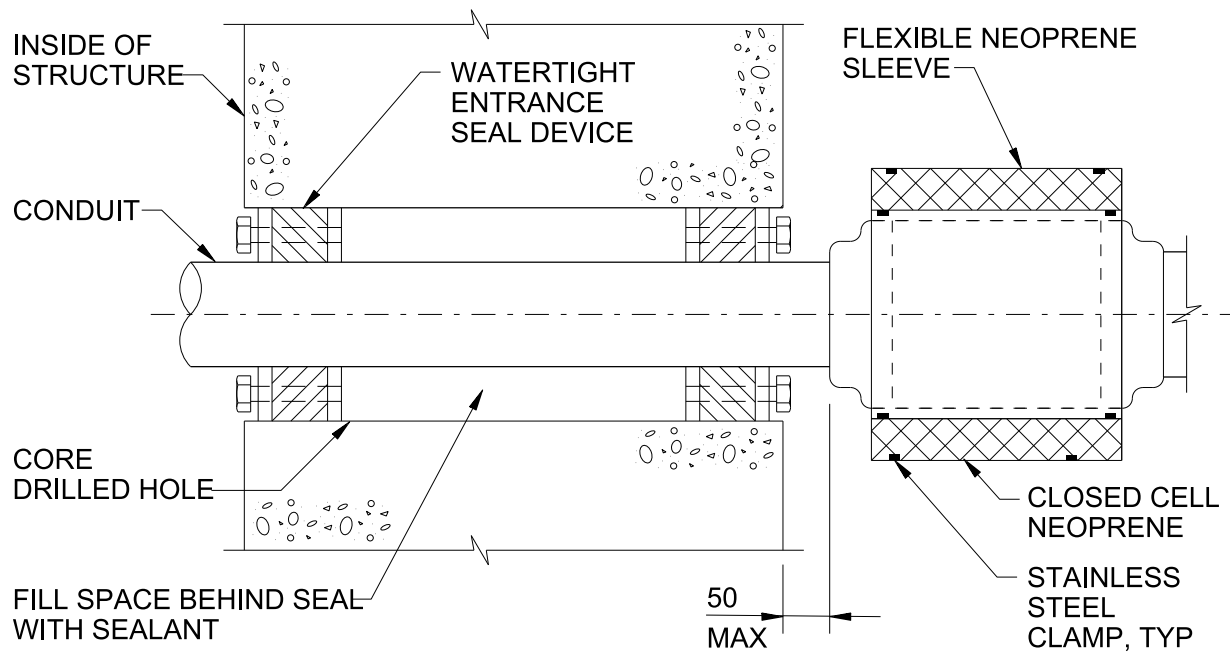


**NOTE:**

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. USE WATERTIGHT CONDUIT SEAL WHERE CONDUIT PENETRATIONS OF EXISTING BUILDING EXTERIOR WALLS ARE BELOW GRADE.

WATERTIGHT WALL CONDUIT SEAL

NTS

STANDARD DETAIL

16108

JACOBS