


CONDUIT RISER TO DEVICE, J-BOX
OR CONTROL PANEL AT CHEMICAL
TANK AS REQUIRED. CONDUIT SHALL
BE SUPPORTED WITHIN 600 mm
OF EXITING THE CONCRETE

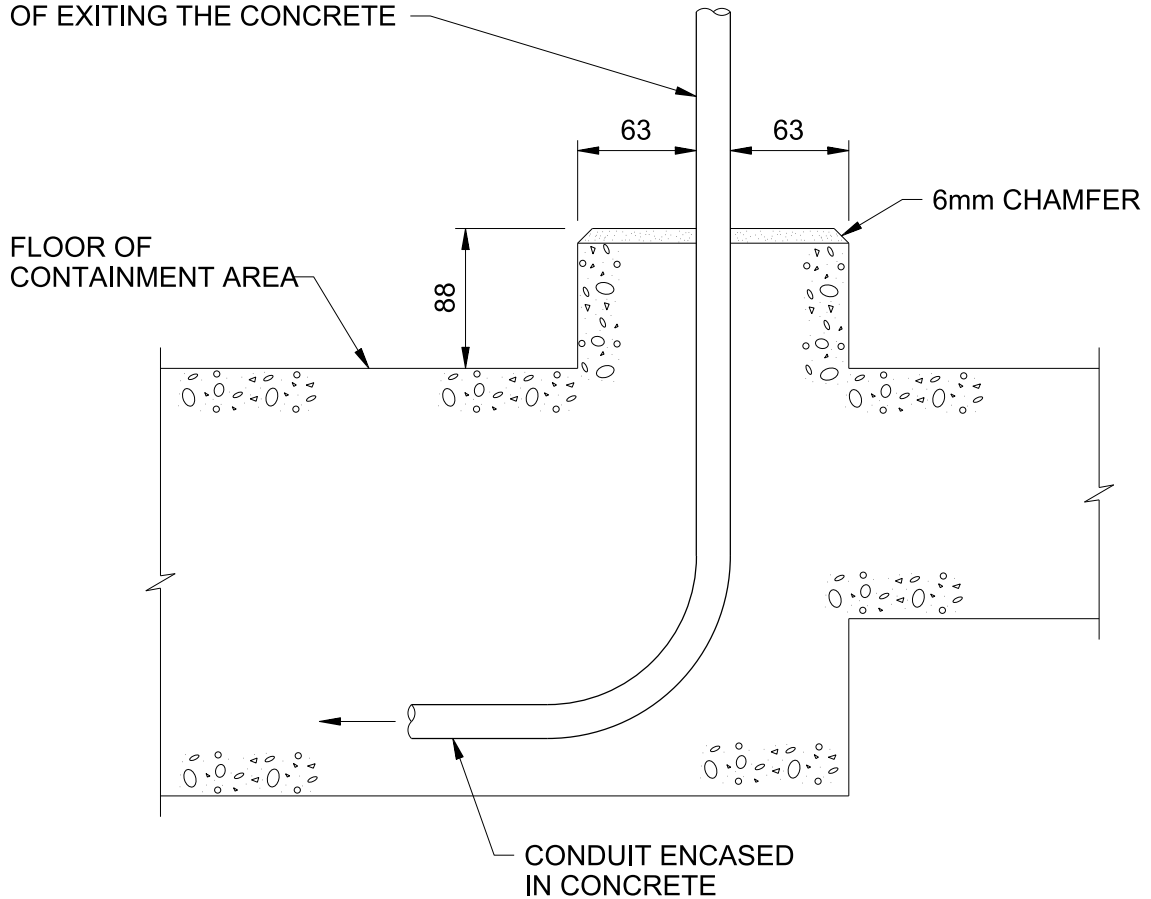

NOTE:

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. CONDUIT INSTALLED INSIDE OF A CONTAINMENT AREA SHALL BE INSTALLED IN ACCORDANCE WITH THIS DETAIL. FOR TYPE OF CONDUIT TO BE INSTALLED, SEE SPECIFICATION.

CONDUIT TERMINATION IN CONTAINMENT AREA

NTS

STANDARD DETAIL

16113

JACOBS