


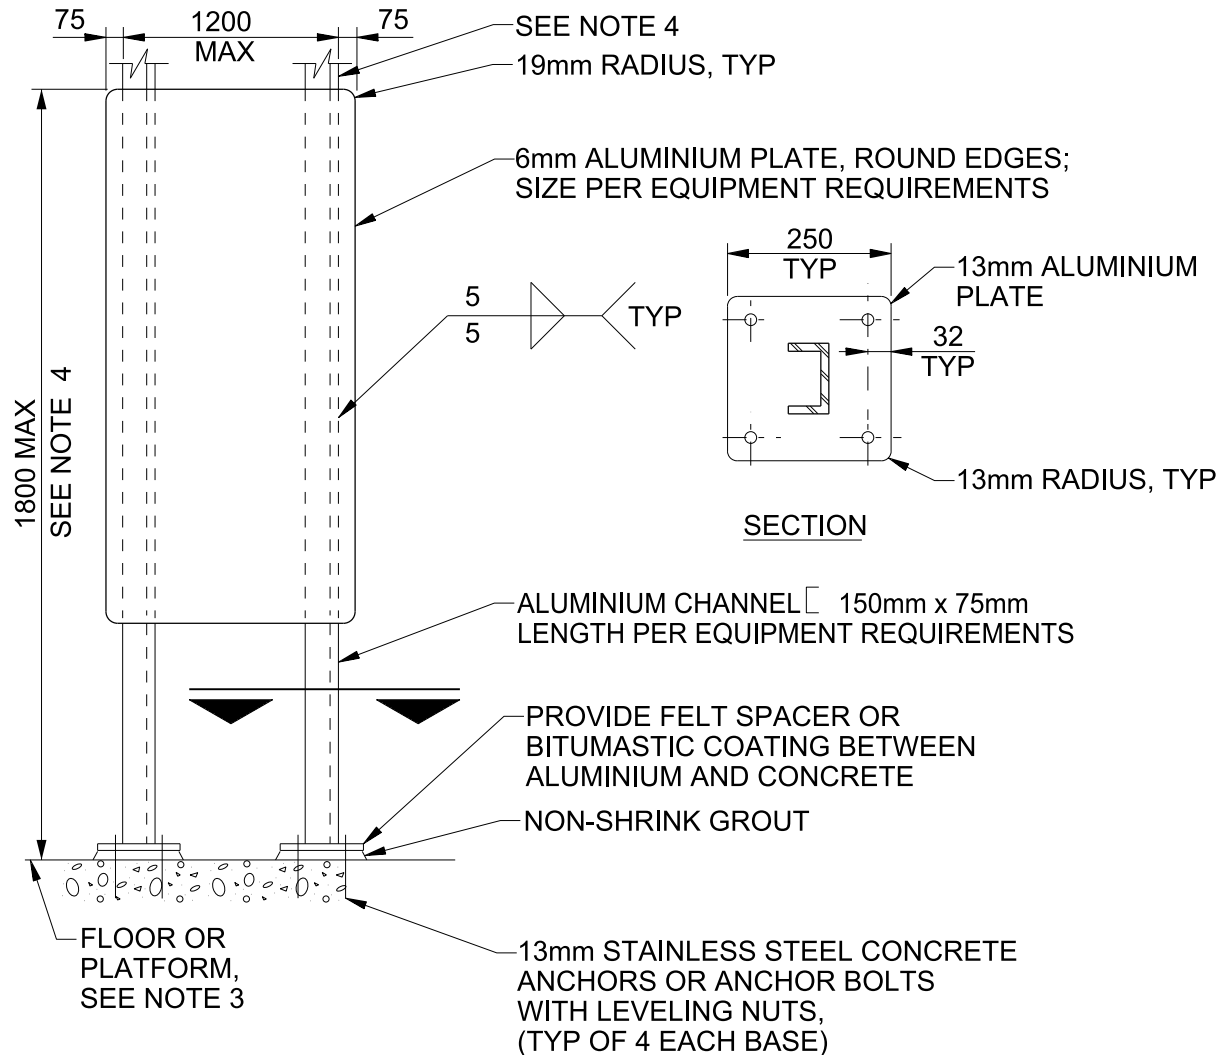

NOTES:

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. USE STAINLESS STEEL MOUNTING HARDWARE. USE WASHER AND SPLIT LOCK WASHER UNDER ALL NUTS.
3. FOR YARD LOACTIONS PROVIDE A 150mm THICK CONCRETE PAD AT GRADE WITH #4 BAR @ 300mm OC EACH WAY, CENTERED. THE PAD SHALL BE 300mm LONGER THAN THE MOUNTING PLATE BY ONE HALF THE HEIGHT OF THE MOUNTING PLATE ABOVE FINISHED GRADE. MINIMUM WIDTH 600mm.
4. FOR HEIGHTS EXCEEDING 1500mm OR WEIGHT OF MOUNTED EQUIPMENT EXCEEDING 90kg, SIZE POSTS AND CONNECTIONS FOR LATERAL LOADS.

ELECTRICAL EQUIPMENT SUPPORT

NTS

STANDARD DETAIL

16162B

JACOBS