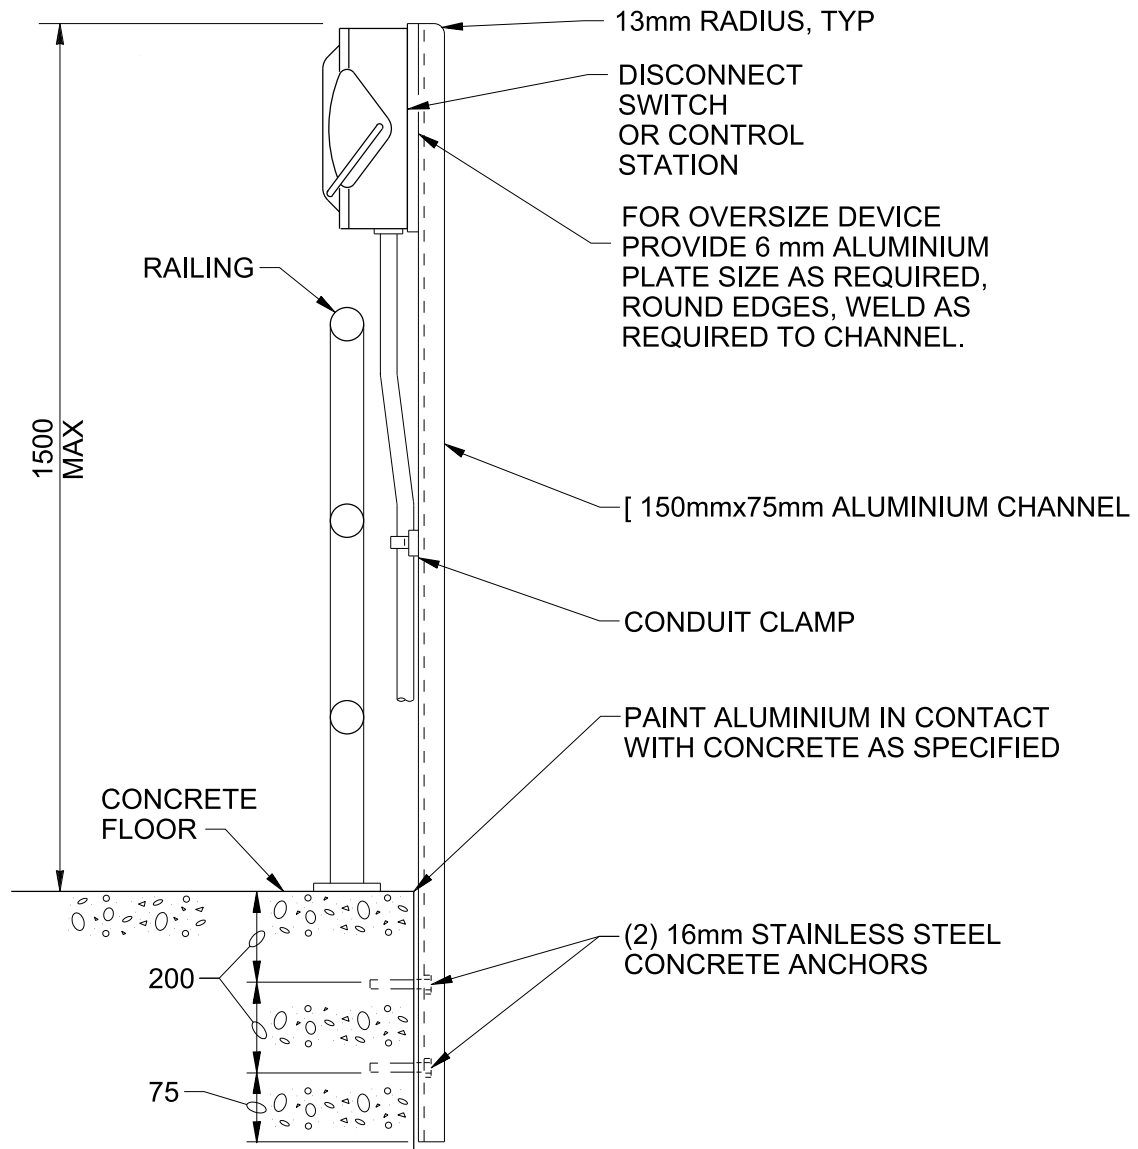


**NOTES :**

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. EQUIPMENT HAVING A FRONTAL AREA GREATER THAN 0.27 SQUARE METERS OR WIDER THAN 450mm SHALL BE SUPPORTED BY TWO CHANNELS. USE STAINLESS STEEL MOUNTING HARDWARE. INSTALL RING AND SPLIT LOCK WASHERS UNDER ALL NUTS AND BOLTS.

PEDESTAL MOUNTED DEVICE AT RAILING

NTS

STANDARD DETAIL

16167

JACOBS