


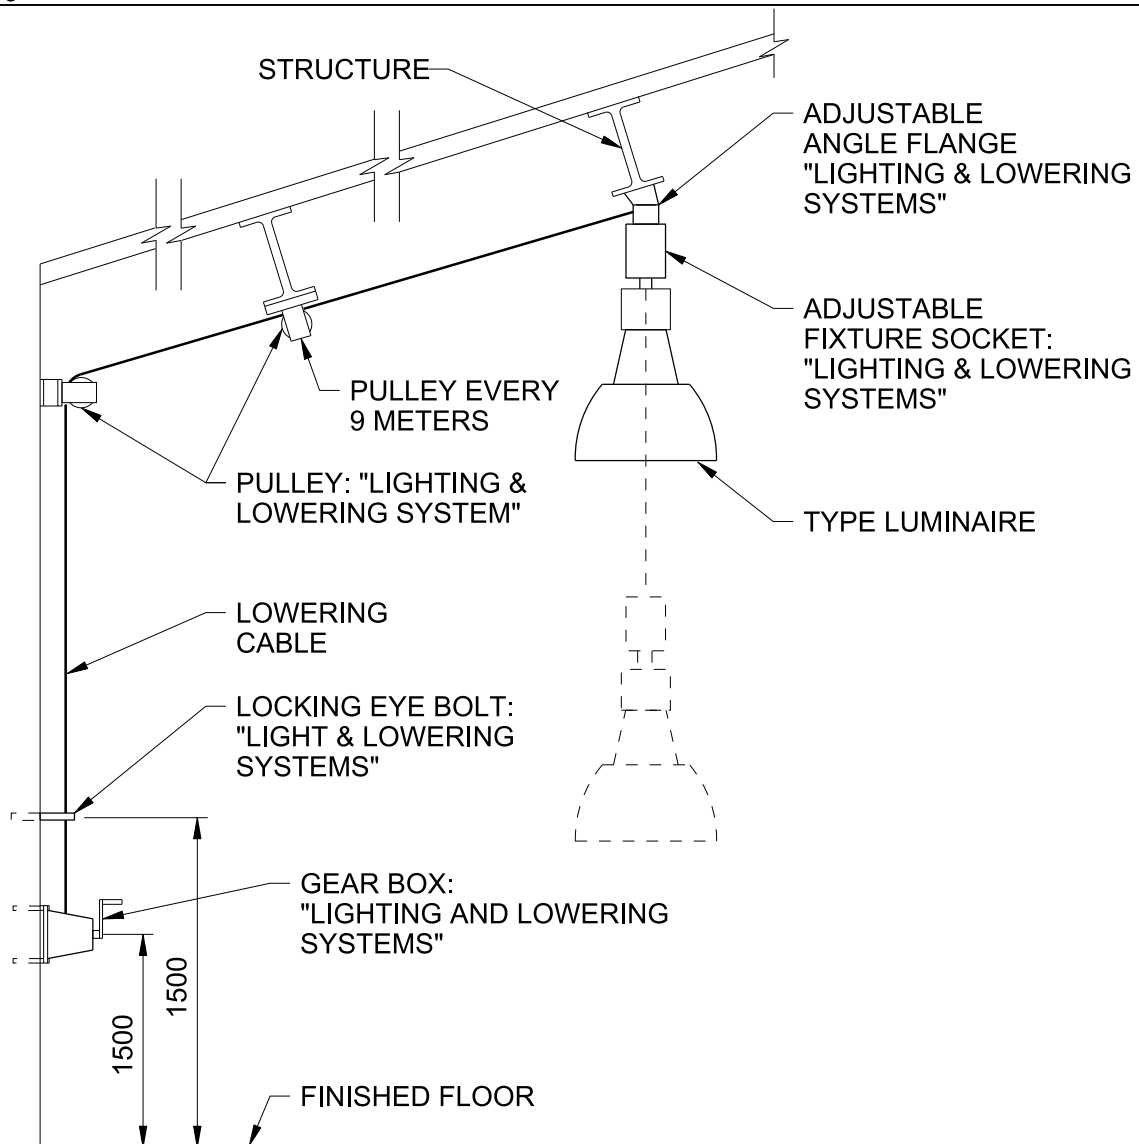

NOTES:

1. ALL HANGERS MUST BE PLUMB. ALLOW AMPLE CLEARANCE BETWEEN OPERATING LINE AND STRUCTURAL MEMBERS, PIPES, DUCTS, ETC. ALL CONDUIT RUNS ENCLOSING OPERATING LINES MUST BE STRAIGHT WITH NO OFFSET BENDS.

LIGHT FIXTURE LOWERING

NTS

STANDARD DETAIL

16207

JACOBS