


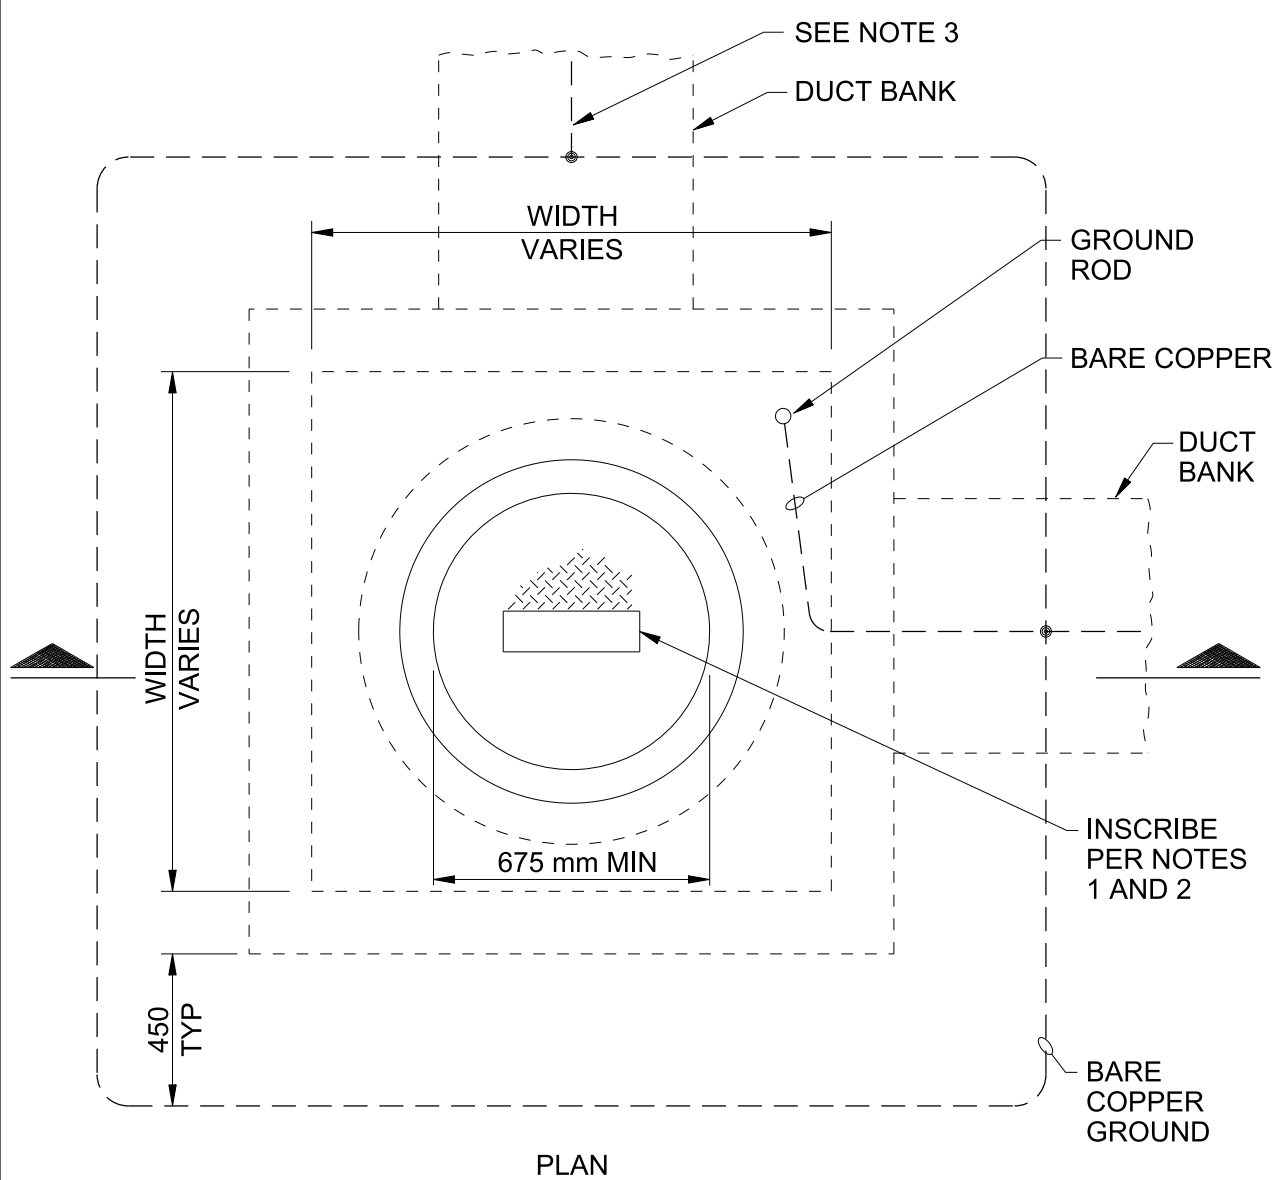

NOTES:

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. INSCRIBE "ELECTRICAL HIGH VOLTAGE" IF ANY CIRCUIT IN MANHOLE IS ABOVE 600V.
3. INSCRIBE "ELECTRICAL LOW VOLTAGE" IF ALL CIRCUITS IN MANHOLE ARE 600V OR LESS.
4. INSTALL BARE COPPER EARTH CENTERED ON TOP OF ALL DUCT RUNS.

MANHOLE-WITH GROUNDING

NTS

STANDARD DETAIL

16351A

JACOBS