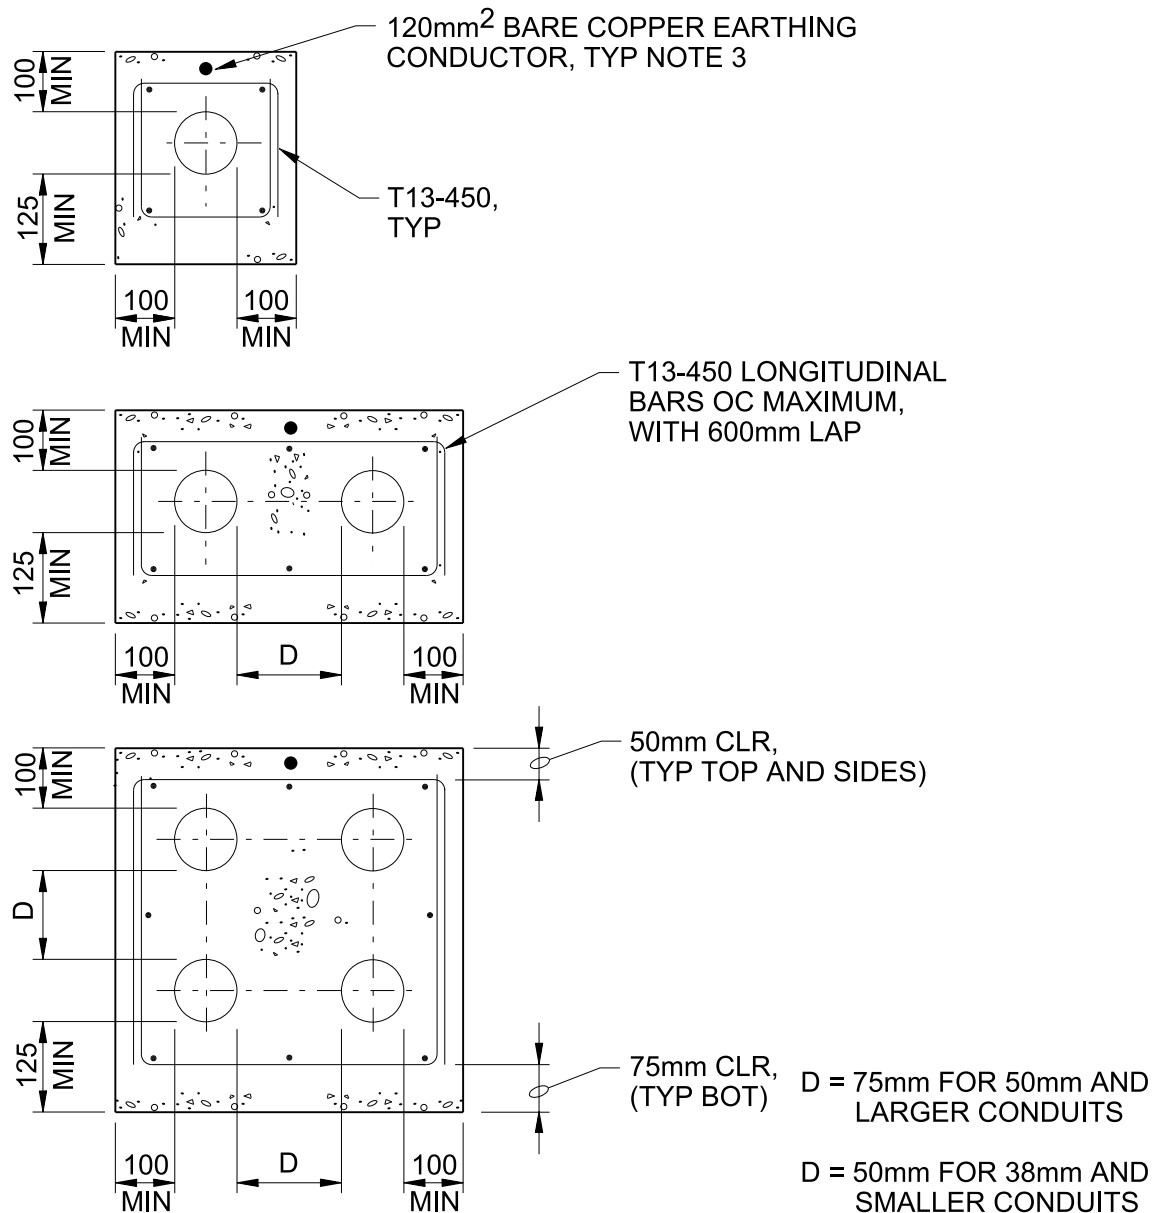


**NOTES:**

1. ALL DIMENSIONS IN MILLIMETERS, UNLESS OTHERWISE NOTED.
2. PROVIDE 200mm MINIMUM COMPACTED GRAVEL, 19mm MINUS, UNDER ALL CONCRETE ENCASED DUCT RUNS.
3. EARTHING CONDUCTOR TO BE CONTINUOUS AND CONNECTED TO EARTH BAR AT EACH END OF DUCT BANKS.

**DUCT BANK**

NTS

16400A

STANDARD DETAIL

**JACOBS**